

A NEW ACCESSORY DWELLING UNIT PROJECT FOR:

SACRAMENTO COUNTY PERMIT READY ADU (ACCESSORY DWELLING UNIT) PLANS MODEL C **ELDERBERRY**

SCOPE OF WORK:

CONSTRUCT NEW 998 S.F. ACCESSORY DWELLING UNIT.

- SLAB FOUNDATION
- 2X6 EXTERIOR WALLS W/ STUCCO OR FIBER CEMENT LAP SIDING EXTERIOR FINISH
- PRE-FABRICATED TRUSS ROOF WITH ASPHALT SHINGLE ROOFING
- VINYL WINDOWS
- HYBRID ELECTRIC WATER HEATER

UTILITY NOTES:

- NO GAS TO BE INSTALLED IN ADU
- PROPOSED ADU TO TIE INTO (E) MAIN WATER LINE
- PROPOSED ADU TO TIE INTO (E) S.F.R. SEWER SERVICE. NOTE: SEWER TIE-IN MUST BE OUTSIDE OF ADU FOOTPRINT
- ELECTRICAL SERVICE TO TIE INTO (E) S.F.R. OR CUSTOMER TO COORDINATE W/ UTILITY COMPANY TO OBTAIN (N) ELECTRICAL SERVICE AND METER

PROJECT SPECIFIC NOTES:

- MODIFICATIONS TO THIS PLAN SET ARE NOT ALLOWED; THESE PLANS MAY BE USED ONLY FOR CONSTRUCTION ON LOTS WITHIN THE UNINCORPORATED COUNTY OF SACRAMENTO AND ONLY IF THE PROPERTY OWNER EXECUTES A HOLD HARMLESS AGREEMENT TO THE SATISFACTION OF THE COUNTY OF SACRAMENTO.

PV INSTALLATION REQUIRED UNDER SEPARATE PERMIT; PER ENERGY T24, Standard Design PV Capacity: 2.15 kWdc min. **NOTE: PV system permit must be approved and issued prior to "104 Frame Inspection" of this dwelling permit. A "Final Hold" Condition will be placed on dwelling permit requiring Final of PV installation prior to or at time of Final Inspection of this permit.

PROJECT DATA:

CUSTOMER ADDRESS: _____

APN: _____

JURISDICTION: SACRAMENTO COUNTY

S.F. OF PROPOSED ADU: 1,000 S.F.

PORCH: 104 S.F.

COVERED PATIO: 134 S.F.

FOUNDATION: SLAB

OCCUPANCY: R-3

CONSTRUCTION: TYPE V-B


CODES: 2022 CALIFORNIA RESIDENTIAL BUILDING CODE
2022 CALIFORNIA ELECTRICAL CODE
2022 CALIFORNIA MECHANICAL CODE
2022 CALIFORNIA PLUMBING CODE
2022 CALIFORNIA ENERGY CODE
2022 CALGREEN CODE

PROJECT CONTACTS:

OWNER/CONTRACTOR:
ADDRESS AND CONTACT INFORMATION _____

ARCHITECT: LAURA MILLER DESIGN
CONTACT: LAURA MILLER
889 EMBARCADERO DRIVE, STE 104
EL DORADO HILLS, CA 95762
916.607.3321

STRUCTURAL ENGINEER: WCD & ASSOCIATES
CONTACT: WESLEY CULLUMBER
6930 DESTINY DRIVE, STE 300
ROCKLIN, CA 95677

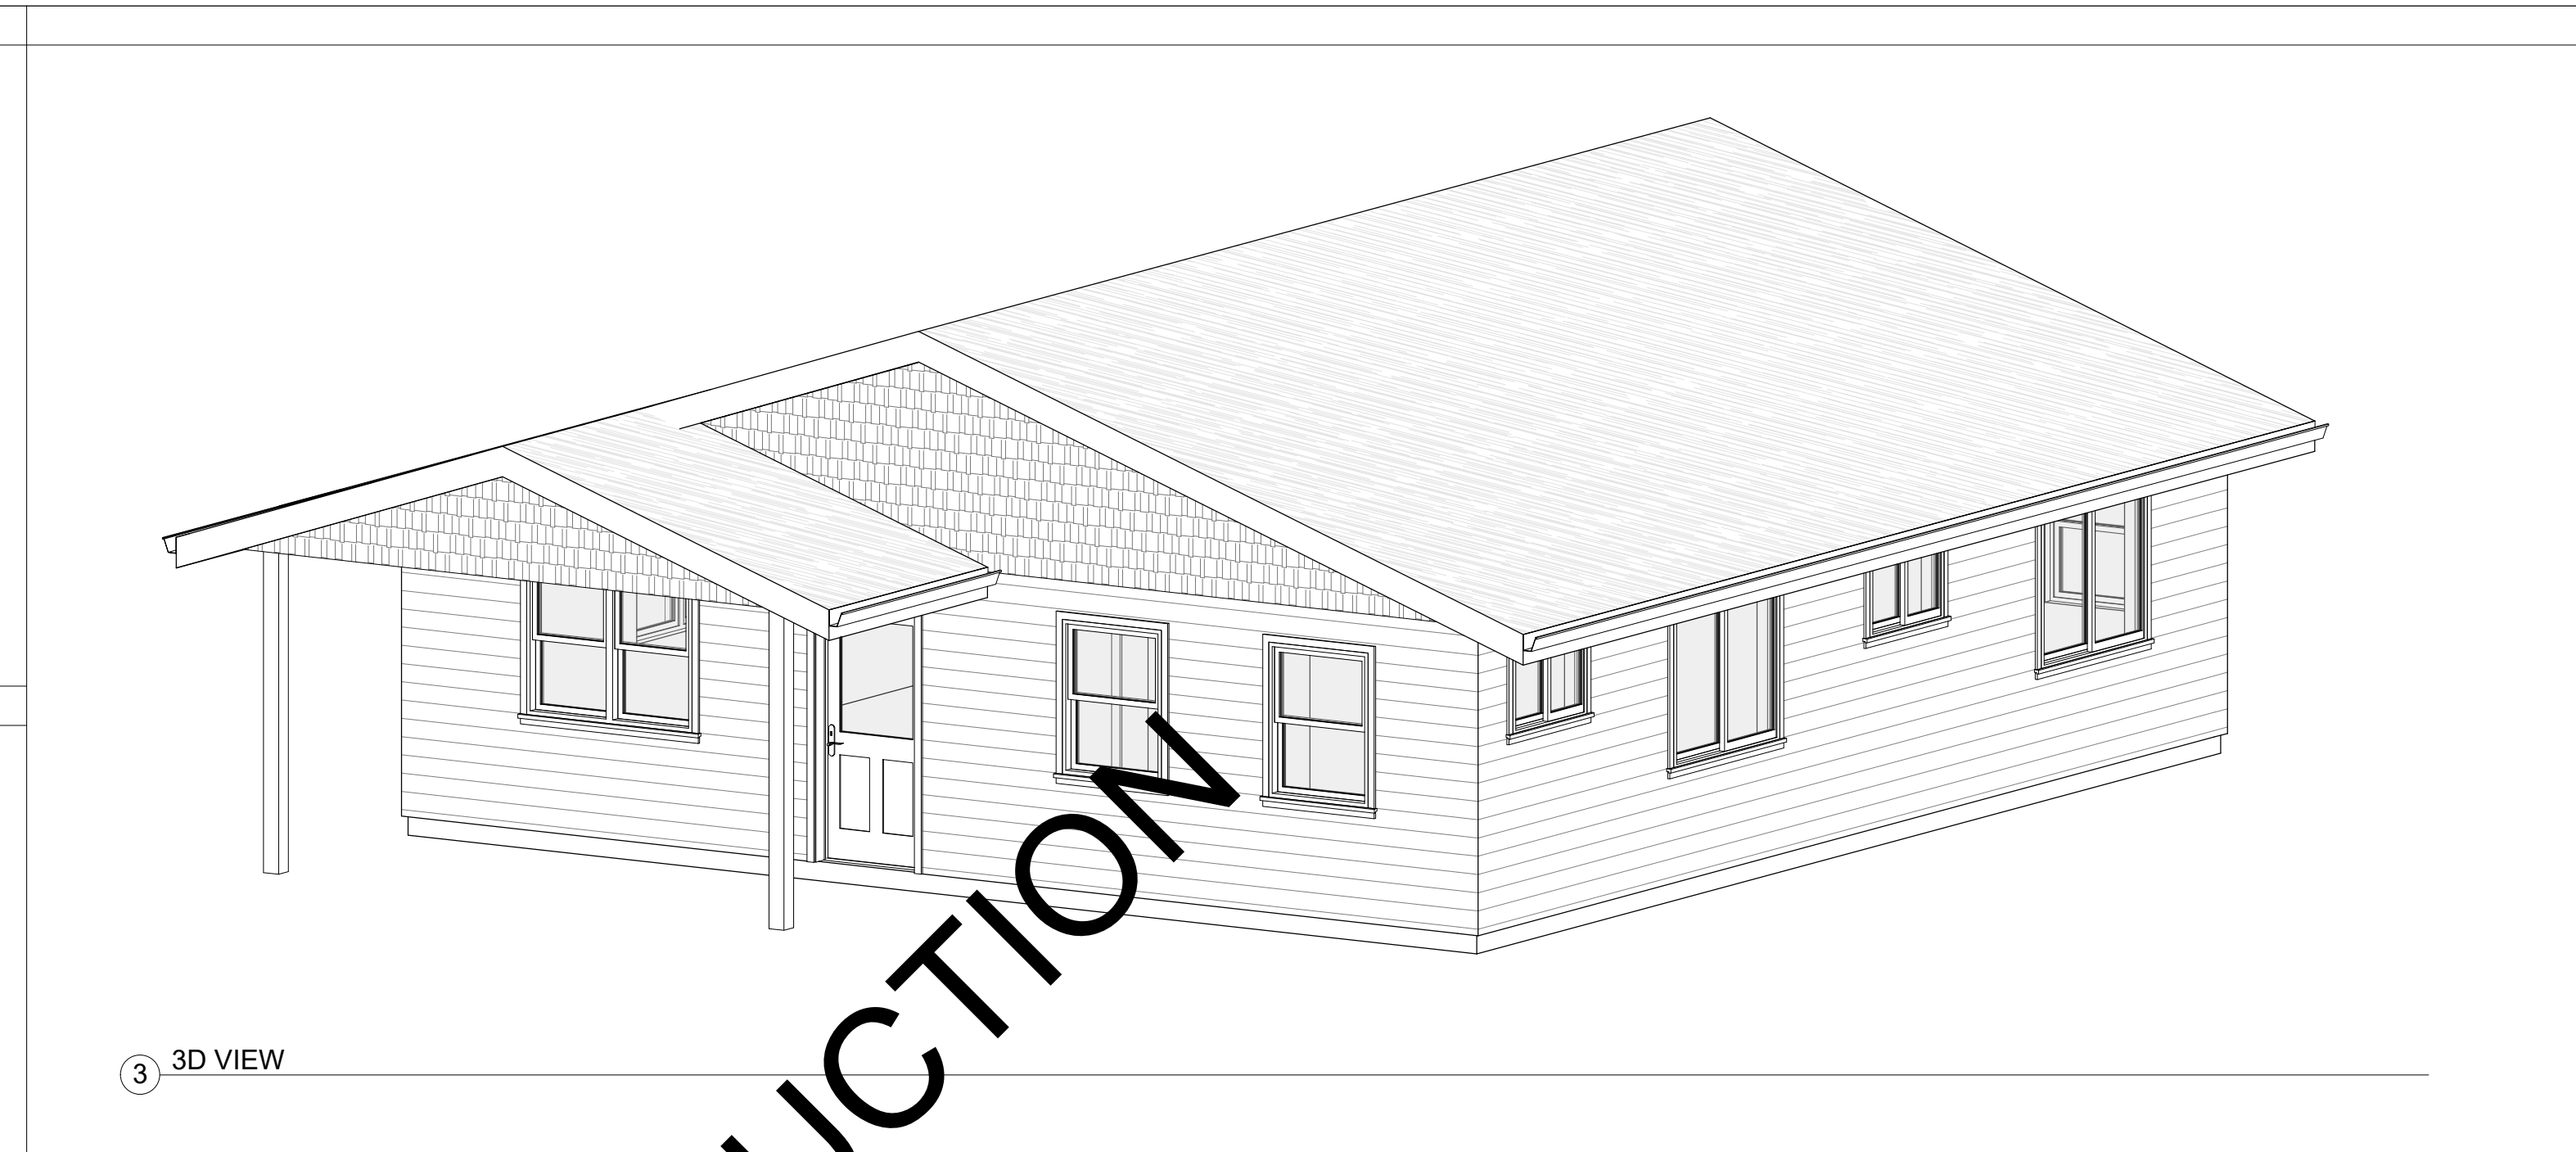

DEFERRED SUBMITTALS:

- FIRE SPRINKLERS (AS NEEDED)
- PHOTOVOLTAIC SYSTEM

PHOTOVOLTAIC REQUIREMENTS:

PER CA ENERGY CODE SUBCHAPTER 8 SECTION 150.1(C)14 ALL LOW-RISE RESIDENTIAL BUILDINGS SHALL HAVE A PHOTOVOLTAIC (PV) SYSTEM MEETING THE MINIMUM QUALIFICATION REQUIREMENTS AS SPECIFIED IN JOINT APPENDIX JA1

CUSTOMER TO SUPPLY PV PLANS AS A DEFERRED SUBMITTAL OR UTILIZE SMUD'S SOLAR SHARES PROGRAM

GRADING & DRAINAGE NOTES:

- GRADE SHALL FALL A MINIMUM OF 6" IN THE FIRST 10 FEET AWAY FROM NEW FOUNDATION WALLS WHERE THERE IS NO PAVING PER CRC 401.3. WHERE DISTANCE IS LESS THAN 10' WATER SHALL SLOPE AWAY FROM FOUNDATION
- IMPERVIOUS SURFACES WITHIN 10 FEET OF THE BUILDING FOUNDATION SHALL BE SLOPED A MINIMUM OF 2 PERCENT AWAY FROM THE BUILDING.

GENERAL NOTES:

- THE INFORMATION ON THIS SET OF CONSTRUCTION DOCUMENTS IS RELATED TO THE BASIC DESIGN INTENT OF THE PROJECT. THEY ARE INTENDED AS A CONSTRUCTION AID, NOT A SUBSTITUTE FOR GENERALLY ACCEPTED GOOD BUILDING PRACTICES AND COMPLIANCE WITH CURRENT CALIFORNIA STATE BUILDING CODES. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR PROVIDING STANDARD CONSTRUCTION DETAILS AND PROCEDURES TO ENSURE A PROFESSIONALLY FINISHED, STRUCTURALLY SOUND, AND WEATHERPROOF COMPLETED PROJECT.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT ALL WORK AND CONSTRUCTION MEETS ALL CURRENT FEDERAL, STATE, COUNTY, AND LOCAL CODES, ORDINANCES, REGULATIONS, ETC. THESE CODES ARE TO BE CONSIDERED PART OF THE SPECIFICATION FOR THIS BUILDING AND SHOULD BE ADHERED TO EVEN IF THEY ARE IN VARIANCE OF THE PLAN.
- DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE DRAWING (DO NOT SCALE DRAWING.)
- THE ARCHITECT HAS NOT BEEN ENGAGED FOR CONSTANT CONSTRUCTION SUPERVISION AND ASSUMES NO RESPONSIBILITY FOR CONSTRUCTION COORDINATING WITH THESE PLANS, NOR RESPONSIBILITY FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCE OF PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK. THERE ARE NO WARRANTIES FOR A SPECIFIC USE EXPRESSED OR IMPLIED IN THE USE OF THESE PLANS.

SITE PLAN REQUIREMENTS:

NOTE: APPLICANT IS REQUIRED TO PROVIDE A SITE PLAN (INCLUDING ALL EXISTING AND PROPOSED STRUCTURES, SIZES, LOCATIONS, USES, PLANNING DEPT SETBACKS AND ANY PUBLIC UTILITY EASEMENT(S) LOCATIONS, MAIN DWELLING ELECTRICAL PANEL LOCATION FOR A.D.U. SUB-PANEL SITUATIONS, SEWER LINE SIZE AND LOCATION ON SITE WITH CONNECTION LOCATION OF PRIMARY DWELLING SEWER MAIN, WATER SUPPLY LINE SIZE, LOCATION AND CONNECTION) AND INCORPORATE IT INTO THIS PLAN SET PRIOR TO SUBMITTING PLANS

SEE ELEVATION SHEETS FOR ADDITIONAL INFORMATION/REQUIREMENTS TO PROVIDE DWELLING ADDRESS PER 2022 CRC R319

SETBACK REQUIREMENTS:

NOTE: ADU FOOTPRINT AND ALL ROOF OVERHANGS MAY NOT PROJECT INTO ANY PUBLIC UTILITY EASEMENTS.

ROOF OVERHANG REQUIREMENTS:

FIREBLOCKING NOTES:

- FIREBLOCKING SHALL BE PROVIDED IN WOOD-FRAMED CONSTRUCTION IN THE FOLLOWING LOCATIONS:
- IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 - VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 - HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET (3048 MM).
- AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
- IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
- AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION.
- FIREBLOCKING MATERIALS SHALL COMPLY WITH R302.11.1

FIRE SPRINKLER REQUIREMENTS:



PER R313.2 AN AUTOMATIC RESIDENTIAL FIRE SPRINKLER SYSTEM SHALL NOT BE REQUIRED IN ACCESSORY DWELLING UNITS, PROVIDED ALL OF THE FOLLOWING ARE MET:

- THE UNIT MEETS THE DEFINITION OF AN ACCESSORY DWELLING UNIT AS DEFINED IN THE GOVERNMENT CODE SECTION 65852.2.
- THE EXISTING PRIMARY RESIDENCE DOES NOT HAVE AUTOMATIC FIRE SPRINKLERS.
- THE ACCESSORY DETACHED DWELLING UNIT DOES NOT EXCEED 1,200 SQUARE FEET IN SIZE.
- THE UNIT IS ON THE SAME LOT AS THE PRIMARY RESIDENCE.

FINAL DETERMINATION OF FIRE SPRINKLER REQUIREMENT WILL BE MADE BY LOCAL FIRE JURISDICTION

SEE ALSO FIRE SPRINKLER INFORMATION BLOCK NOTE @ RIGHT OF THIS SHEET.

Sheet Number	Sheet Name
A-0.0	TITLE SHEET
A-0.1	CALGREEN CHECKLIST
A-0.2	CALGREEN CHECKLIST CONT.
A-1.0	FLOOR PLAN
A-1.1	ROOF PLAN
A-1.2	POWER PLAN
A-2.0	EXTERIOR ELEVATIONS
A-3.0	STUCCO SECTION DETAILS
A-3.1	STUCCO PLAN DETAILS
A-3.2	LAP SIDING SECTION DETAILS
A-3.3	LAP SIDING PLAN DETAILS
A-3.4	FIRE DETAILS
S1.0	FOUNDATION & SHEAR WALL PLAN
S2.0	SHEARWALL PLAN
S3.0	ROOF FRAMING PLAN
SD1	STRUCTURAL DETAILS
SD2	STRUCTURAL DETAILS
SD3	STRUCTURAL DETAILS
SN1	STRUCTURAL NOTES & SPECIFICATIONS
T24-1	ENERGY CODE
T24-2	ENERGY CODE
T24-3	ENERGY CODE

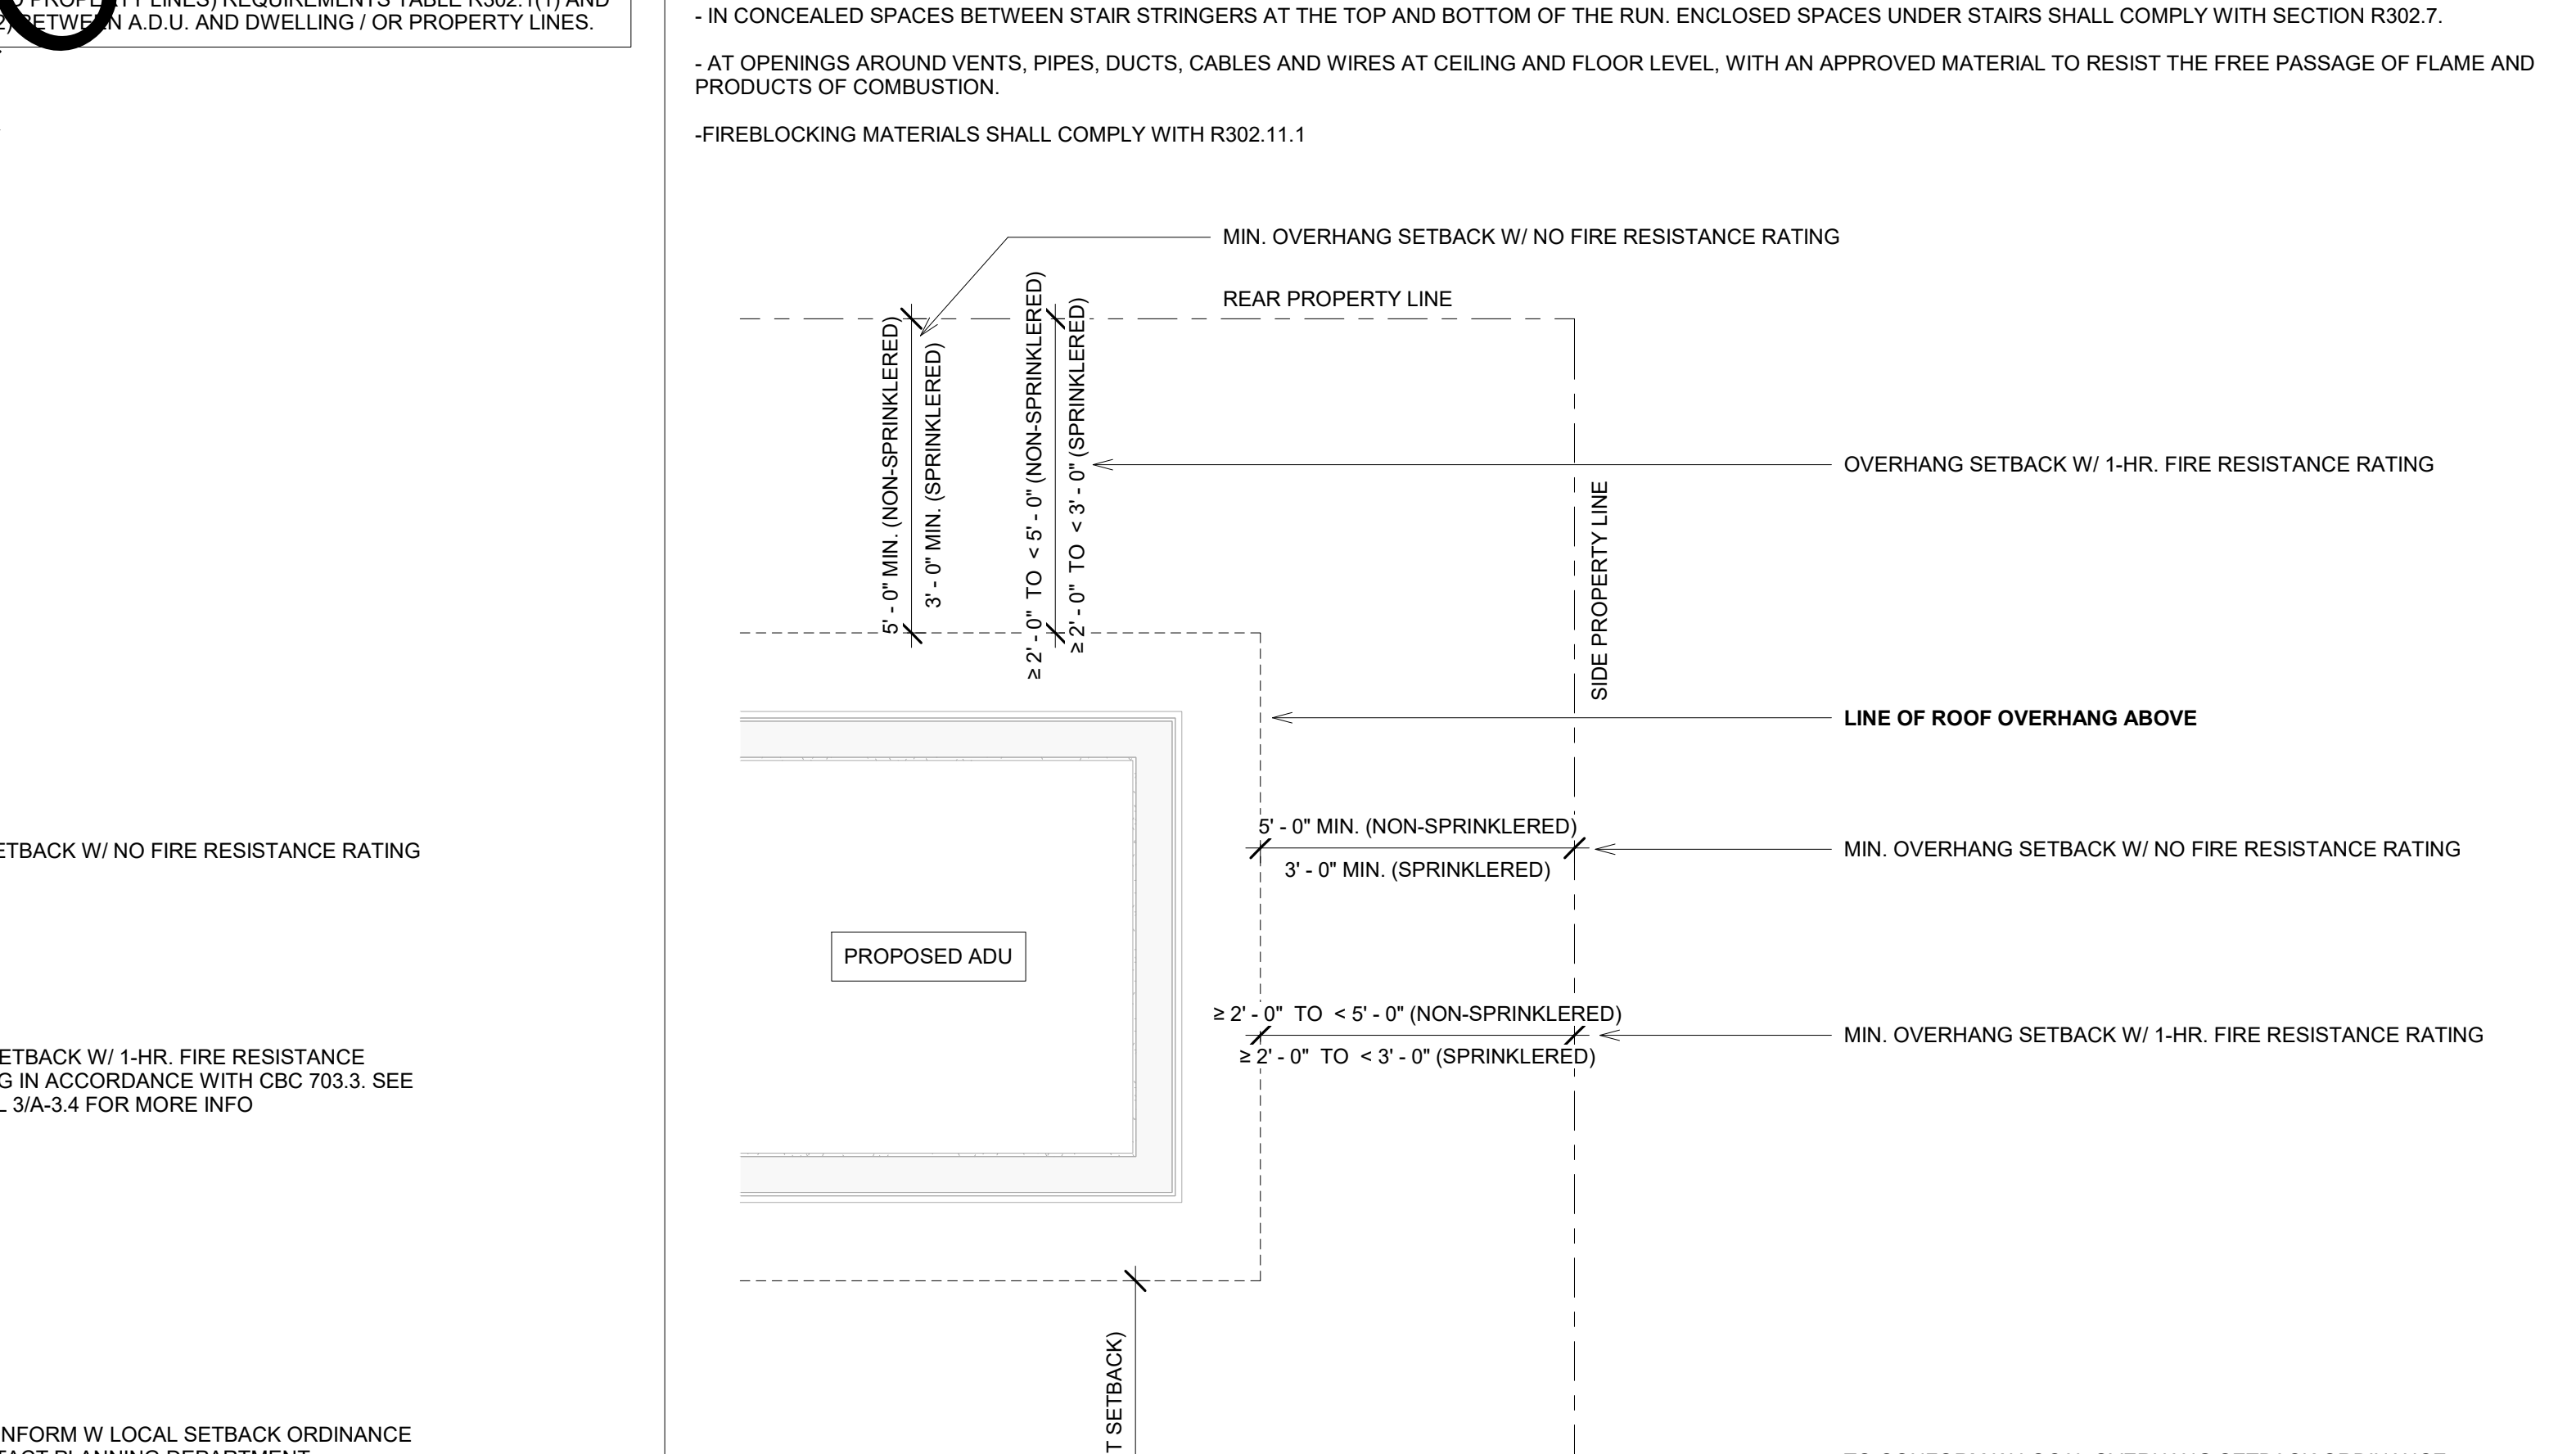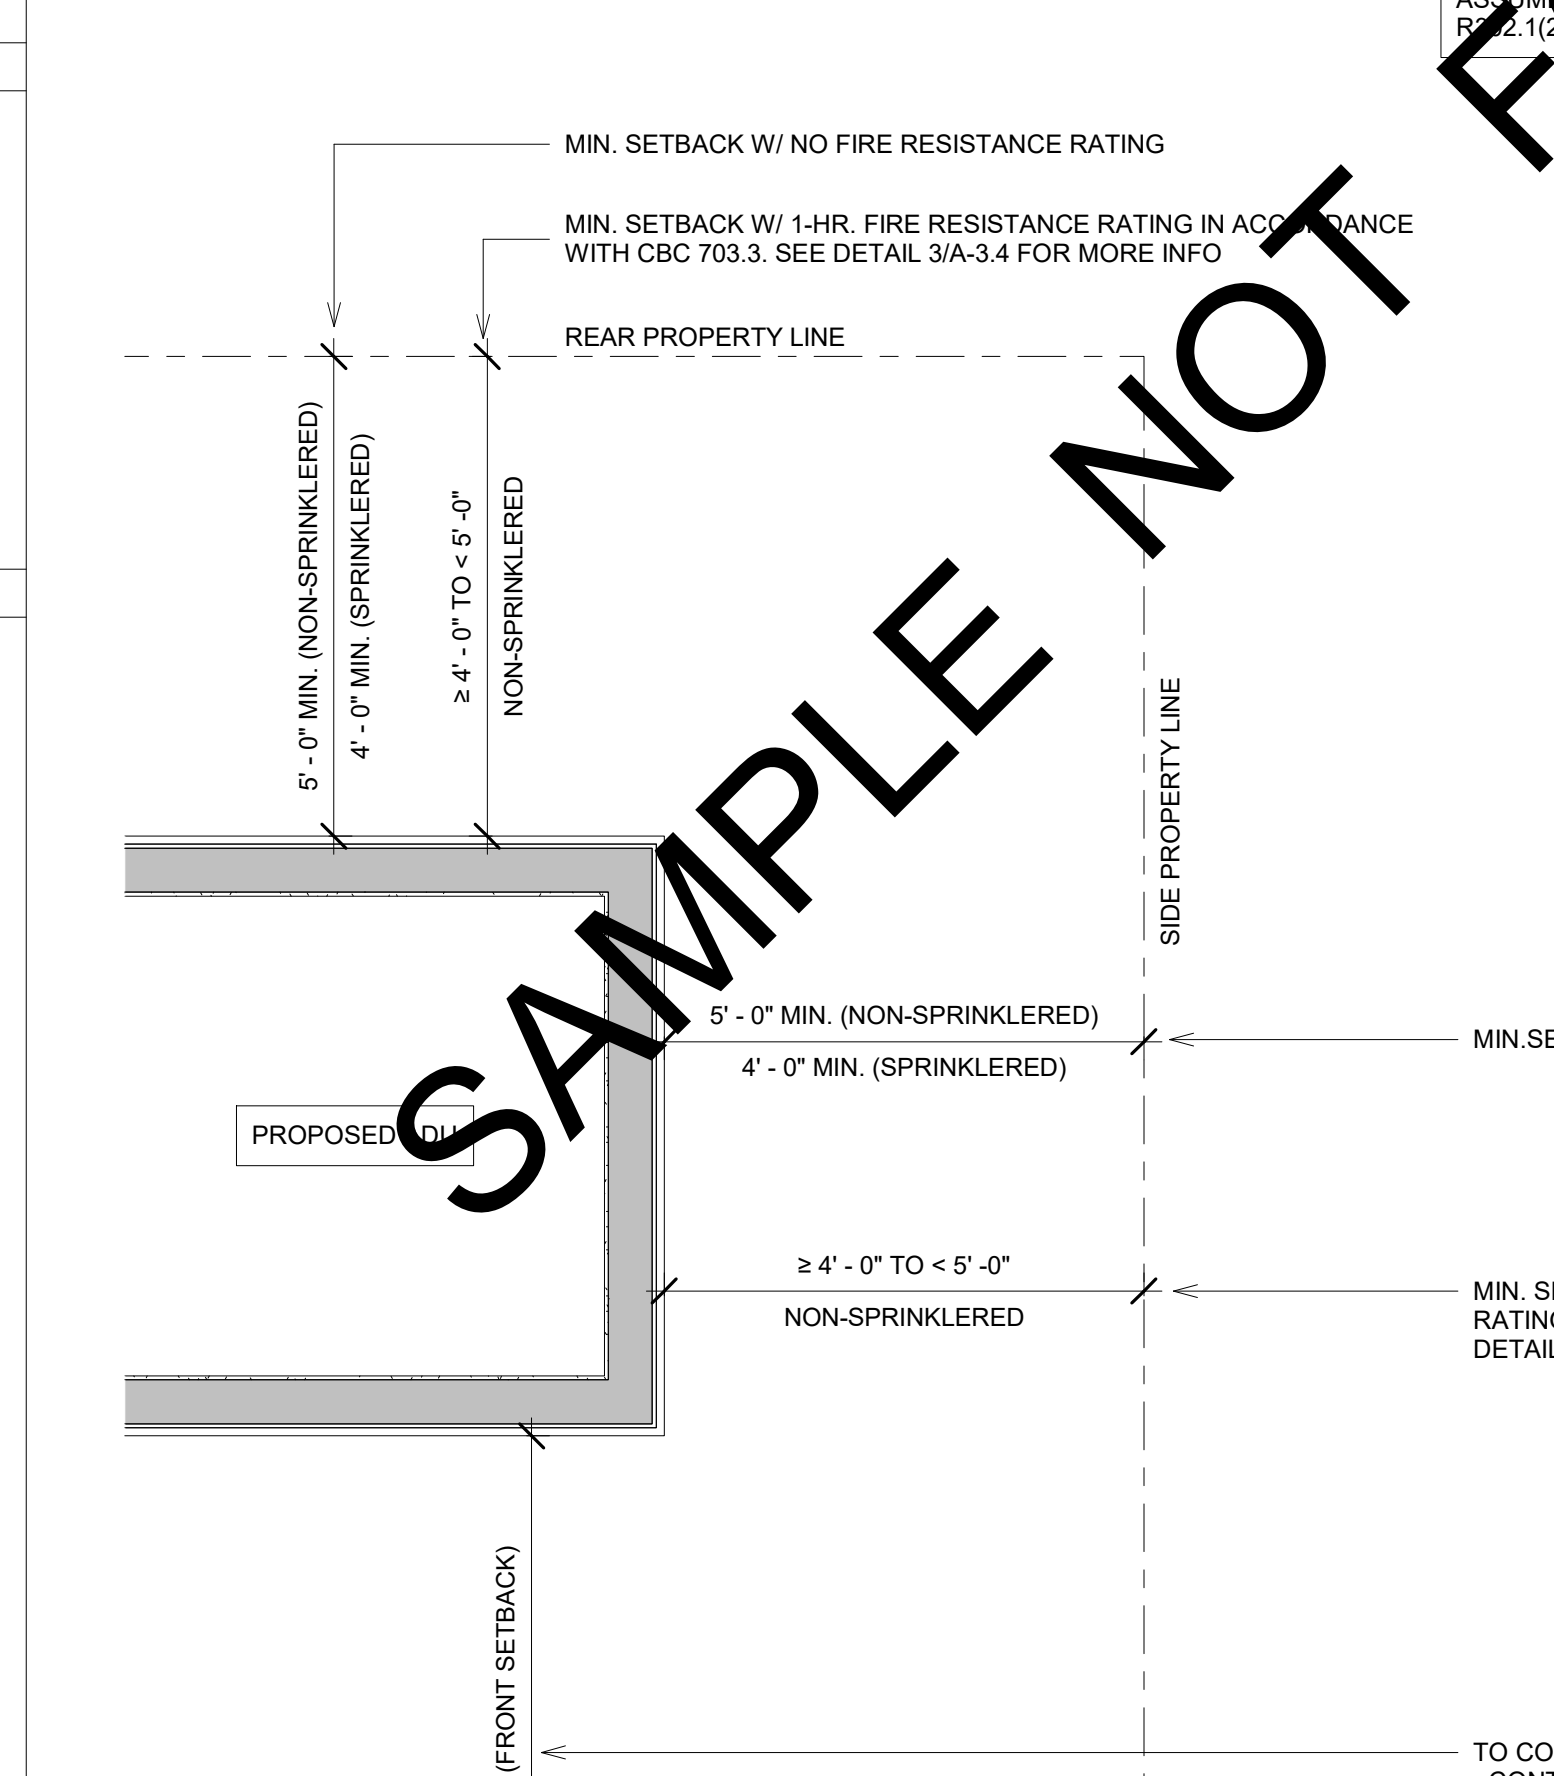

LAURA MILLER
DESIGN

889 Embarcadero Drive, Suite 102
El Dorado Hills, CA 95762
laura@lauramiller-design.com
lauramiller-design.com
916.607.3321

LICENSED ARCHITECT
LAURA A. MILLER
No. C-35317
REN. 4/30/25
STATE OF CALIFORNIA

Miller

SACRAMENTO COUNTY
PERMIT READY ADU (ACCESSORY DWELLING UNIT) PLANS
MODEL C

No.	Date	Description

Sheet Name:
TITLE SHEET

Scale:
N.T.S.

Date:
MAR 2024

Drawn By:
LM

Approved By:
LM

Sheet Number:
A-0.0

4/8/2024 12:50:00 PM



2022 CALIFORNIA GREEN BUILDING STANDARDS CODE RESIDENTIAL MANDATORY MEASURES, SHEET 1 (January 2023)

RES. PART 1 - YES
RES. PART 2 - NOT APPLICABLE
RES. PART 3 - RESPONSIBLE PARTY (i.e. ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

LAURA MILLER DESIGN
889 E. Lincoln Blvd., Suite 102
El Dorado Hills, CA 95762
laura@lauramiller-design.com
lauramiller-design.com
916.607.3521
LICENSED ARCHITECT
LAURA A. MILLER
No. C-35317
REN. 4/30/25
STATE OF CALIFORNIA

Table with 2 columns: YES/NO/RESP. PARTY and checkboxes for various sections.

CHAPTER 3 GREEN BUILDING SECTION 301 GENERAL

301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code.

301.1.1 Additions and alterations. [HCD] The mandatory provisions of Chapter 4 shall be applied to additions or alterations of existing residential buildings...

The mandatory provision of Section 4.106.4.2 may apply to additions or alterations of existing parking facilities or the addition of new parking facilities serving existing multifamily buildings.

Note: Repairs including, but not limited to, resurfacing, restriping and repairing or maintaining existing lighting fixtures are not considered alterations for the purpose of this section.

301.2 LOW-RISE AND HIGH-RISE RESIDENTIAL BUILDINGS. [HCD] The provisions of individual sections of CALGreen may apply to either low-rise residential buildings high-rise residential buildings, or both.

SECTION 302 MIXED OCCUPANCY BUILDINGS 302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy.

EXCEPTIONS: 1. [HCD] Accessory structures and accessory occupancies serving residential buildings shall comply with Chapter 4 and Appendix A4, as applicable.

DIVISION 4.1 PLANNING AND DESIGN ABBREVIATION DEFINITIONS:

HCD Department of Housing and Community Development
BSC California Building Standards Commission
DSA-SS Division of State Architect, Structural Safety
OSHDP Office of Statewide Health Planning and Development
LR Low Rise
HR High Rise
AA Additions and Alterations
AN New

CHAPTER 4 RESIDENTIAL MANDATORY MEASURES SECTION 4.102 DEFINITIONS

4.102.1 DEFINITIONS The following terms are defined in Chapter 2 (and are included here for reference) FRENCH DRAIN. A trench, hole or other depressed area loosely filled with rock, gravel, fragments of brick or similar porous material used to collect or channel drainage or runoff water.

WATTLES. Wattles are used to reduce sediment in runoff. Wattles are often constructed of natural plant materials such as hay, straw or similar material shaped in the form of tubes and placed on a downflow slope. Wattles are also used for perimeter and inlet controls.

4.106 SITE DEVELOPMENT 4.106.1 GENERAL. Preservation and use of available natural resources shall be accomplished through evaluation and assessment to minimize negative effects on the site and adjacent areas.

4.106.2 STORM WATER DRAINAGE AND RETENTION DURING CONSTRUCTION. Projects which disturb less than one acre of soil and are not part of a larger common plan of development which in total disturbs one acre or more, shall manage storm water drainage during construction.

4.106.3 GRADING AND PAVING. Construction plans shall indicate how the site grading or drainage system will manage all surface water flows to keep water from entering buildings.

4.106.4 Electric vehicle (EV) charging for new construction. New construction shall comply with Sections 4.106.4.1 or 4.106.4.2 to facilitate future installation and use of EV chargers.

4.106.4.2 New multifamily dwellings, hotels and motels and new residential parking facilities. When the parking spaces for new multifamily dwellings, hotels and motels shall meet the requirements of Sections 4.106.4.2.1 and 4.106.4.2.2.

4.106.4.2.1 Multifamily development projects with less than 20 dwelling units; and hotels and motels with less than 20 sleeping units or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

EXCEPTIONS: 1. When EV chargers (Level 2 EVSE) are installed in a number equal to or greater than the required number of EV capable spaces.

2. When EV chargers (Level 2 EVSE) are installed in a number less than the required number of EV capable spaces, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed.

Notes: a. Construction documents are intended to demonstrate the project's capability and capacity for facilitating future EV charging.

2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

4.106.4.2.2 Multifamily development projects with 20 or more dwelling units, hotels and motels with 20 or more sleeping units or guest rooms. The number of dwelling units, sleeping units or guest rooms shall be based on all buildings on a project site subject to this section.

1.EV Capable. Ten (10) percent of the total number of parking spaces on a building site, provided for all types of parking facilities, shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

EXCEPTION: When EV chargers (Level 2 EVSE) are installed in a number greater than five (5) percent of parking spaces required by Section 4.106.4.2.2, Item 3, the number of EV capable spaces required may be reduced by a number equal to the number of EV chargers installed over the five (5) percent required.

Notes: a. Construction documents shall show locations of future EV spaces. b. There is no requirement for EV spaces to be constructed or available until receptacles for EV charging or EV chargers are installed for use.

2.EV Ready. Twenty-five (25) percent of the total number of parking spaces shall be equipped with low power Level 2 EV charging receptacles. For multifamily parking facilities, no more than one receptacle is required per dwelling unit when more than one parking space is provided for use by a single dwelling unit.

3.EV Chargers. Five (5) percent of the total number of parking spaces shall be equipped with Level 2 EVSE. Where common use parking is provided, at least one EV charger shall be located in the common use parking area and shall be available for use by all residents or guests.

4.106.4.2.2.1 Electric vehicle charging stations (EVCS). Electric vehicle charging stations required by Section 4.106.4.2.2, Item 3, shall comply with Section 4.106.4.2.2.1.

4.106.4.2.2.1.1 Location. EVCS shall comply with at least one of the following options: 1. The charging space shall be located adjacent to an accessible parking space meeting the requirements of the California Building Code, Chapter 11A, to allow use of the EV charger from the accessible parking space.

4.106.4.2.2.2 Electric vehicle charging stations (EVCS) dimensions. The charging spaces shall be designed to comply with the following: 1. The minimum length of a charging space shall be 18 feet (5486 mm).

4.106.4.2.3 EV space requirements. 1. Single EV space required. Install a listed raceway capable of accommodating a 208/240-volt dedicated branch circuit. The raceway shall not be less than trade size 1 (nominal 1-inch inside diameter).

4.106.4.2.4 Identification. The service panel or subpanel circuit directory shall identify the overcurrent protective device space(s) reserved for future EV charging purposes as "EV CAPABLE" in accordance with the California Electrical Code.

4.106.4.2.5 Electric Vehicle Ready Space Signage. Electric vehicle ready spaces shall be identified by signage or pavement markings, in compliance with Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

4.106.4.3 Electric vehicle charging for additions and alterations of parking facilities serving existing multifamily buildings. When new parking facilities are added, or electrical systems or lighting of existing parking facilities are added or altered and the work requires a building permit, ten (10) percent of the total number of parking spaces added or altered shall be electric vehicle charging spaces (EV spaces) capable of supporting future Level 2 EVSE.

DIVISION 4.2 ENERGY EFFICIENCY 4.201 GENERAL 4.201.1 SCOPE. For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory standards.

DIVISION 4.3 WATER EFFICIENCY AND CONSERVATION 4.303 INDOOR WATER USE 4.303.1 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures (water closets, urinals) and fittings (faucets and showerheads) shall comply with the sections 4.303.1.1, 4.303.1.2, 4.303.1.3, and 4.303.4.4.

4.303.1.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified by the performance criteria of the U.S. EPA WaterSense Specification for Tank-type Toilets.

4.303.1.2 Urinals. The effective flush volume of wall-mounted urinals shall not exceed 0.125 gallons per flush. The effective flush volume of all floor urinals shall not exceed 0.5 gallons per flush.

4.303.1.3 Showerheads. 4.303.1.3.1 Single Showerheads. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

4.303.1.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons per minute at 80 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 80 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 80 psi.

4.303.1.4.1 Residential Lavatory Faucets. The maximum flow rate of residential lavatory faucets shall not exceed 1.2 gallons per minute at 60 psi. The minimum flow rate of residential lavatory faucets shall not be less than 0.8 gallons per minute at 20 psi.

4.303.1.4.2 Lavatory Faucets in Common and Public Use Areas. The maximum flow rate of lavatory faucets installed in common and public use areas (outside of dwellings or sleeping units) in residential buildings shall not exceed 0.5 gallons per minute at 60 psi.

4.303.1.4.3 Metering Faucets. Metering faucets when installed in residential buildings shall not deliver more than 0.2 gallons per cycle. 4.303.1.4.4 Kitchen Faucets. The maximum flow rate of kitchen faucets shall not exceed 1.8 gallons per minute at 80 psi.

4.303.1.4.5 Pre-rinse spray valves. When installed, shall meet the requirements in the California Code of Regulations, Title 20 (Appliance Efficiency Regulations), Sections 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7) and shall be equipped with an integral automatic shutoff.

4.303.2 Submeters for multifamily buildings and dwelling units in mixed-used residential/commercial buildings. Submeters shall be installed to measure water usage of individual residential dwelling units in accordance with the California Plumbing Code.

4.303.3 Standards for plumbing fixtures and fittings. Plumbing fixtures and fittings shall be installed in accordance with the California Plumbing Code, and shall meet the applicable standards referenced in Table 7.01.1 of the California Plumbing Code.

TABLE H-2 STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALVES MANUFACTURED ON OR AFTER JANUARY 28, 2019

TABLE - MAXIMUM FIXTURE WATER USE

4.304 OUTDOOR WATER USE 4.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS. Residential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent.

DIVISION 4.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY 4.406 ENHANCED DURABILITY AND REDUCED MAINTENANCE 4.406.1 RODENT PROOFING. Annual spaces around pipes, electric cables, conduits or other openings in soffit/bottom plates at exterior walls shall be protected against the passage of rodents by closing such openings with cement mortar, concrete masonry or a similar method acceptable to the enforcing agency.

4.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING 4.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65 percent of the non-hazardous construction and demolition waste in accordance with either Section 4.408.2, 4.408.3 or 4.408.4, or meet a more stringent local construction and demolition waste management ordinance.

4.408.2 CONSTRUCTION WASTE MANAGEMENT PLAN. Submit a construction waste management plan in conformance with Items 1 through 5. The construction waste management plan shall be updated as necessary and shall be available during construction for examination by the enforcing agency.

4.408.3 WASTE MANAGEMENT COMPANY. Utilize a waste management company, approved by the enforcing agency, which can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with Section 4.408.1.

4.408.4 WASTE STREAM REDUCTION ALTERNATIVE [LR]. Projects that generate a total combined weight of construction and demolition waste disposed of in landfills, which do not exceed 3.4 lbs/sq. ft. of the building area shall meet the minimum 65% construction waste reduction requirement in Section 4.408.1.

4.408.5 DOCUMENTATION. Documentation shall be provided to the enforcing agency which demonstrates compliance with Section 4.408.2, Items 1 through 5, Section 4.408.3 or Section 4.408.4.

4.410 BUILDING MAINTENANCE AND OPERATION 4.410.1 OPERATION AND MAINTENANCE MANUAL. At the time of final inspection, a manual, compact disc, web-based reference or other media acceptable to the enforcing agency which includes all of the following shall be placed in the building:

- 1. Directions to the owner or occupant that the manual shall remain with the building throughout the life cycle of the structure.
2. Operation and maintenance instructions for the following:
a. Equipment and appliances, including water-saving devices and systems, HVAC systems, photovoltaic systems, electric vehicle chargers, water-heating systems and other major appliances and equipment.
b. Roof and yard drainage, including gutters and downspouts.
c. Space conditioning systems, including condensers and air filters.
d. Landscape irrigation systems.
e. Water reuse systems.
3. Information from local utility, water and waste recovery providers on methods to further reduce resource consumption, including recycle programs and locations.
4. Public transportation and/or carpool options available in the area.
5. Educational material on the positive impacts of an interior relative humidity between 30-60 percent and what methods an occupant may use to maintain the relative humidity level in that range.
6. Information about water-conserving landscape and irrigation design and controllers which conserve water.
7. Instructions for maintaining gutters and downspouts and the importance of diverting water at least 5 feet away from the foundation.
8. Information on required routine maintenance measures, including, but not limited to, caulking, painting, grading around the building, etc.
9. Information about state solar energy and incentive programs available.
10. A copy of all special inspections verifications required by the enforcing agency or this code.
11. Information from the Department of Forestry and Fire Protection on maintenance of defensible space around residential structures.
12. Information and/or drawings identifying the location of grab bar reinforcements.

4.410.2 RECYCLING BY OCCUPANTS. Where 6 or more multifamily dwelling units are constructed on a building site, provide readily accessible area(s) that serves all buildings on the site and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals, or meet a locally enacted local recycling ordinance, if more restrictive.

DIVISION 4.5 ENVIRONMENTAL QUALITY SECTION 4.501 GENERAL 4.501.1 Scope. The provisions of this chapter shall outline means of reducing the quality of air contaminants that are odorous, irritating and/or harmful to the comfort and well being of a building's installers, occupants and neighbors.

SECTION 4.502 DEFINITIONS 5.102.1 DEFINITIONS The following terms are defined in Chapter 2 (and are included here for reference) AGRIFIBER PRODUCTS. Agrifiber products include wheatboard, strawboard, panel substrates and door cores, not including furniture, fixtures and equipment (FFFE) not considered base building elements.

COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, prefabricated wood joists or finger-jointed lumber, all as specified in California Code of regulations (CCR), title 17, Section 9320.1.

DIRT-CENT APPLIANCE. A fuel-burning appliance with a sealed combustion system that draws all air for combustion from the outside atmosphere and discharges all flue gases to the outside atmosphere.

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

SACRAMENTO COUNTY PERMIT READY ADU (ACCESSORY DWELLING UNIT) PLANS MODEL C

Checklist table with columns: No., Date, Description. Includes fields for Name, Date, Drawn By, Approved By, Sheet Number.



MAXIMUM INCREMENTAL REACTIVITY (MIR), MOISTURE CONTENT, PRODUCT-WEIGHTED MIR (PWMIR), REACTIVE ORGANIC COMPOUND (ROC), 4.503 FIREPLACES, 4.504 POLLUTANT CONTROL, 4.504.2.1 Adhesives, Sealants and Caulks, 4.504.2.2 Paints and Coatings, 4.504.2.3 Aerosol Paints and Coatings, 4.504.2.4 Verification, TABLE 4.504.1 - ADHESIVE VOC LIMIT, 1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER...

TABLE 4.504.2 - SEALANT VOC LIMIT, TABLE 4.504.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS, TABLE 4.504.4 - ADHESIVE VOC LIMIT, TABLE 4.504.5 - FORMALDEHYDE LIMITS, 4.505 INTERIOR MOISTURE CONTROL, 4.505.1 General, 4.505.2 CONCRETE SLAB FOUNDATIONS, 4.505.2.1 Capillary break, 4.505.3 MOISTURE CONTENT OF BUILDING MATERIALS, 4.506 INDOOR AIR QUALITY AND EXHAUST, 4.506.1 Bathroom exhaust fans, 4.507 ENVIRONMENTAL COMFORT, 4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN.

CHAPTER 7 INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS, 702 QUALIFICATIONS, 702.1 INSTALLER TRAINING, 702.2 SPECIAL INSPECTION [HCD], 703 VERIFICATIONS, 703.1 DOCUMENTATION, 4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN.

CHAPTER 7 INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS, 702 QUALIFICATIONS, 702.1 INSTALLER TRAINING, 702.2 SPECIAL INSPECTION [HCD], 703 VERIFICATIONS, 703.1 DOCUMENTATION, 4.507.2 HEATING AND AIR-CONDITIONING SYSTEM DESIGN.

SAMPLE NOT FOR CONSTRUCTION

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

Table with 3 columns: No., Date, Description. Includes fields for Sheet Name (CALGREEN CHECKLIST CONT.), Date (MAR 2024), and other project details.

Door Schedule							
Mark	Width	Height	Location	Description	Application	Finish	Hardware
1	3' - 0"	6' - 8"	LIVING ROOM	HALF LITE	EXTERIOR	PRIMED	ENTRY LOCKSET
2	2' - 0"	6' - 8"	UTILITY CLOSET	FLAT PANEL	INTERIOR	PRIMED	PASSAGE
3	3' - 0"	6' - 8"	BATH 2	FLAT PANEL	INTERIOR	PRIMED	PRIVACY
4	3' - 0"	6' - 8"	BEDROOM 2	FLAT PANEL	INTERIOR	PRIMED	PRIVACY
5	4' - 0"	6' - 8"	BEDROOM 2 CLOSET	DOUBLE SLIDING	INTERIOR	PRIMED	
6	2' - 4"	6' - 8"	LAUNDRY CLOSET	LOUVERED BI-FOLD DOOR	INTERIOR	PRIMED	
7	3' - 0"	6' - 8"	PRIMARY BEDROOM	FLAT PANEL	INTERIOR	PRIMED	PRIVACY
8	3' - 0"	6' - 8"	PRIMARY BATHROOM	FLAT PANEL	INTERIOR	PRIMED	PRIVACY
9	6' - 0"	6' - 8"	PRIMARY BEDROOM CLOSET	DOUBLE SLIDING	INTERIOR	PRIMED	
10	3' - 0"	6' - 8"	KITCHEN	FULL LITE	EXTERIOR	PRIMED	ENTRY LOCKSET

- WASHER/DRYER CLOSET DOOR NOTE: A MINIMUM OF ONE SQUARE INCH OF OPENING SHALL BE PROVIDED PER 1,000 BTU'S OF EQUIPMENT INPUT. A MINIMUM OF ONE 100 S.I. OPENING WITHIN 12 INCHES OF THE FLOOR AND WITHIN 12 INCHES FROM THE TOP OF THE DOOR SHALL BE PROVIDED. (CMC 701.5)

Window Schedule					
Type Mark	Width	Height	Clear Height	Operation	Count
A	5' - 0"	4' - 0"	3' - 0"	DOUBLE SINGLE HUNG	2
B	3' - 0"	4' - 0"	3' - 0"	SINGLE HUNG	4
C	3' - 6"	4' - 0"	5' - 0"	SLIDER	2
D	5' - 0"	4' - 0"	3' - 0"	SLIDER	2
E	2' - 6"	3' - 6"	3' - 6"	SINGLE HUNG	1
Grand total: 11					

WINDOW INFORMATION:

FRAME: VINYL
U VALUE: .3
SHGC: .23
ENERGY STAR CERTIFIED: YES
LOW E GLASS: YES

LIGHT & VENTILATION CALCULATIONS

- ALL HABITABLE ROOMS ARE REQUIRED TO HAVE NATURAL LIGHT SIZED TO A MIN. OF 8% OF THE FLOOR AREA AND VENTILATION SIZED TO A MIN OF 4% OF THE FLOOR AREA.

BEDROOM 1:
128 S.F. X .08 = 14.24 S.F. NATURAL LIGHT AREA REQ'D ; 44 S.F. PROVIDED
128 S.F. X .04 = 5.12 S.F. VENTILATION AREA REQ'D ; 22 S.F. PROVIDED

BEDROOM 2:
128 S.F. X .08 = 10.24 S.F. NATURAL LIGHT AREA REQ'D ; 20 S.F. PROVIDED
128 S.F. X .04 = 5.12 S.F. VENTILATION AREA REQ'D ; 10 S.F. PROVIDED VIA OPERATIONAL WINDOW

EXTERIOR DOOR NOTES:

- ENTRY/EXIT DOOR MUST OPEN OVER A LANDING NOT MORE THAN 1.5' BELOW THE THRESHOLD (CRC311.3.1)
- THERE SHALL BE A LANDING OR FLOOR ON EACH SIDE OF EACH EXTERIOR DOOR. THE WIDTH OF EACH LANDING SHALL NOT BE LESS THAN THE DOOR SERVED.
- EVERY LANDING SHALL HAVE A MIN. DIMENSION OF 36 INCHES MEASURED IN THE DIRECTION OF TRAVEL (CRC311.3)

WINDOW NOTES:

- ALL WINDOWS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS, INCLUDING FLASHING
- WINDOWS IN BEDROOMS SHALL MEET ALL OF THE FOLLOWING EMERGENCY ESCAPE AND RESCUE REQUIREMENTS (CRC310.1):
MIN 5.7 S.F. OF OPENABLE AREA (5.0 S.F. FOR GRADE LEVEL BEDROOMS)
MIN 20" CLEAR WIDTH AND 24" CLEAR HEIGHT WHEN OPEN
MAX SILL HEIGHT OF 44" FROM FINISHED FLOOR TO BOTTOM OF THE CLEAR OPENING

BATH & KITCHEN NOTES:

- PROVIDE AN APPROVED DISHWASHER AIR GAP FITTING AS PER CPC 807.4
- MAX FLOW RATE OF KITCHEN FAUCETS SHALL NOT EXCEED 1.8 GALLONS PER MIN AT 60 PSI (CAL GREEN 4.303.1.4.4)
- WHERE A FIXTURE COMES IN CONTACT WITH THE WALL OR FLOOR, THE JOINT BETWEEN THE FIXTURE AND THE WALL OR FLOOR SHALL BE MADE WATER TIGHT AS PER CPC 402.2
- THE INSTALLATION OF A LISTED COOKING APPLIANCE OR MICROWAVE OVEN OVER A LISTED COOKING APPLIANCE SHALL CONFORM TO THE CONDITIONS OF THE UPPER APPLIANCE'S LISTING AND THE MANUF. INSTALLATION INSTRUCTIONS.
- FIXTURES SHALL BE SPACED IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE.
- NO WATER CLOSET OR BIDET SHALL BE SET CLOSER THAN 15 INCHES FROM ITS CENTER TO A SIDE WALL OR OBSTRUCTION NOR CLOSER THAN 30 INCHES CENTER TO CENTER TO A SIMILAR FIXTURE. THE CLEAR SPACE IN FRONT OF A WATER CLOSET, LAVATORY, OR BIDET SHALL BE NOT LESS THAN 24 INCHES.
- BATHTUB AND SHOWER FLOORS AND WALLS ABOVE BATHTUBS WITH INSTALLED SHOWER HEADS AND IN SHOWER COMPARTMENTS SHALL BE FURNISHED WITH A NONABSORBENT SURFACE. SUCH SURFACES SHALL EXTEND TO A HEIGHT OF NOT LESS THAN 6 FT ABOVE THE FLOOR (CRC 307.2).

WATER HEATER NOTES:

- MANUFACTURE'S INSTALLATION INSTRUCTIONS FOR THE WATER HEATER AND ALL OTHER LISTED APPLIANCES SHALL BE AVAILABLE TO THE FIELD INSPECTOR AT THE TIME OF INSPECTIONS PER 2022 CRC SEC. R106.

- PER CF1R: WATER HEATER HEAT PUMP MODEL, RHEEM PROPH 40T2R H37515

AGING IN PLACE DESIGN AND FALL PROTECTION (2022 CRC R327).

1. INTERIOR DOORS

- AT LEAST ONE BATHROOM AND ONE BEDROOM ON THE ENTRY LEVEL SHALL PROVIDE A DOORWAY WITH A NET CLEAR OPENING OF NOT LESS THAN 32 INCHES, MEASURED WITH THE DOOR POSITIONED AT AN ANGLE OF 90 DEGREES FROM THE CLOSED POSITION, OR, IN THE CASE OF A TWO- OR THREE-STORY SINGLE FAMILY DWELLING, ON THE SECOND OR THIRD FLOOR OF THE DWELLING IF A BATHROOM OR BEDROOM IS NOT LOCATED ON THE ENTRY LEVEL, PER 2022 CRC R327.1.3

2. DOORBELL BUTTONS

- DOORBELL BUTTONS OR CONTROLS, WHEN INSTALLED, SHALL NOT EXCEED 48 INCHES ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON ASSEMBLY. WHERE DOORBELL BUTTONS INTEGRATED WITH OTHER FEATURES ARE REQUIRED TO BE INSTALLED ABOVE 48 INCHES MEASURED FROM THE EXTERIOR FLOOR OR LANDING, A STANDARD DOORBELL BUTTON OR CONTROL SHALL ALSO BE PROVIDED AT A HEIGHT NO EXCEEDING 48 INCHES ABOVE EXTERIOR FLOOR OR LANDING, MEASURED FROM THE TOP OF THE DOORBELL BUTTON OR CONTROL, PER 2022 CRC R327.1.4

3. ELECTRICAL RECEPTACLE OUTLET, SWITCH, AND CONTROL HEIGHTS

- ALL ELECTRICAL RECEPTACLE OUTLET, SWITCH AND CONTROL HEIGHTS TO BE LOCATED NO MORE THAN 48 INCHES MEASURED FROM THE TOP OF THE OUTLET BOX AND NOT LESS THAN 15 INCHES ABOVE THE FINISH FLOOR, PER 2022 CRC R327.1.2

4. REINFORCEMENT FOR GRAB BARS

- AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH THIS SECTION. WHERE THERE IS NO BATHROOM ON THE ENTRY LEVEL, AT LEAST ONE BATHROOM ON THE SECOND OR THIRD FLOOR OF THE DWELLING SHALL COMPLY WITH THIS SECTION.


- A. REINFORCEMENT SHALL BE SOLID LUMBER OR OTHER CONSTRUCTION MATERIALS APPROVED BY THE ENFORCING AGENCY.
- B. REINFORCEMENT SHALL NOT BE LESS THAN 2 BY 8 INCH NOMINAL LUMBER OR OTHER CONSTRUCTION MATERIAL PROVIDING EQUAL HEIGHT AND LOAD CAPACITY. REINFORCEMENT SHALL BE LOCATED BETWEEN 32 INCHES AND 39 1/4 INCHES ABOVE THE FINISHED FLOOR FLUSH WITH THE WALL FRAMING.
- C. WATER CLOSET REINFORCEMENT SHALL BE INSTALLED ON BOTH SIDE WALLS OF THE FIXTURE OR ONE SIDE WALL AND THE BACK WALL.
- D. SHOWER REINFORCEMENT SHALL BE CONTINUOUS WHERE WALL FRAMING IS PROVIDED.
- E. BATHTUB AND COMBINATION BATHTUB/SHOWER REINFORCEMENT SHALL BE CONTINUOUS ON EACH END OF THE BATHTUB AND THE BACK WALL. ADDITIONALLY, BACK WALL REINFORCEMENT FOR A LOWER GRAB BAR SHALL BE PROVIDED WITH THE BOTTOM EDGE LOCATED NO MORE THAN 6 INCHES ABOVE THE BATHTUB RIM

2X6 EXTERIOR WALL: 3 COAT STUCCO OR FIBER CEMENT SIDING EXTERIOR FINISH. GYP. BOARD INTERIOR FINISH.

2X4 INTERIOR WALL: GYP. BOARD BOTH SIDES.

WALL LEGEND
1/4" = 1'-0"

NOTE: ALL DIMENSIONS TO FACE OF STUD U.N.O.

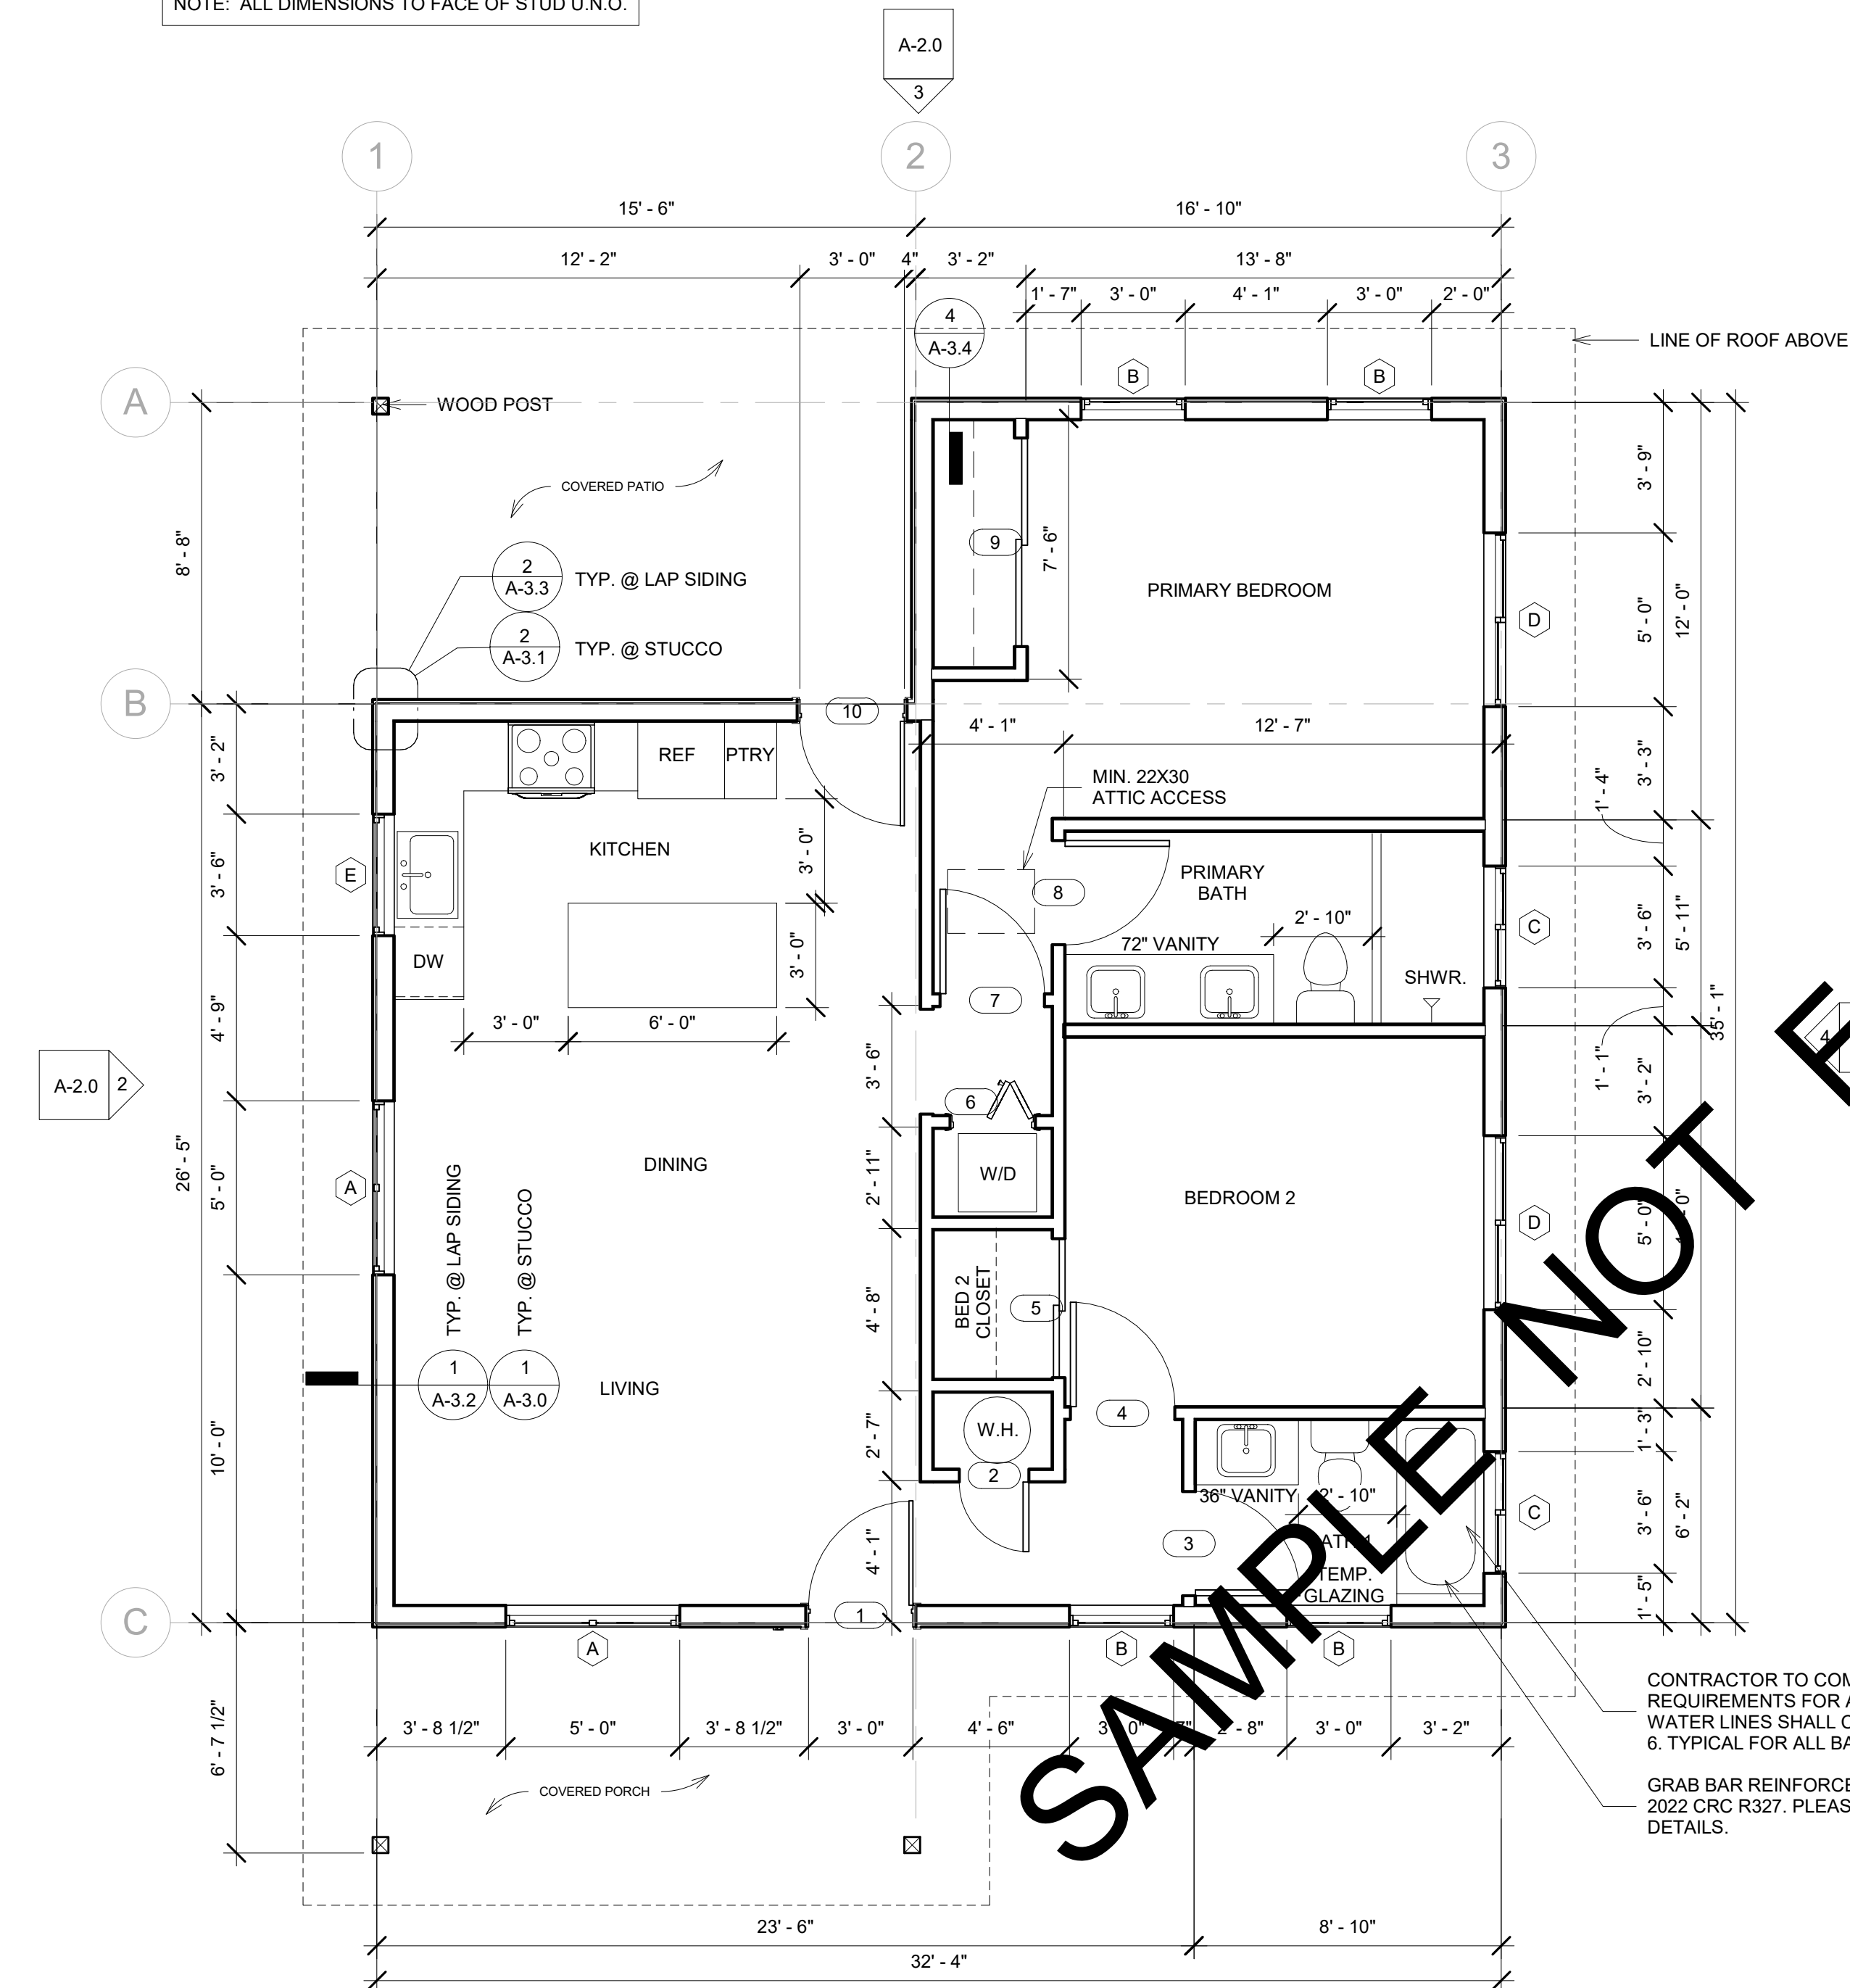

CONTRACTOR TO COMPLY WITH 1/4":12" SLOPE REQUIREMENTS FOR ALL WASTE LINES. (N) WATER LINES SHALL COMPLY WITH CPC CHAPTER 6. TYPICAL FOR ALL BATHROOMS & KITCHEN

GRAB BAR REINFORCEMENTS TO COMPLY WITH 2022 CRC R327. PLEASE SEE NOTES FOR MORE DETAILS.

1 FLOOR PLAN
1/4" = 1'-0"

No.	Date	Description

Sheet Name:
ROOF PLAN

Scale:
1/4" = 1'-0"

Date:
MAR 2024

Drawn By:
IS

Approved By:
LM

Sheet Number:

ROOF PLAN NOTES:

- THE MIN. NET FREE VENTILATION AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.

ENCLOSED RAFTER AREA:

1104 S.F./150 = 7.36 S.F. = 1,059.84 S.I. NET FREE VENTILATION AREA REQUIRED

ROOF VENTILATION PROVIDED:

RIDGE VENT

41'-6" (41.5') LINEAR FEET OF RIDGE VENT
VENT AREA OF RIDGE VENT: 12.5 S.I. PER LINEAR FOOT
41.5' X 12.5 = 518.75 S.I. VENTILATION FROM A 41'-6" LONG RIDGE VENT

ROOF VENTS

541.09 S.I./72 S.I. PER VENT = 7.5 = 8 ROOF VENTS NEEDED
576 S.I. VENTILATION FROM 8 ROOF VENTS

TOTAL VENTILATION PROVIDED = 1,094.75 S.I. OF NET FREE VENTILATION

ROOFING NOTES:

- ROOFING MATERIAL TO BE ASPHALT SHINGLE. THE INSTALLATION OF ASPHALT SHINGLE ROOFING SHALL COMPLY WITH THE PROVISIONS OF R905.2

- ASPHALT SHINGLE UNDERLAYMENT TYPE SHALL BE ONE OF THE FOLLOWING:


- ASTM D226 TYPE I
- ASTM D4889 TYPE I
- ASTM D6757

- UPPER ROOF VENTILATION TO BE PROVIDED BY OWENS CORNING VENTSURE RIDGE VENT RIGID ROLL WITH WEATHER PROTECTOR MOISTURE BARRIER OR APPROVED EQUAL.

- LOWER ROOF VENTILATION TO BE PROVIDED BY MAGIN LOW PROFILE ROOF VENTS OR APPROVED EQUAL.

- ATTIC ACCESS OPENINGS TO ATTIC AREAS SHALL HAVE A VERTICAL UNOBSTRUCTED HEAD HEIGHT OF 30 INCHES OR GREATER OVER AN AREA OF NOT LESS THAN 30 SQUARE FEET. VERTICAL HEIGHT SHALL BE MEASURED FROM THE TOP OF THE CEILING FRAMING MEMBERS TO THE UNDERSIDE OF THE ROOF FRAMING MEMBERS. THE ROUGH-FRAMED OPENING SHALL BE NOT LESS THAN 22 INCHES BY 30 INCHES AND SHALL BE LOCATED IN A HALLWAY OR OTHER LOCATION WITH READY ACCESS. WHERE LOCATED IN A WALL, THE OPENING SHALL BE NOT LESS THAN 12 INCHES WIDE BY 30 INCHES HIGH.


- NOTE: PROVIDE VENT MANUFACTURERS LISTED INSTALLATION INSTRUCTIONS AND SPECIFICATIONS INDICATING "FREE VENT AREA" TO THE INSPECTOR AT TIME OF INSPECTION.

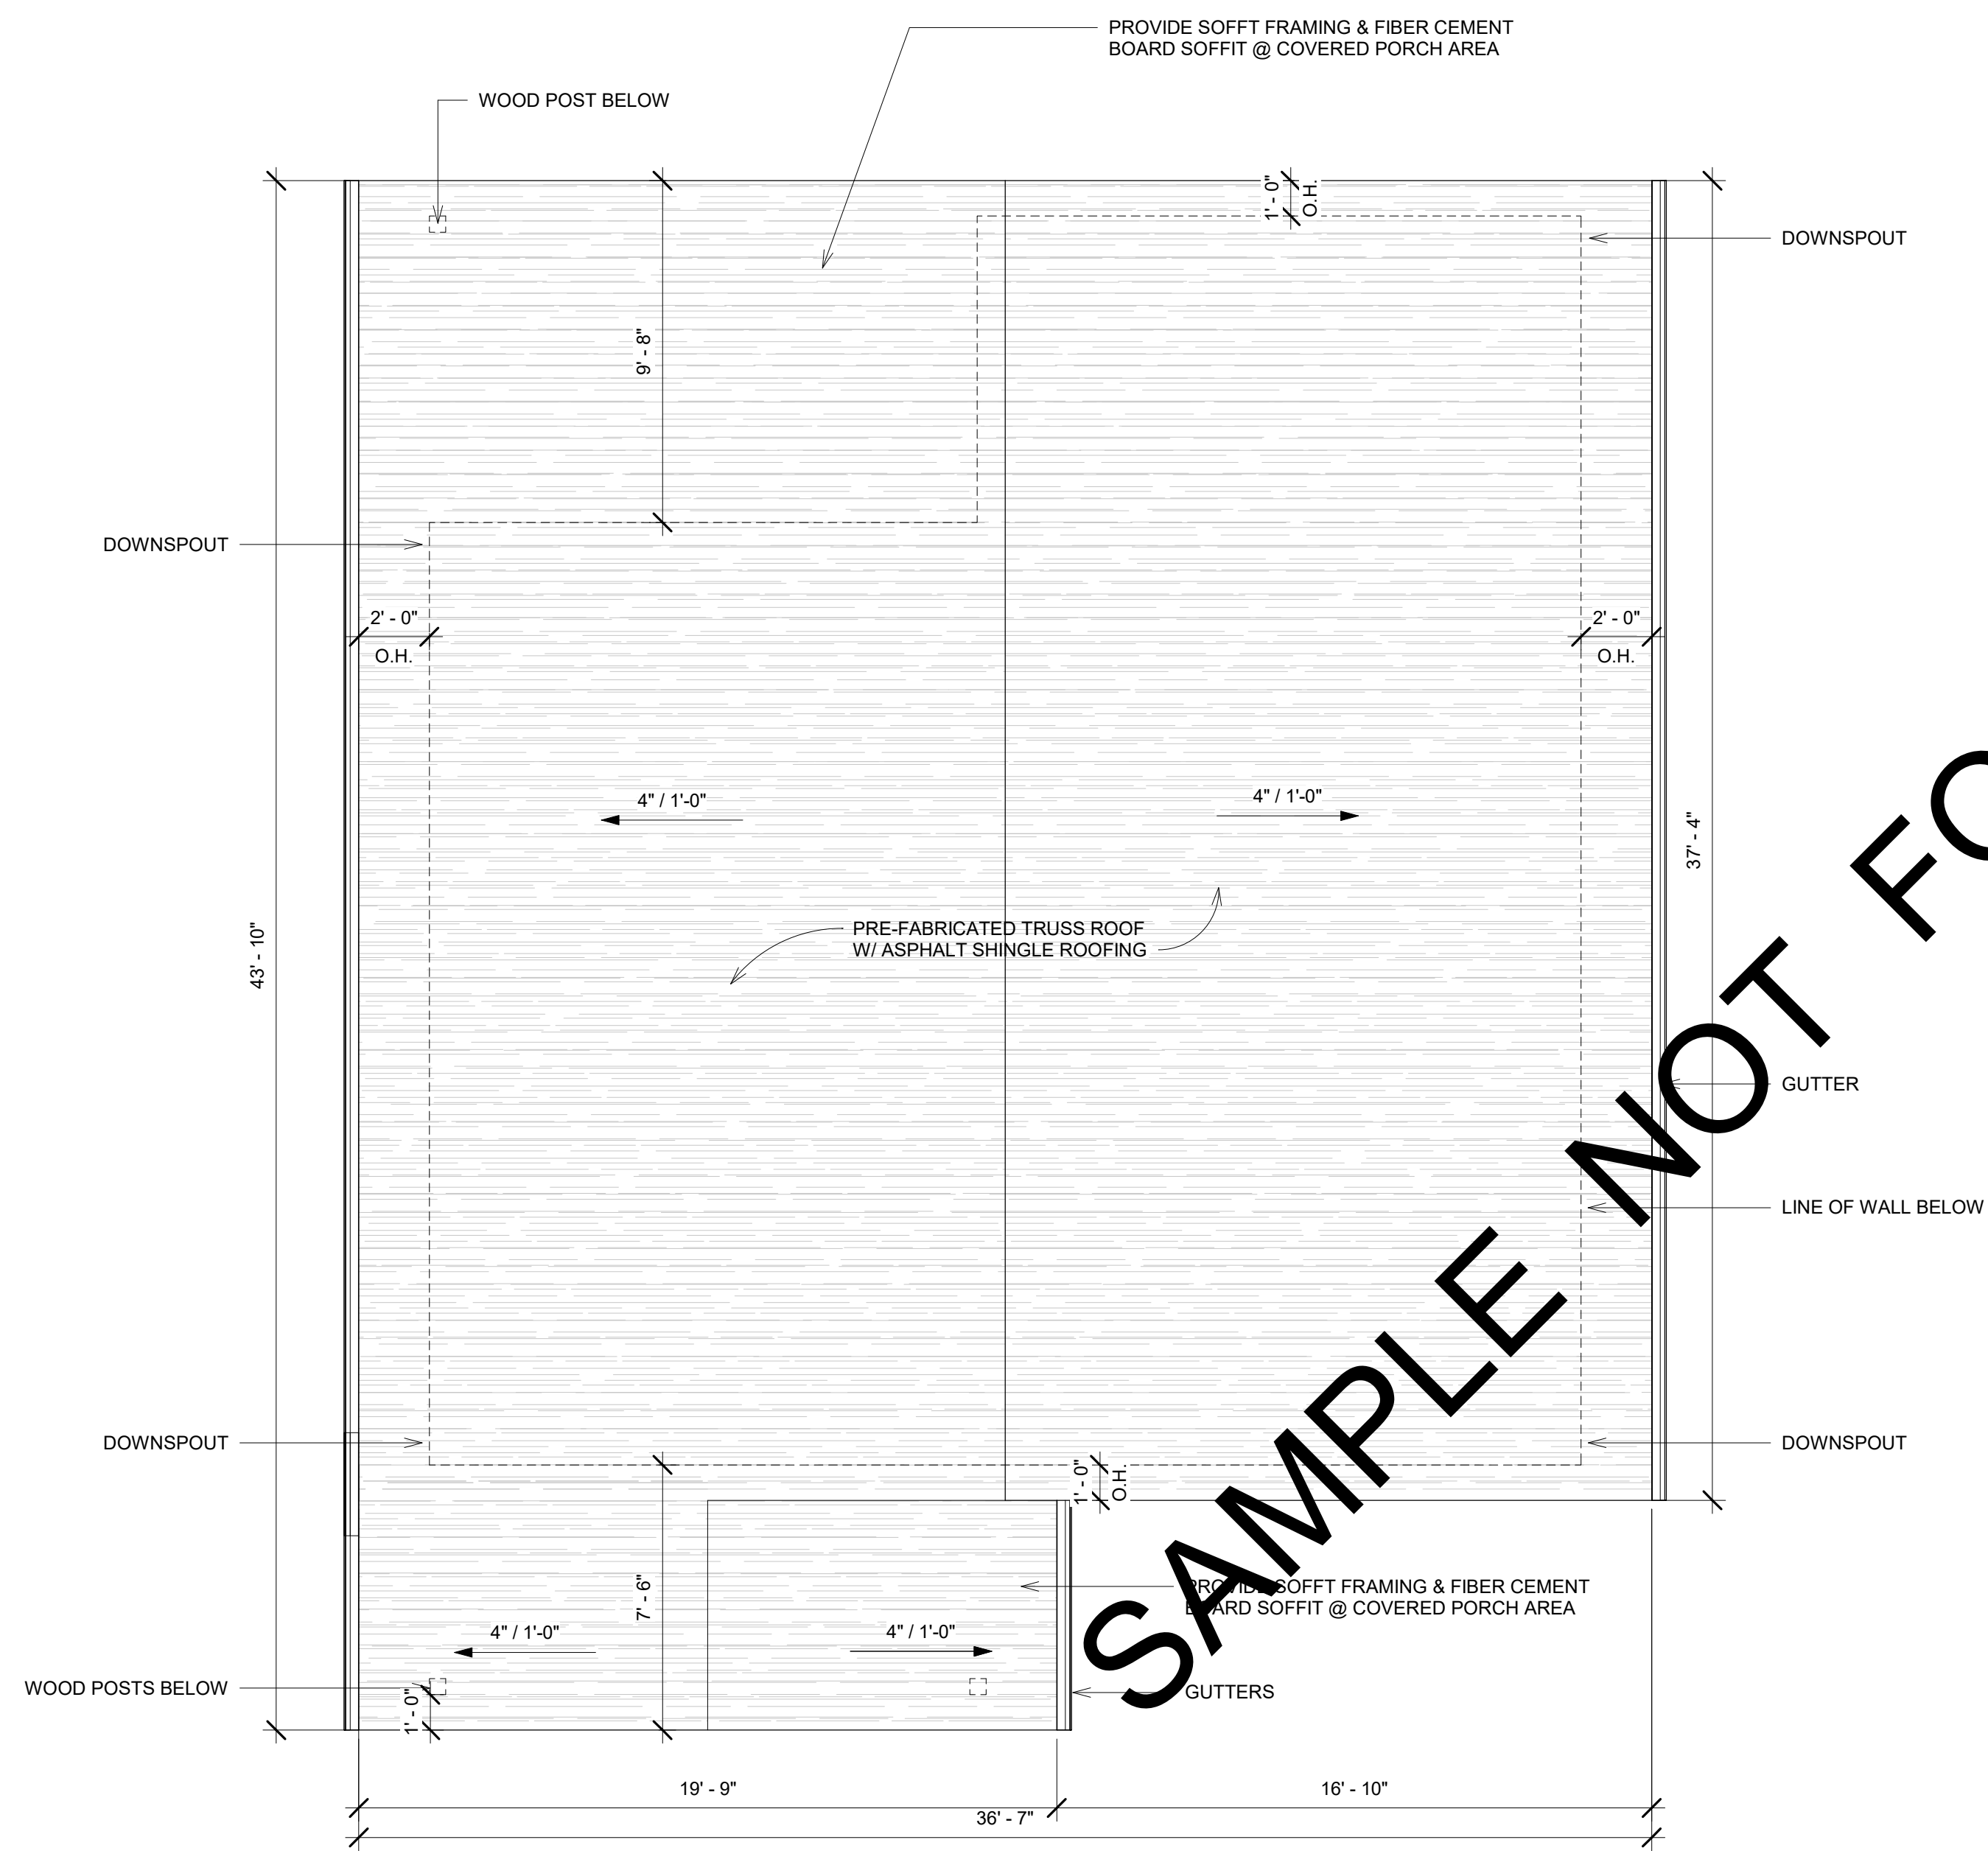


1 ROOF PLAN
1/4" = 1'-0"

SAMPLE NOT FOR CONSTRUCTION


- ELECTRICAL NOTES:**
1. PROVIDE 2 OR MORE 20-AMP SMALL APPLIANCE BRANCH CIRCUITS TO SERVE ALL COUNTERTOP, WALL AND FLOOR RECEPTACLES IN THE KITCHEN, PANTRY, BREAKFAST ROOM, DINING ROOM, OR SIMILAR AREAS. RECEPTACLE OUTLETS SHALL BE INSTALLED AT EACH WALL, ISLAND, AND PENINSULA COUNTER SPACE IN KITCHENS AND DINING ROOMS. SUCH CIRCUITS SHALL HAVE NO OTHER OUTLETS.
 2. PROVIDE GFCI PROTECTION TO ALL 125 VOLT, 15 AND 20 AMP RECEPTACLES SERVING COUNTERTOP SURFACES IN KITCHENS, WITHIN 6 FEET OF LAUNDRY, UTILITY AND WET BAR SINKS, IN BATHROOMS, GARAGES AND ACCESSORY BUILDINGS, CRAWL SPACES, UNFINISHED BASEMENTS AND BOATHOUSES.
 3. RECEPTACLE OUTLETS SHALL BE INSTALLED SO THAT NO POINT ALONG THE FLOOR LINE IN ANY WALL SPACE IS MORE THAN 6 FEET MEASURED HORIZONTALLY, FROM AN OUTLET IN THAT SPACE. RECEPTACLE OUTLETS ARE REQUIRED IN WALLS 2 FEET OR GREATER. HALLWAYS OF 10 FEET OR MORE IN LENGTH SHALL HAVE AT LEAST ONE RECEPTACLE OUTLET.
 4. NEW 120-VOLT, SINGLE PHASE, 15- AND 20 AMPERE BRANCH CIRCUITS SUPPLYING OUTLETS OR DEVICES INSTALLED IN DWELLING UNIT KITCHEN, FAMILY ROOMS, DINING ROOMS, LIVING ROOMS, PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, LAUNDRY AREAS, OR SIMILAR ROOMS OR AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER (AFCI), COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT. REFERENCE CEC ART. 210.12(A).
 5. DWELLINGS WITH DIRECT GRADE LEVEL ACCESS SHALL HAVE AT LEAST ONE RECEPTACLE OUTLET WITHIN 6.5 FEET OF GRADE LEVEL AT THE FRONT AND BACK OF THE DWELLING. ALL 125 VOLT, 15 AND 20 AMP, RECEPTACLES INSTALLED OUTDOORS SHALL BE GFCI PROTECTED. RECEPTACLES INSTALLED OUTDOORS IN AN EXTERIOR WET LOCATION SHALL HAVE AN ENCLOSURE THAT IS WEATHERPROOF WHETHER OR NOT THE ATTACHMENT PLUG CAP IS INSERTED.
 6. AT LEAST ONE WALL SWITCH-CONTROLLED LIGHTING OUTLET SHALL BE INSTALLED IN EVERY HABITABLE ROOM, IN BATHROOM, HALLWAYS, STAIRWAYS, ATTACHED GARAGES, DETACHED GARAGES WITH ELECTRIC POWER, AND AT OUTDOOR ENTRANCES OR EXITS.
 7. LOCATION AND INSTALLATION REQUIREMENTS FOR LUMINAIRES SHALL COMPLY WITH ALL APPLICABLE PROVISIONS OF THE 2022 CALIFORNIA ELECTRICAL CODE ARTICLE 410. FIXTURES SHALL BE SECURELY SUPPORTED.
 8. A FIXTURE THAT WEIGHS MORE THAN 6 POUNDS OR EXCEEDS 16 INCHES IN ANY DIMENSION SHALL NOT BE SUPPORTED BY THE SCREW SHELL OF A LAMP HOLDER.
 9. OUTLET BOXES OR OUTLET BOX SYSTEMS USED AS THE SOLE SUPPORT OF A CEILING-SUSPENDED FAN SHALL BE LISTED AND MARKED BY THE MANUF. AS SUITABLE FOR THIS PURPOSE. THE REQUIRED MARKING SHALL INCLUDE THE MAX. WEIGHT TO BE SUPPORTED FOR CEILING FANS THAT WEIGH MORE THAN 35 LBS.
 10. TYPE NM AND NMS CABLES SHALL NOT BE PERMITTED IN WET OR DAMP LOCATIONS.
 11. FLEXIBLE METAL CONDUIT (FMC) IS NOT PERMITTED IN A WET LOCATION.
 12. LUMINAIRES INSTALLED IN WET OR DAMP LOCATIONS SHALL BE INSTALLED SUCH THAT WATER CANNOT ENTER OR ACCUMULATE IN WIRING COMPARTMENTS, LAMP HOLDERS, OR OTHER ELECTRICAL PARTS. LUMINAIRES INSTALLED IN WET LOCATIONS SHALL BE MARKED, "SUITABLE FOR WET LOCATIONS." ALL LUMINAIRES INSTALLED IN DAMP LOCATIONS SHALL BE MARKED "SUITABLE FOR WET LOCATIONS" OR "SUITABLE FOR DAMP LOCATIONS."
 13. ALL 15 AND 20 AMPERE, 120 AND 125 VOLT EXTERIOR RECEPTACLES SHALL BE PROTECTED BY AN "IN-USE" WEATHERPROOF COVER.
 14. BATHROOM RECEPTACLES WILL BE SUPPLIED BY AT LEAST ONE 20 AMP BRANCH CIRCUITS.
 15. ALL NEW NON-RETRACTING-TYPE 125-VOLT, 15- AND 20-AMPERE RECEPTACLES SHALL BE LISTED TAMPER-RESISTANT RECEPTACLES
 16. COUNTERTOP RECEPTACLES IN THE KITCHEN, NOOK PANTRIES, DINING ROOMS AND SIMILAR AREAS SHALL BE SPACED SUCH THAT ANY POINT ALONG THE WALL AT THE COUNTERTOP LEVEL IS NOT MORE THAN 2 FEET FROM A RECEPTACLE. ANY COUNTER SPACE MORE THAN 12" WIDE SHALL BE PROVIDED WITH A RECEPTACLE. PENINSULA OR ISLAND COUNTER SPACE IS TO BE PROVIDED WITH AT LEAST ONE RECEPTACLE, WHERE A RANGE, COUNTER-MOUNTED COOKING UNIT, OR SINK IS INSTALLED IN THE ISLAND WITH LESS THAN 12" OF COUNTER SPACE BEHIND THE FIXTURES, THE ISLAND OR PENINSULAR IS CONSIDERED AS TWO COUNTER SPACES. THESE RECEPTACLES ARE TO BE LOCATED NO MORE THAN 6" BELOW THE COUNTERTOP WHERE THE COUNTERTOP DOES NOT EXTEND MORE THAN 6" BEYOND ITS SUPPORT BASE. COUNTERTOPS INTERRUPTED BY RANGES, SINKS, OR OTHER APPLIANCES SHALL BE CONSIDERED SEPARATE COUNTERS.
 17. GFCI PROTECTION IS REQUIRED FOR ALL 15A AND 20A, 125V RECEPTACLES INSTALLED IN THE FOLLOWING LOCATIONS PER 2019 CEC ART 210.8(A)
 - SINKS - GFCI PROTECTION FOR RECEPTACLES IN REQUIRED WITHIN AN ARC MEASUREMENT OF 6FT. FROM THE OUTSIDE EDGE OF A SINK.
 - BATH TUBS OR SHOWER STALLS - GFCI PROTECTION IS REQUIRED FOR RECEPTACLES LOCATED WITHIN 6FT. OF THE OUTSIDE EDGE OF A BATHTUB OR SHOWER STALL.
 - LAUNDRY AREAS - RECEPTACLES INSTALLED IN LAUNDRY AREAS OF A DWELLING UNIT SHALL BE GFCI PROTECTED.
 - DWELLING UNIT DISHWASHERS - OUTLETS (NOT REQUIRED FOR A HARDWIRED APPLIANCE) SUPPLYING DISHWASHERS IN A DWELLING UNIT MUST BE GFCI PROTECTED PER 2019 CEC ART. CEC 210.8
 18. ALL PERMANENTLY INSTALLED LUMINAIRES IN DWELLING UNITS SHALL BE HIGH EFFICACY AND HAVE MANUAL ON/OFF CONTROLS AND VACANCY SENSORS OR DIMMERS EXCEPT FOR HALLWAYS & CLOSETS LESS THAN 70 SQ. FT.
 19. EXHAUST FANS MUST BE SWITCHED SEPARATE FROM LIGHTING OR UTILIZE A DEVICE WHERE LIGHTING CAN BE TURNED OFF WHILE THE FAN IS RUNNING. EXCLUDES KITCHEN EXHAUST HOODS.
 20. UNDER CABINET MUST BE SWITCHED SEPARATE FROM ALL OTHER LIGHTING.
 21. PERMANENTLY INSTALLED LIGHTING IN CABINETS MUST BE HIGH EFFICACY.
 22. LIGHTING IN BATHROOMS, GARAGES, LAUNDRY ROOMS, AND UTILITY ROOMS MUST HAVE AT LEAST ONE LUMINAIR CONTROLLED BY VACANCY SENSORS.
 23. PERMANENTLY INSTALLED OUTDOOR LIGHTING ATTACHED TO RESIDENCE OR OTHER BUILDING MUST BE HIGH EFFICACY AND MUST BE CONTROLLED BY A MANUAL ON AND OFF SWITCH AND ONE OF THESE CONTROL TYPES:
 - PHOTO-CONTROL AND MOTION SENSOR OR
 - PHOTO-CONTROL AND AUTOMATIC TIME SWITCH CONTROL OR ASTRONOMICAL TIME CLOCK THAT AUTOMATICALLY TURNS OUTDOOR LIGHTING OFF DURING DAYLIGHT HOURS OR
 - ENERGY MANAGEMENT CONTROL SYSTEM (EMCS) THAT PROVIDES THE FUNCTIONALITY OF AN ASTRONOMICAL TIME CLOCK.
- SMOKE ALARM NOTES:**
1. ALL SMOKE ALARMS SHALL BE LISTED IN ACCORDANCE WITH UL 217 AND INSTALLED IN ACCORDANCE WITH CODE SECTION R314 AND THE HOUSEHOLD FIRE WARNING EQUIPMENT PROVISIONS OF NFPA 72.
 2. SMOKE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
 - IN EACH SLEEPING ROOM.
 - OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS.
 3. WHEN MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN AN INDIVIDUAL DWELLING UNIT THE ALARM DEVICES SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE INDIVIDUAL UNIT.
 4. SMOKE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING PROVIDED THAT SUCH WIRING IS FROM A COMMERCIAL SOURCE AND SHALL BE EQUIPPED WITH A BACKUP BATTERY.
- CARBON MONOXIDE ALARM NOTES:**
1. SINGLE AND MULTIPLE STATION CARBON MONOXIDE ALARMS SHALL BE LISTED AS COMPLYING WITH THE REQUIREMENTS OF UL2034. CARBON MONOXIDE DETECTORS SHALL BE LISTED AS COMPLYING WITH THE REQUIREMENTS OF UL2075. CARBON MONOXIDE ALARMS AND DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH R315, THE CURRENT EDITION OF NFPA 720, AND THE MANUF. INSTALLATION INSTRUCTIONS.
 2. CARBON MONOXIDE ALARMS SHALL BE INSTALLED IN THE FOLLOWING LOCATIONS:
 - OUTSIDE EACH SEPARATE DWELLING SLEEPING AREA IN THE IMMEDIATE VICINITY OF BEDROOMS.
 - ON EVERY LEVEL OF A DWELLING UNIT INCLUDING BASEMENTS.
 3. WHERE MORE THAN ONE CARBON MONOXIDE ALARM IS REQUIRED TO BE INSTALLED WITHIN THE DWELLING UNIT OR WITHIN A SLEEPING UNIT THE ALARM SHALL BE INTERCONNECTED IN A MANNER THAT ACTIVATION OF ONE ALARM SHALL ACTIVATE ALL OF THE ALARMS IN THE INDIVIDUAL UNIT.
 4. CARBON MONOXIDE ALARMS SHALL RECEIVE THEIR PRIMARY POWER FROM THE BUILDING WIRING PROVIDED THAT SUCH WIRING IS FROM A COMMERCIAL SOURCE AND SHALL BE EQUIPPED WITH A BACKUP BATTERY.
 5. CARBON MONOXIDE ALARMS COMBINED WITH SMOKE ALARMS SHALL COMPLY WITH SECTION R315, ALL APPLICABLE STANDARDS, AND REQUIREMENTS FOR LISTING AND APPROVAL BY THE OFFICE OF THE STATE FIRE MARSHALL, FOR SMOKE ALARMS.
- ENERGY COMPLIANCE:**
- SOLAR READY BUILDINGS, SHALL MEET THE REQUIREMENTS OF SECTION 110.10 APPLICABLE TO THE BUILDING PROJECT
 - ENERGY STORAGE SYSTEMS (ESS) READY. ALL SINGLE FAMILY RESIDENCES THAT INCLUDE ONE OR TWO DWELLING UNITS SHALL MEET THE FOLLOWING. ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE:
 1. AT LEAST ONE OF THE FOLLOWING SHALL BE PROVIDED:
 - A. ESS READY INTERCONNECTION EQUIPMENT WITH A MINIMUM BACKED-UP CAPACITY OF 60 AMPS AND A MINIMUM OF FOUR ESS-SUPPLIED BRANCH CIRCUITS, OR
 - B. A DEDICATED RACEWAY FROM THE MAIN SERVICE TO A PANELBOARD (SUBPANEL) THAT SUPPLIES THE BRANCH CIRCUITS IN SECTION 150.0(S)(2). ALL BRANCH CIRCUITS ARE PERMITTED TO BE SUPPLIED BY THE MAIN SERVICE PANEL PRIOR TO THE INSTALLATION OF AN ESS. THE TRADE SIZE OF THE RACEWAY SHALL BE NOT LESS THAN 1 INCH. THE PANELBOARD THAT SUPPLIES THE BRANCH CIRCUITS (SUBPANEL) MUST BE LABELED "SUBPANEL" SHALL INCLUDE ALL BACKED-UP LOAD CIRCUITS.
 2. A MINIMUM OF FOUR BRANCH CIRCUITS SHALL BE IDENTIFIED AND HAVE THERE SOURCE OF SUPPLY COLLOCATED AT A SINGLE PANELBOARD SUITABLE TO BE SUPPLIED BY THE ESS. AT LEAST ONE CIRCUIT SHALL SUPPLY THE REFRIGERATOR, ONE LIGHTING CIRCUIT SHALL BE LOCATED NEAR THE PRIMARY EGRESS AND AT LEAST ONE CIRCUIT SHALL SUPPLY A SLEEPING ROOM RECEPTACLE OUTLET.
 3. THE MAIN PANELBOARD SHALL HAVE A MINIMUM BUSBAR RATING OF 225 AMPS
 4. SUFFICIENT SPACE SHALL BE RESERVED TO ALLOW FUTURE INSTALLATION OF A SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH WITHIN 3 FEET OF MAIN PANELBOARD. RACEWAYS SHALL BE INSTALLED BETWEEN THE PANELBOARD AND THE SYSTEM ISOLATION EQUIPMENT/TRANSFER SWITCH LOCATION TO ALLOW THE CONNECTION OF BACKUP POWER SOURCE.
- ELECTRIC COOKTOP READY. SYSTEMS USING GAS OR PROPANE COOKTOP TO SERVE INDIVIDUAL DWELLING UNITS SHALL INCLUDE THE FOLLOWING:
1. A DEDICATED 240 VOLT BRANCH CIRCUIT WIRING SHALL BE INSTALLED WITHIN 3 FEET FROM THE COOKTOP AND ACCESSIBLE TO THE COOKTOP WITH NO OBSTRUCTIONS. THE BRANCH CIRCUIT CONDUCTORS SHALL BE RATED AT 50 AMPS MINIMUM. THE BLANK COVER SHALL BE IDENTIFIED AS "240V READY." ALL ELECTRICAL COMPONENTS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA ELECTRICAL CODE.
 2. THE MAIN ELECTRICAL SERVICE PANEL SHALL HAVE A RESERVED SPACE TO ALLOW FOR THE INSTALLATION OF A DOUBLE POLE CIRCUIT BREAKER FOR A FUTURE ELECTRIC COOKTOP INSTALLATION. THE RESERVED SPACE SHALL BE PERMANENTLY MARKED AS "FOR FUTURE 240V USE."

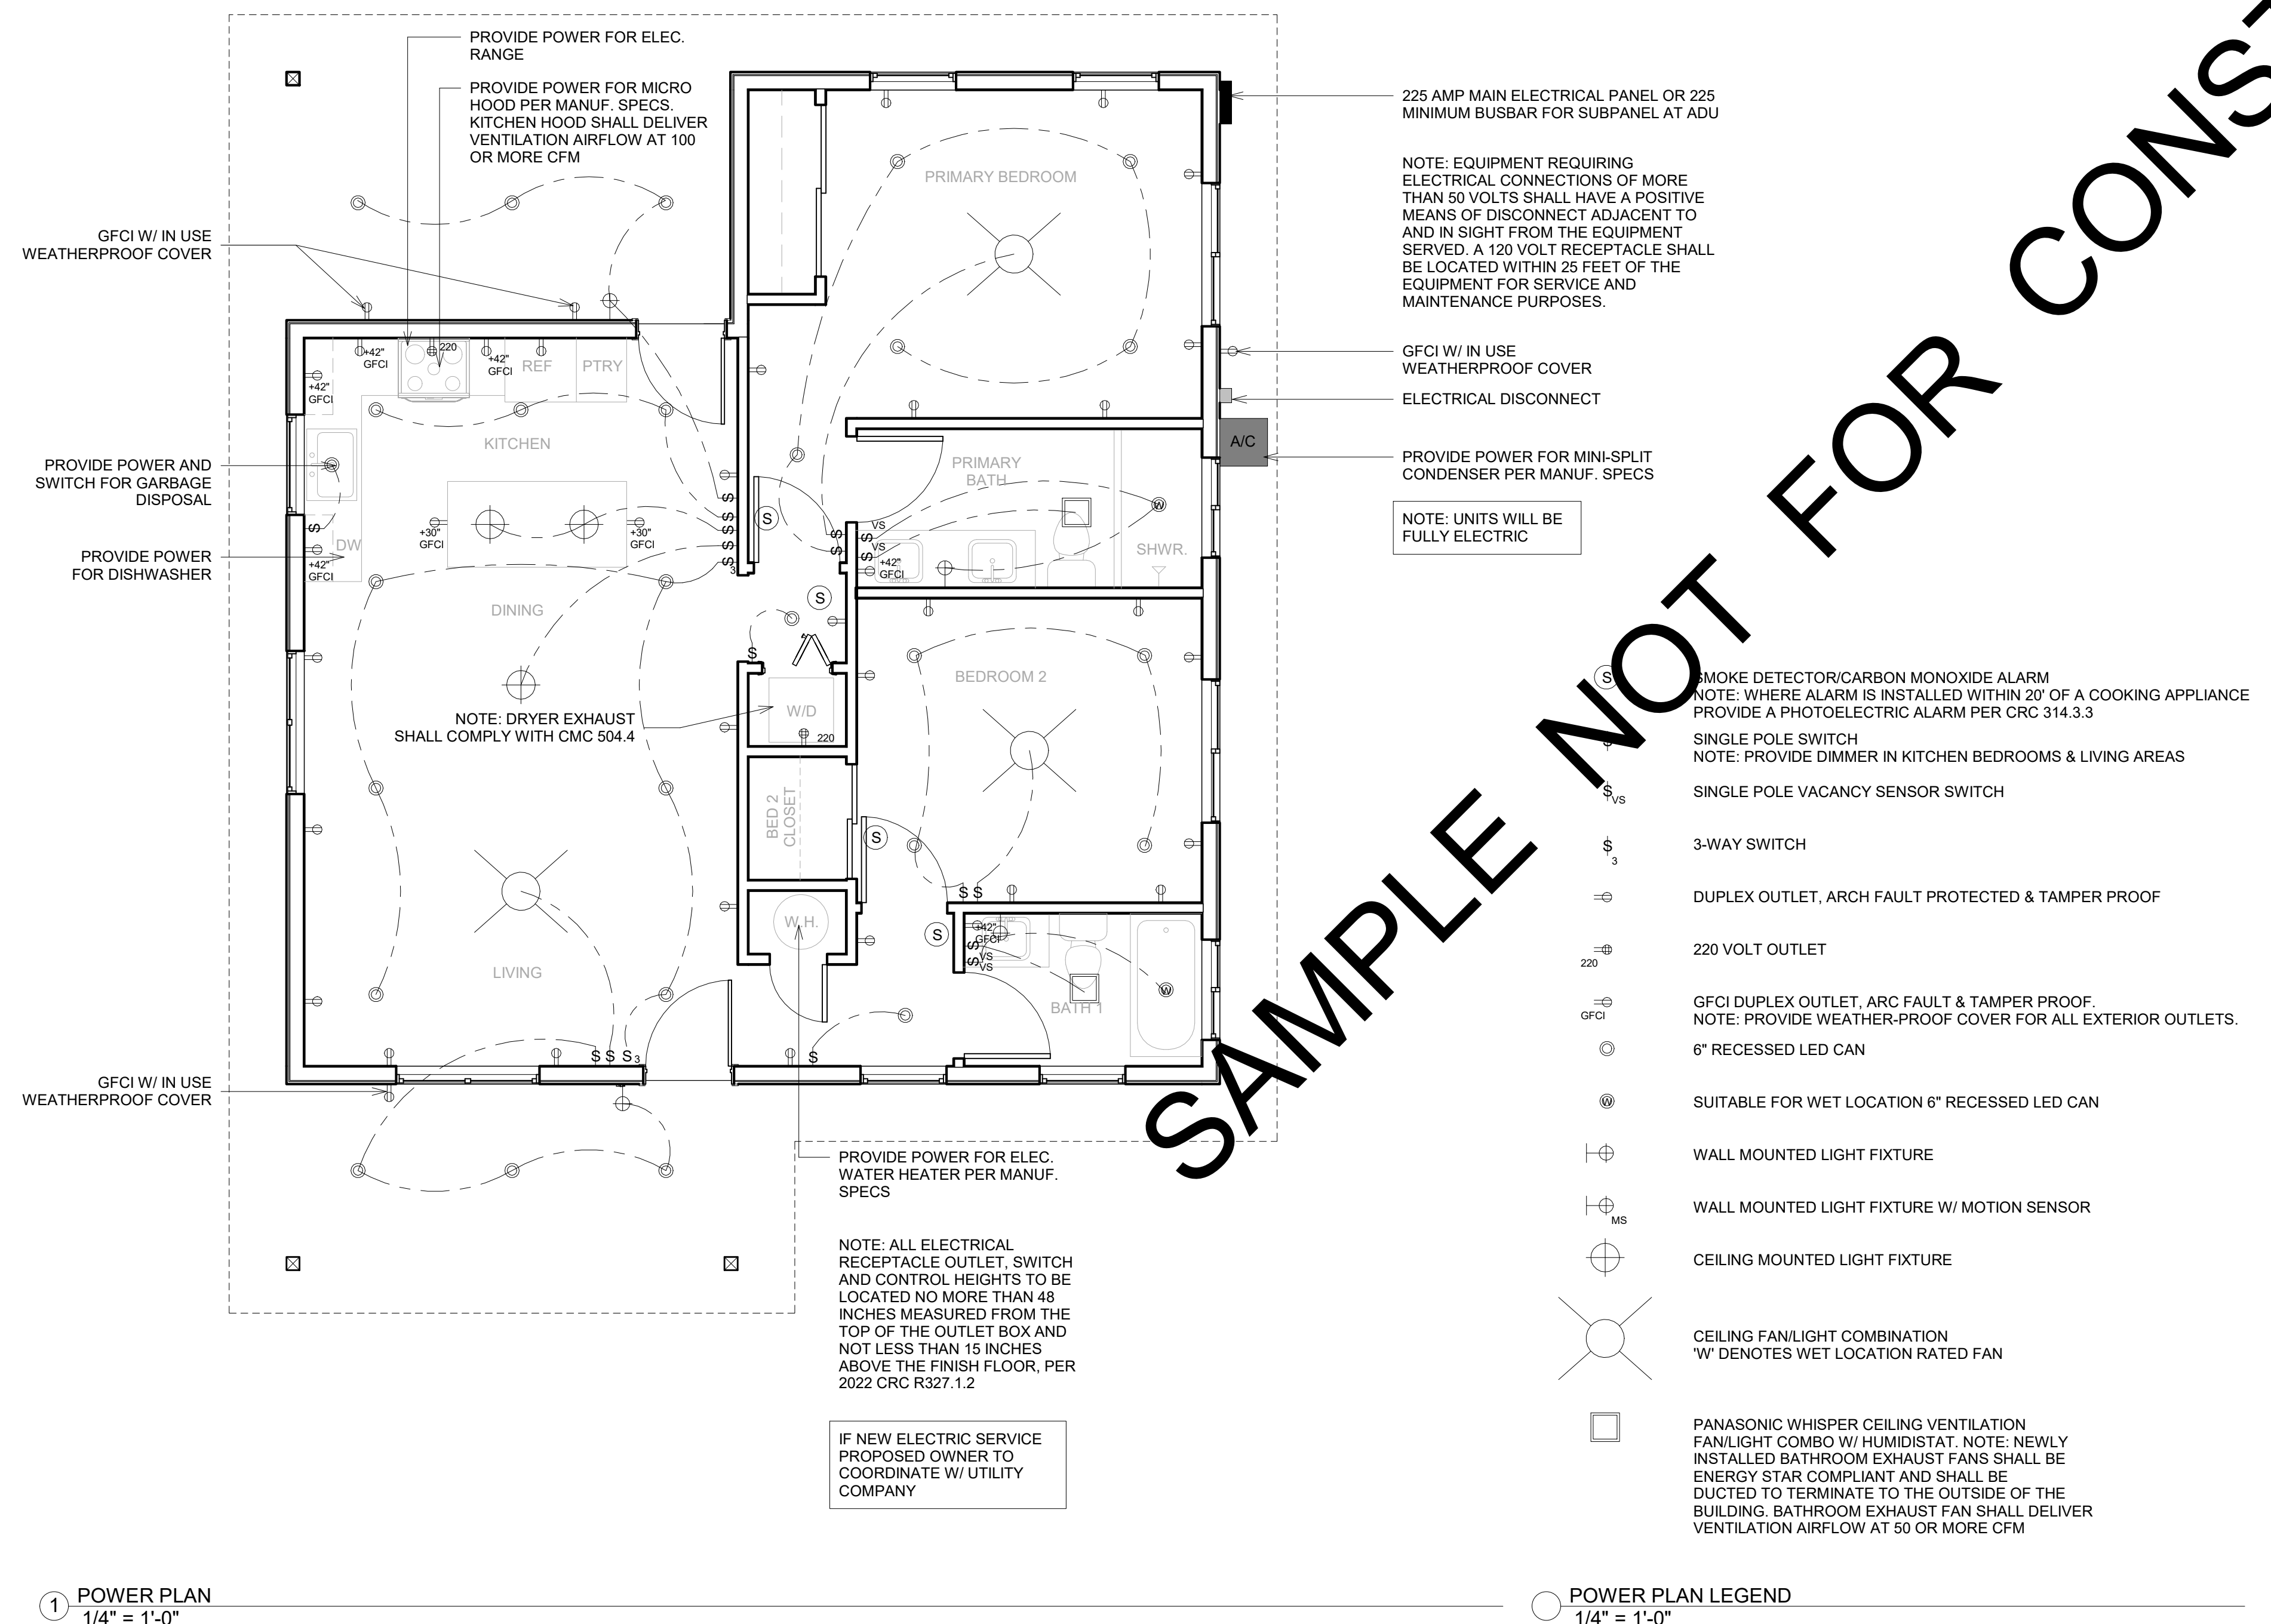


SAMPLE NOT FOR CONSTRUCTION

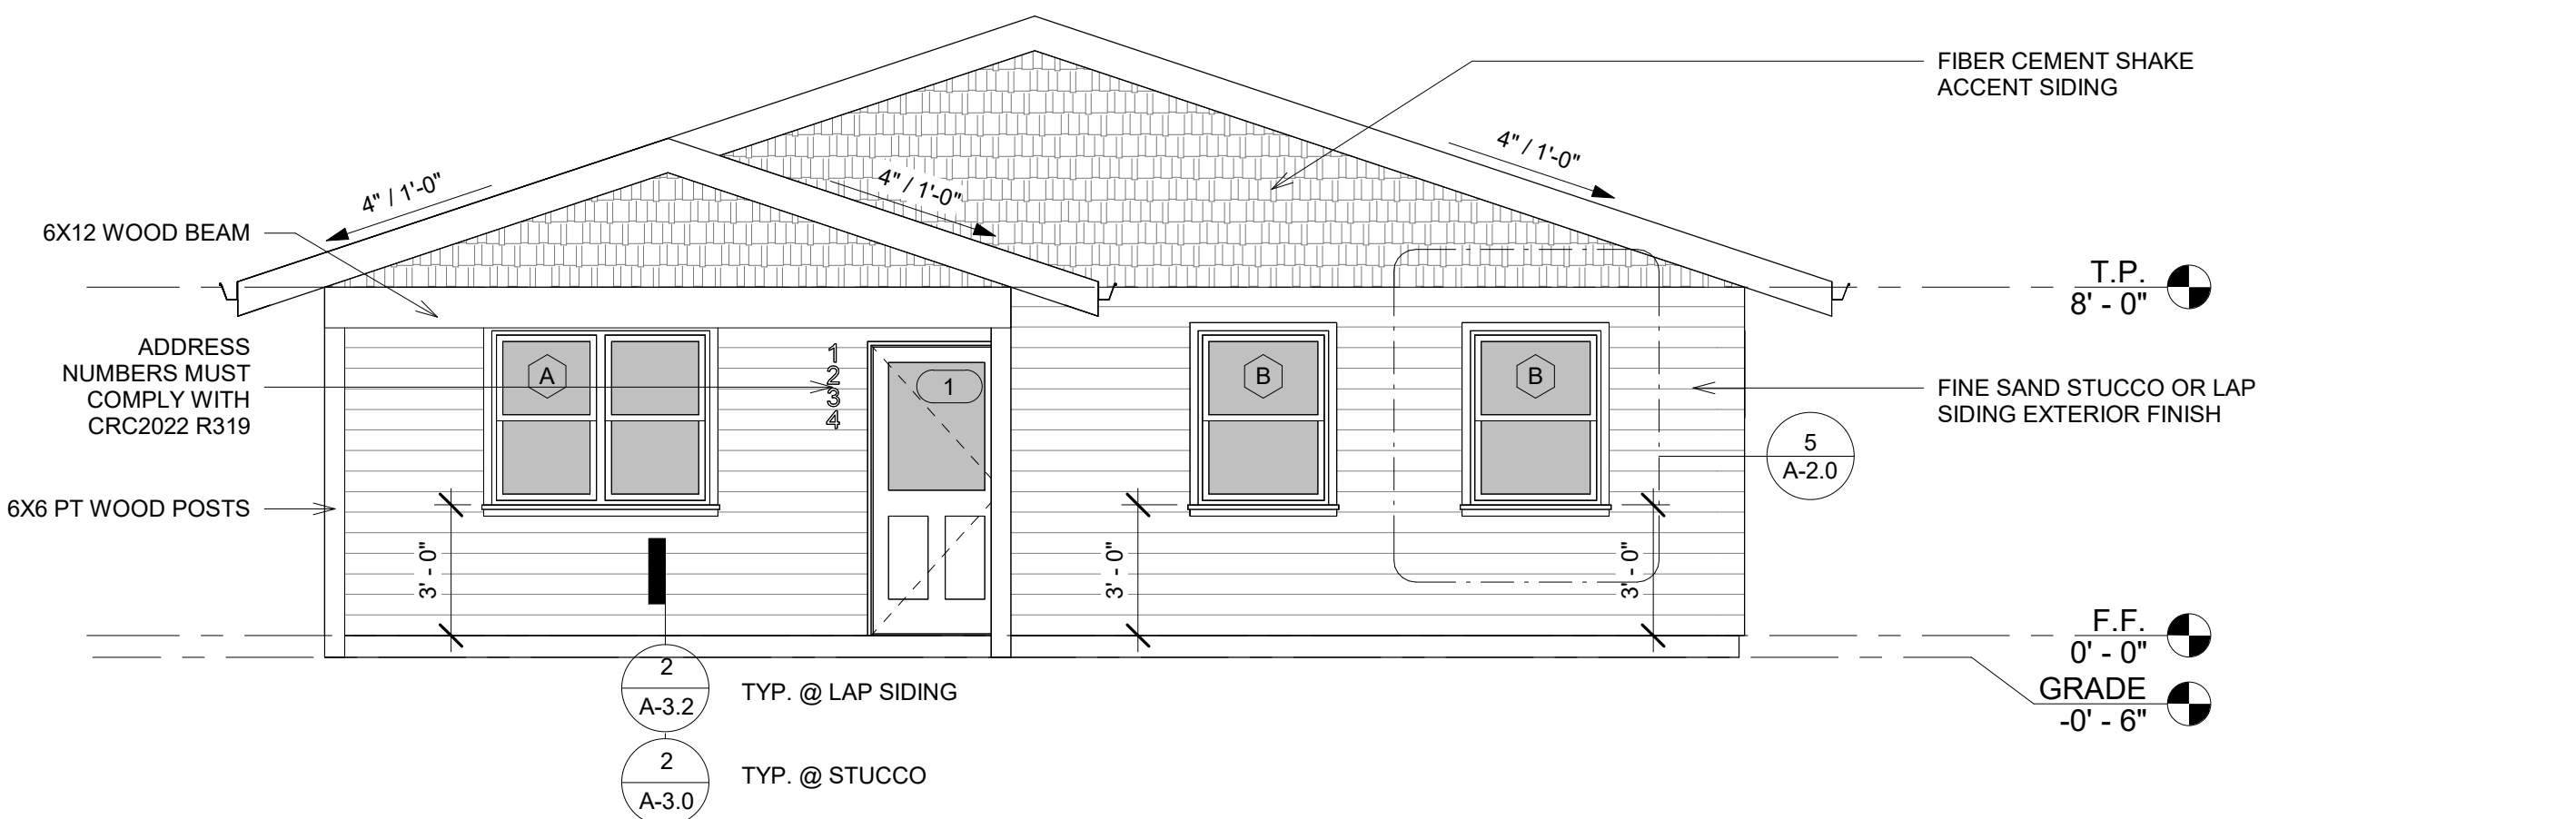


1 FRONT ELEVATION
1/4" = 1'-0"

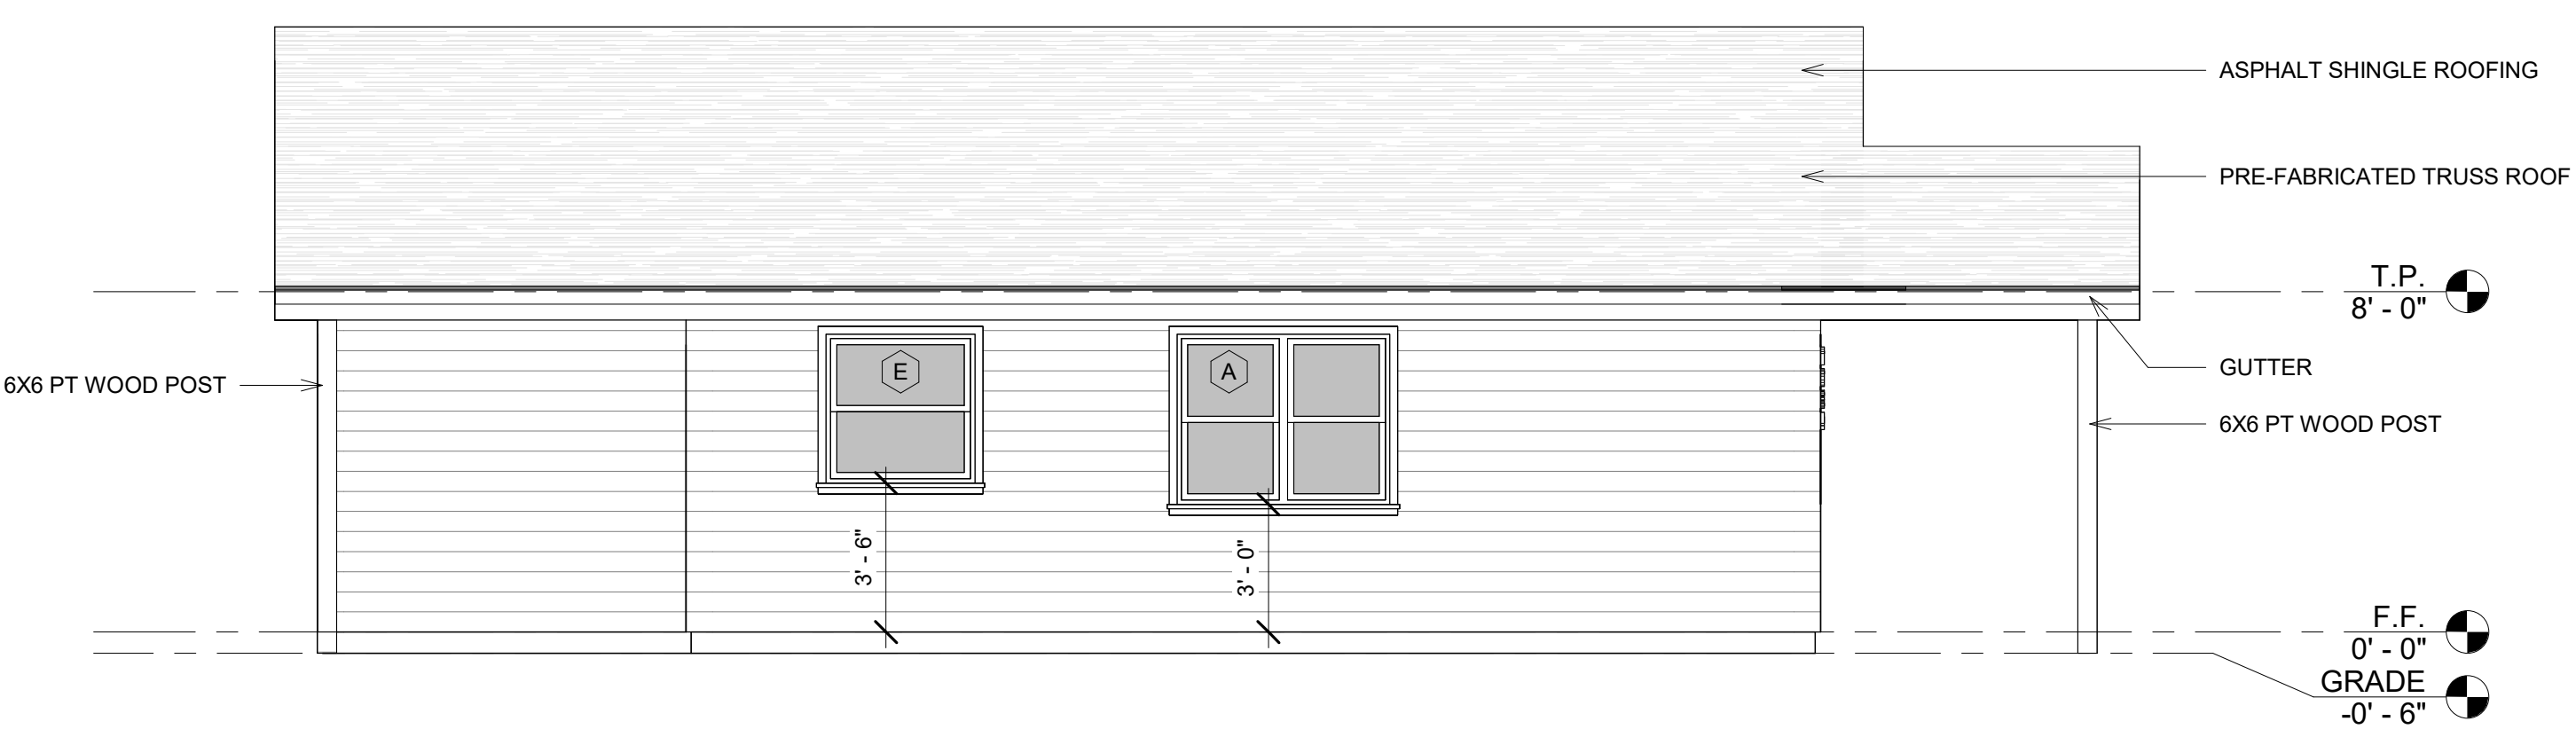

2 LEFT (SIDE) ELEVATION
1/4" = 1'-0"

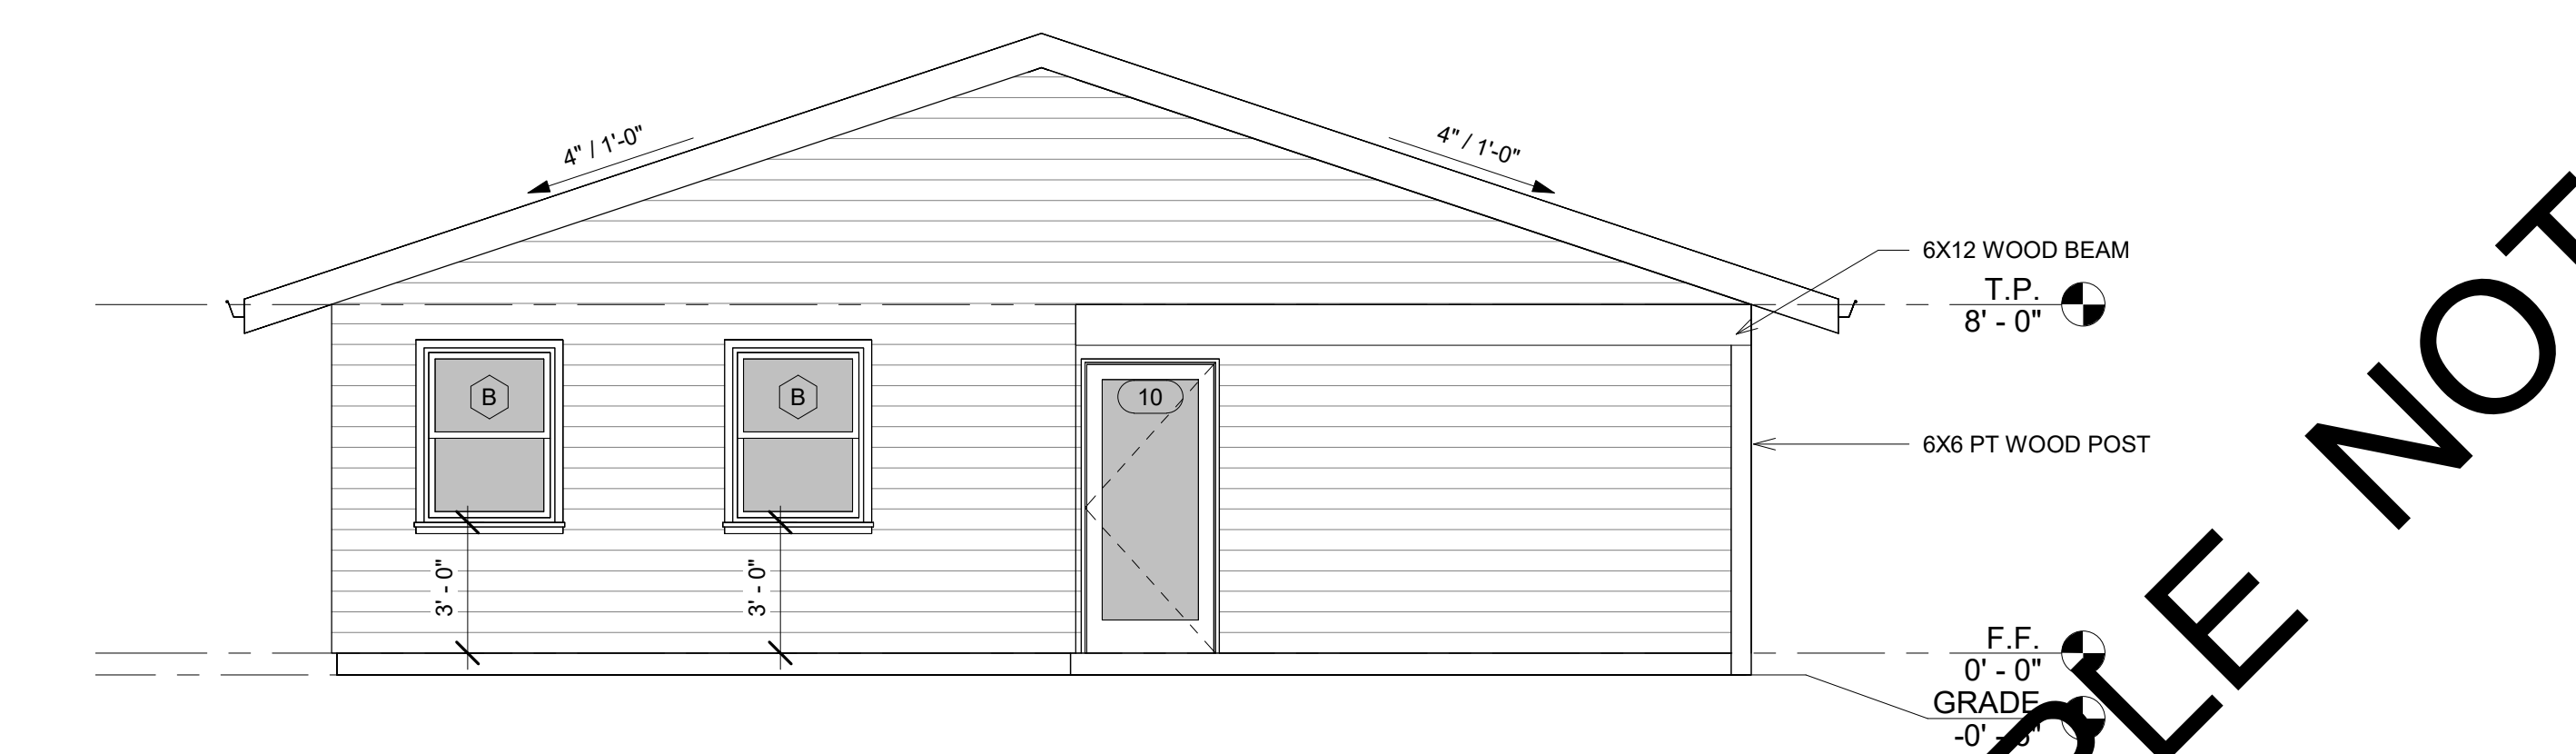

3 REAR ELEVATION
1/4" = 1'-0"

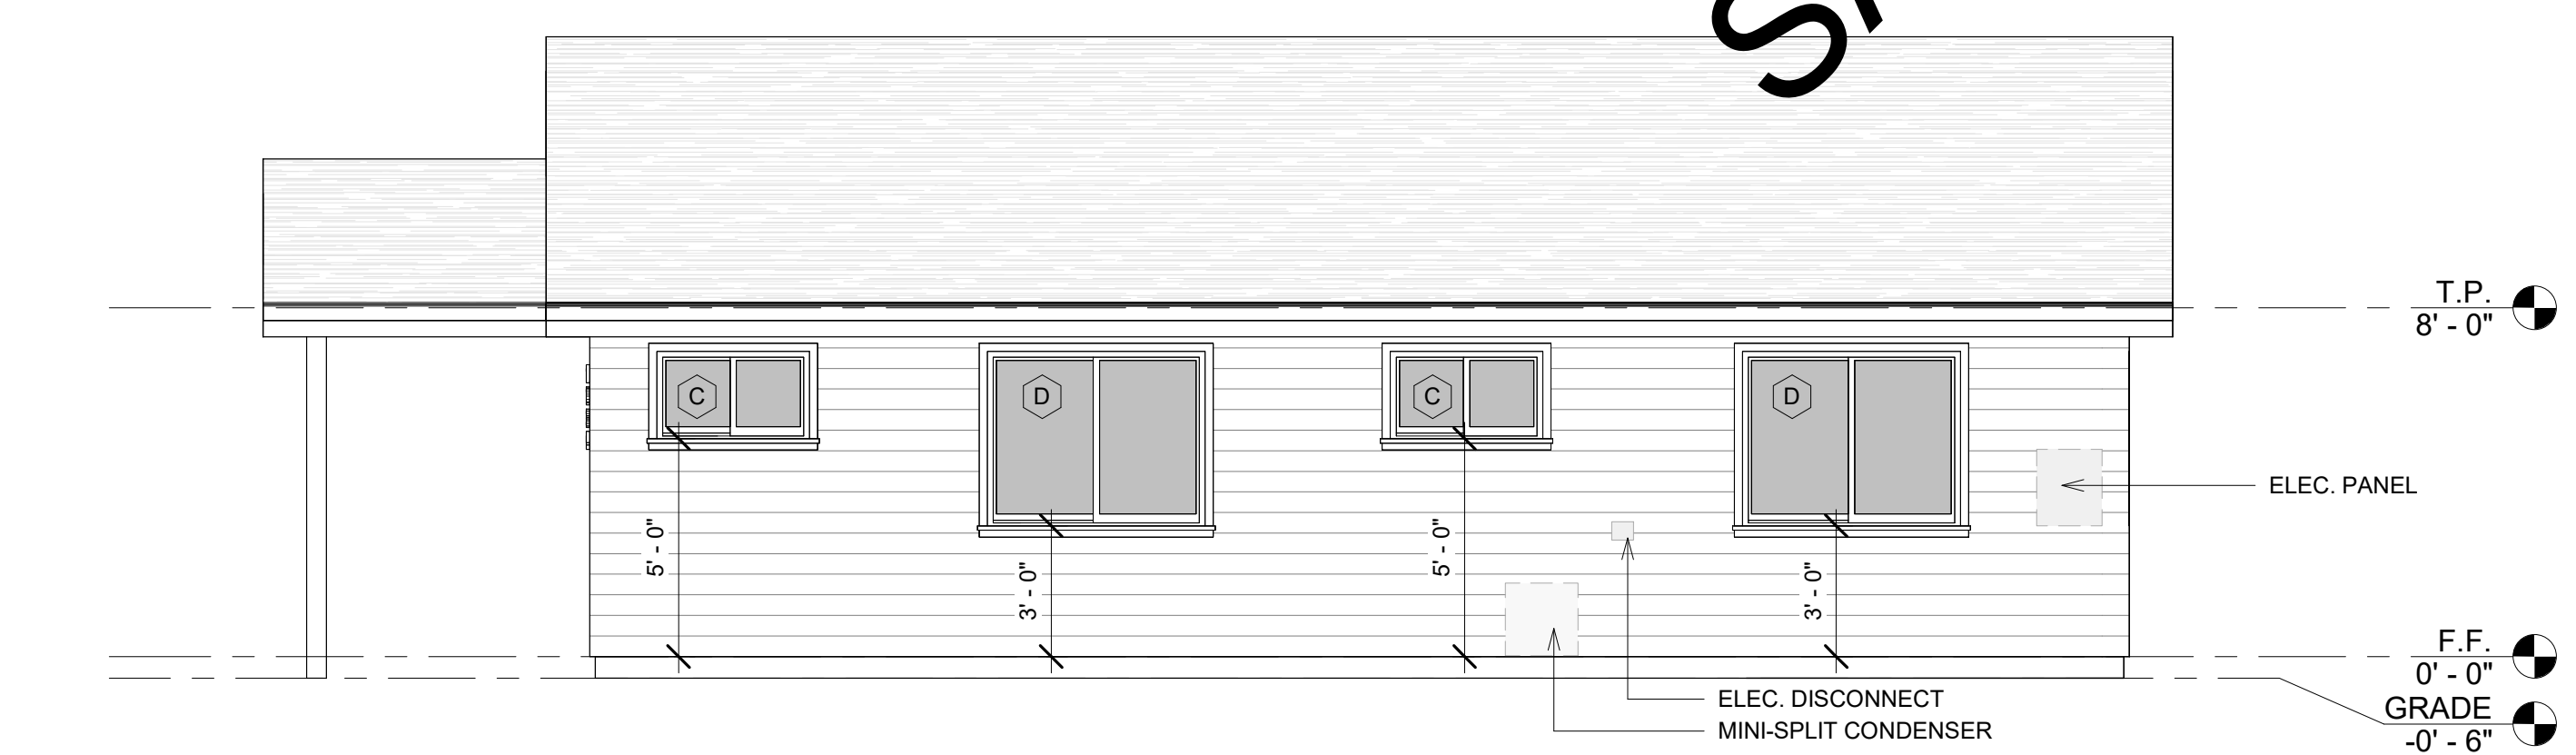


4 RIGHT (SIDE) ELEVATION
1/4" = 1'-0"

ADDRESS NUMBER NOTES:

- THE ADDRESS IDENTIFICATION SHALL BE LEGIBLE AND PLACED IN A POSITION THAT IS VISIBLE FROM THE STREET OR ROAD FRONTING THE PROPERTY.
- ADDRESS IDENTIFICATION CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND.
- ADDRESS NUMBERS SHALL BE ARABIC NUMBERS OR ALPHABETICAL LETTERS. NUMBERS SHALL NOT BE SPELLED OUT.
- EACH CHARACTER SHALL BE NOT LESS THAN 4 INCHES IN HEIGHT WITH A STROKE WIDTH OF NOT LESS THAN 0.5 INCH.
- WHERE REQUIRED BY THE FIRE CODE OFFICIAL, ADDRESS IDENTIFICATION SHALL BE PROVIDED IN ADDITIONAL APPROVED LOCATIONS TO FACILITATE EMERGENCY RESPONSE.
- WHERE ACCESS IS BY MEANS OF A PRIVATE ROAD AND THE BUILDING ADDRESS CANNOT BE VIEWED FROM THE PUBLIC WAY, A MONUMENT, POLE OR OTHER SIGN OR MEANS SHALL BE USED TO IDENTIFY THE STRUCTURE. ADDRESS IDENTIFICATION SHALL BE MAINTAINED. CRC 2022 R319

SAMPLE NOT FOR CONSTRUCTION

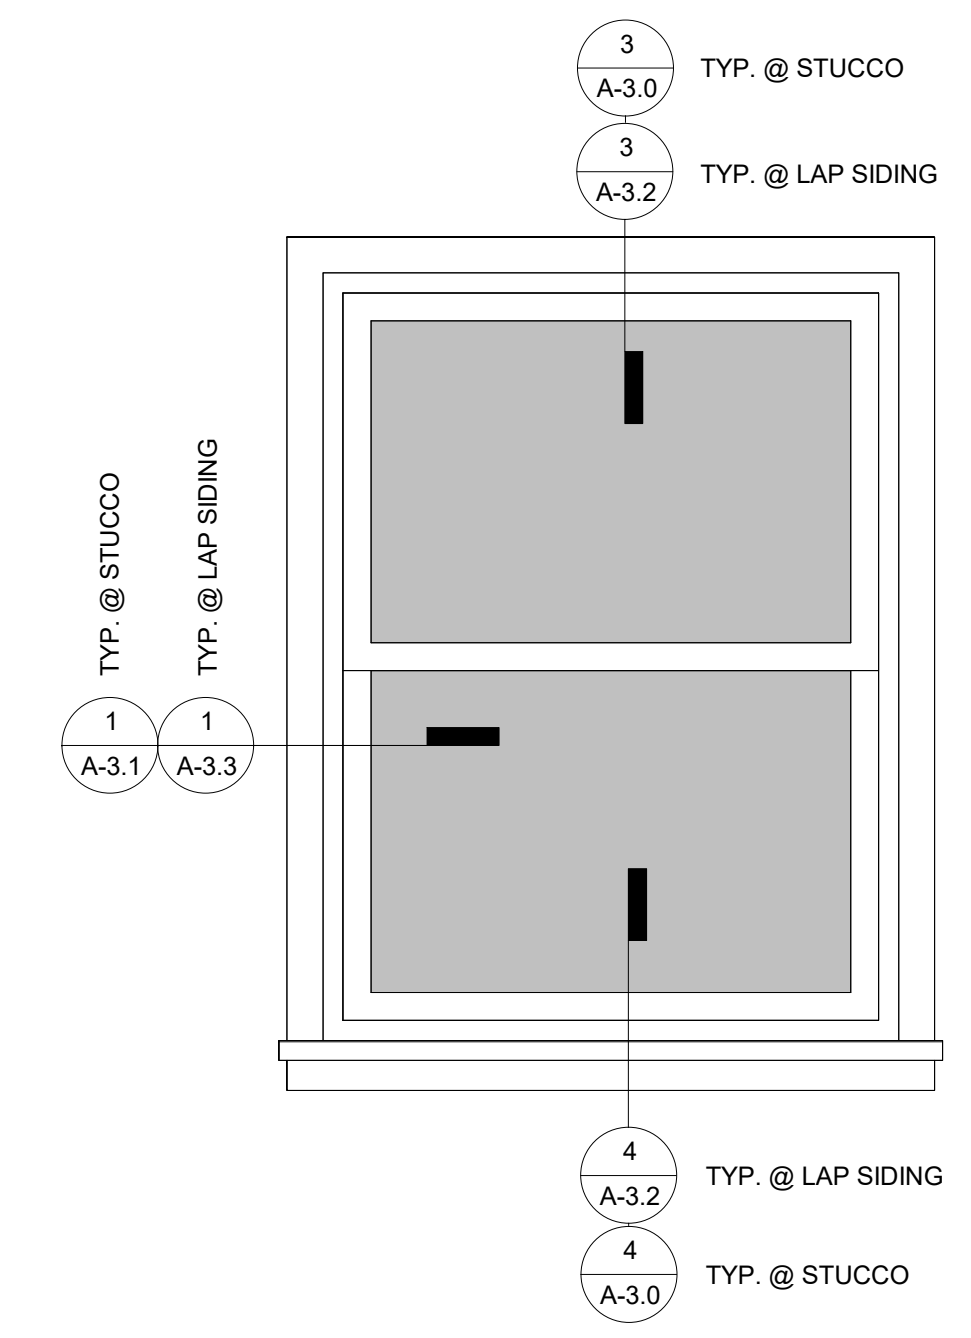

5 WINDOW DETAIL KEY
1" = 1'-0"

No.	Date	Description

Sheet Name:
 EXTERIOR ELEVATIONS


Scale:
 As indicated

Date:
 MAR 2024


Drawn By:
 IS

Approved By:
 LM


Sheet Number:

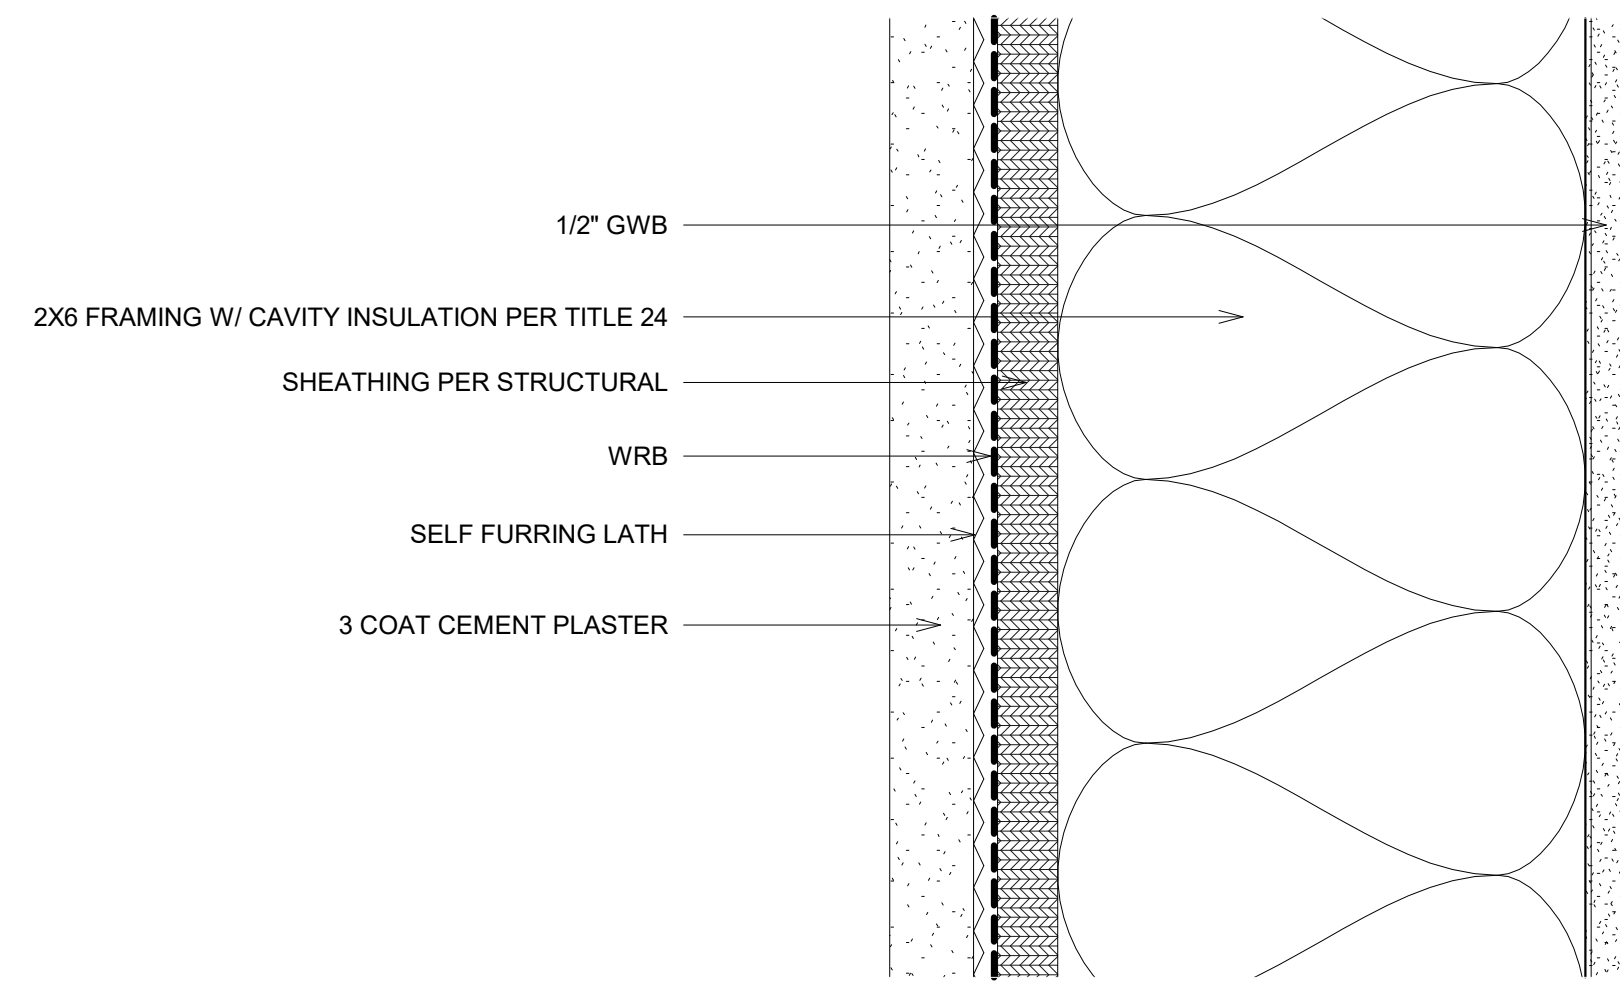


1 STUCCO WALL SECTION
6" = 1'-0"

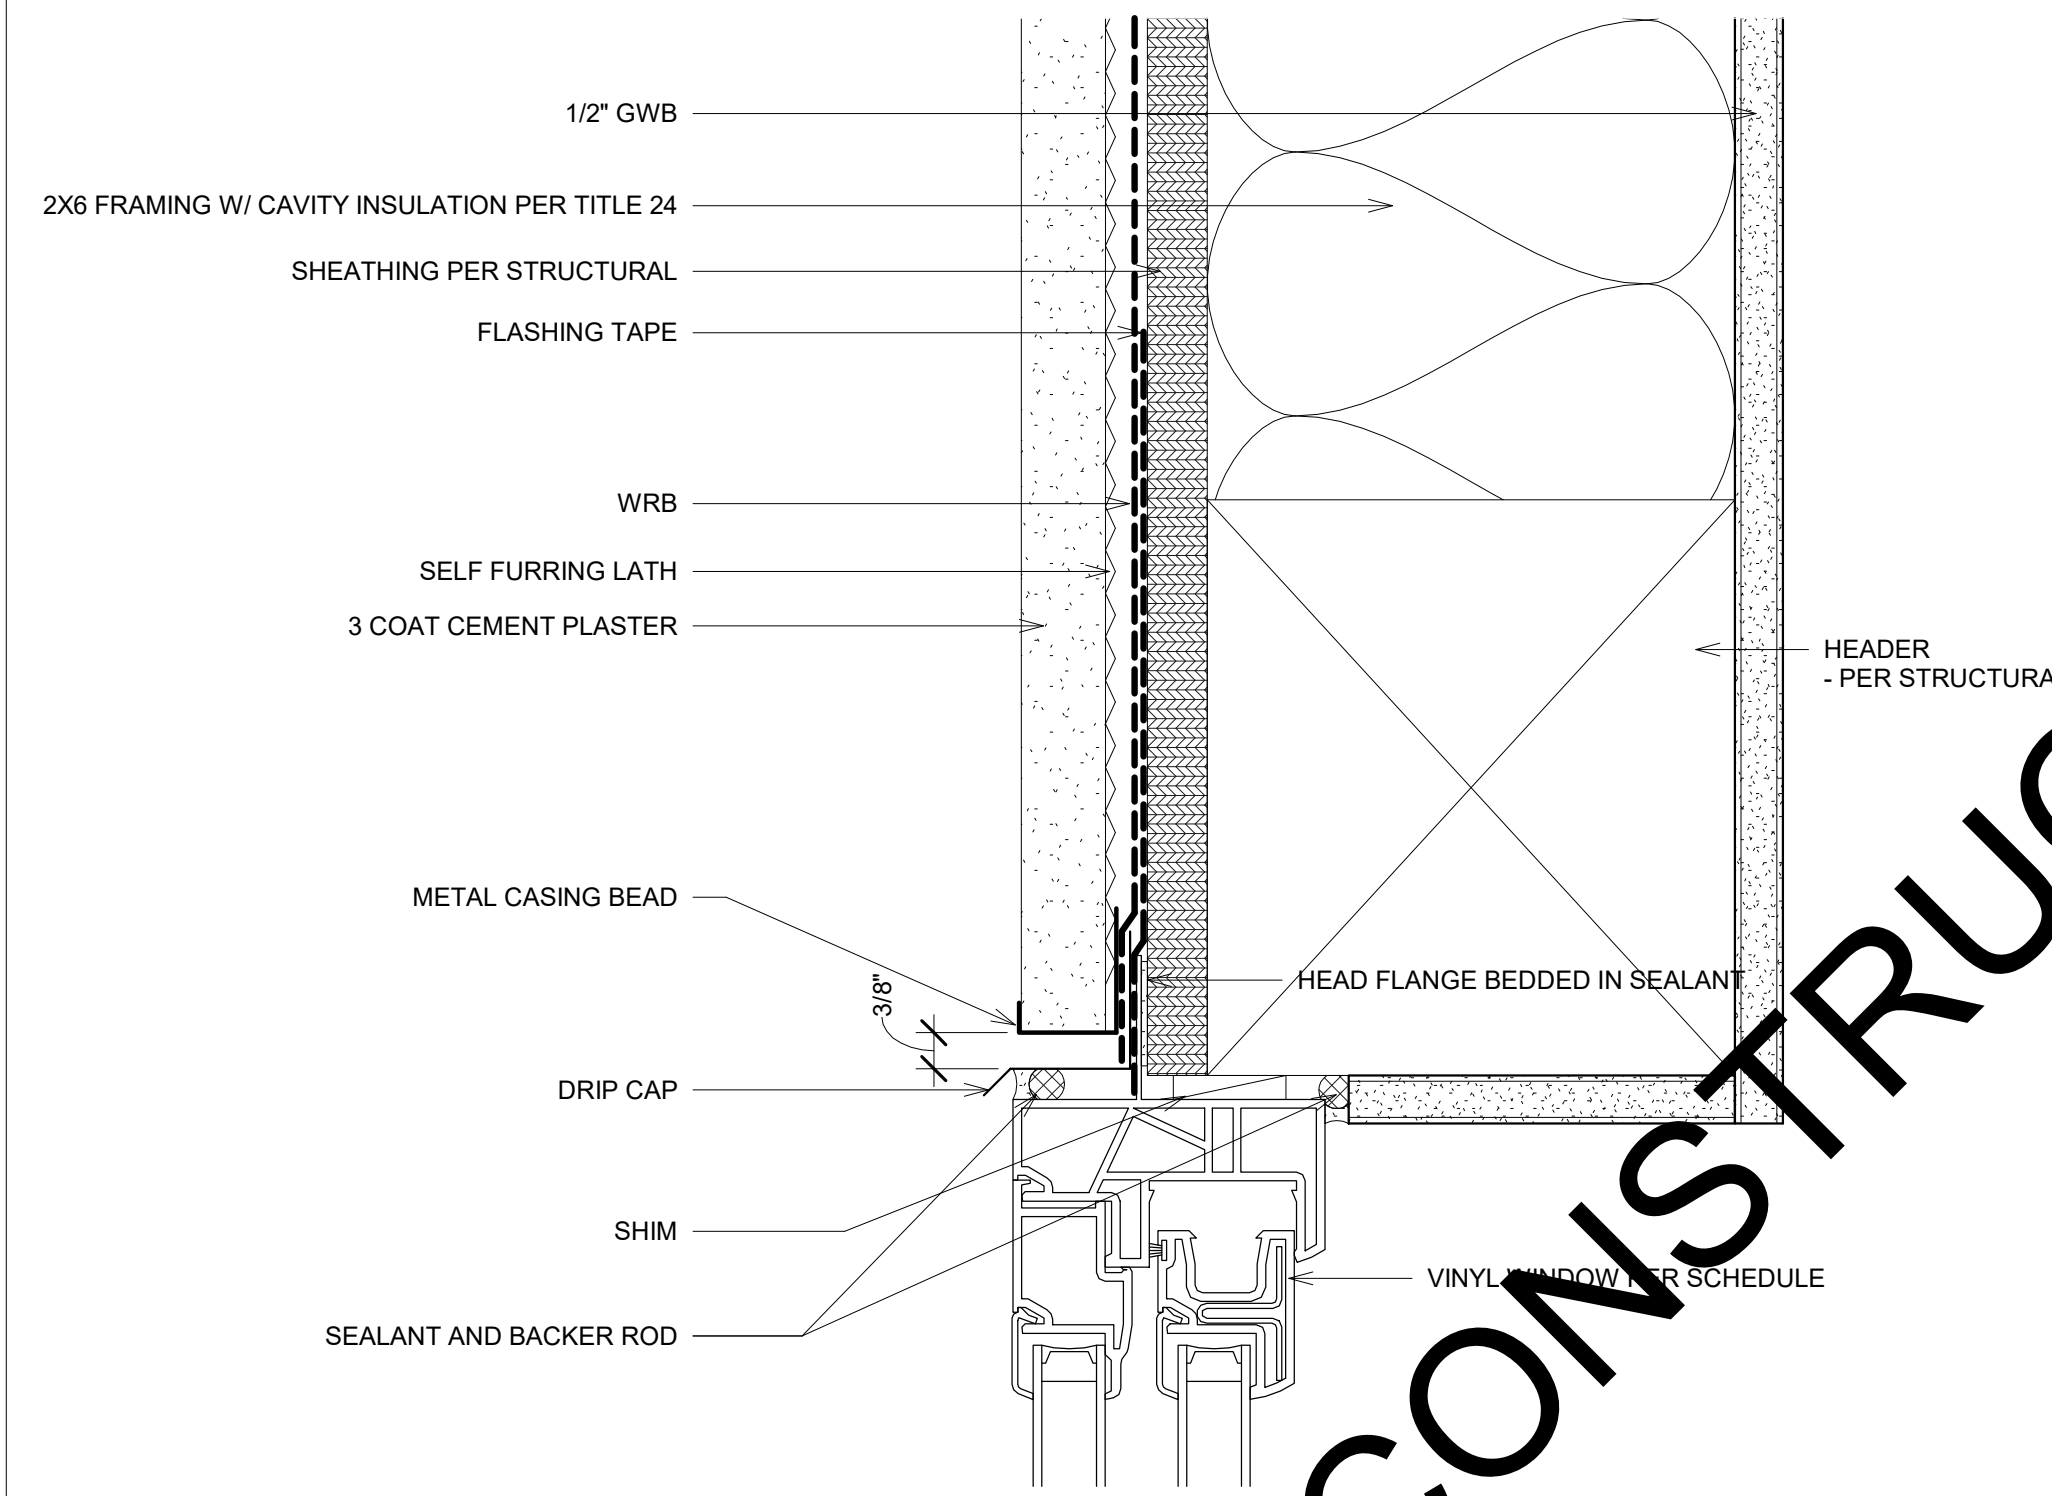

3 STUCCO @ VINYL WINDOW HEAD
6" = 1'-0"

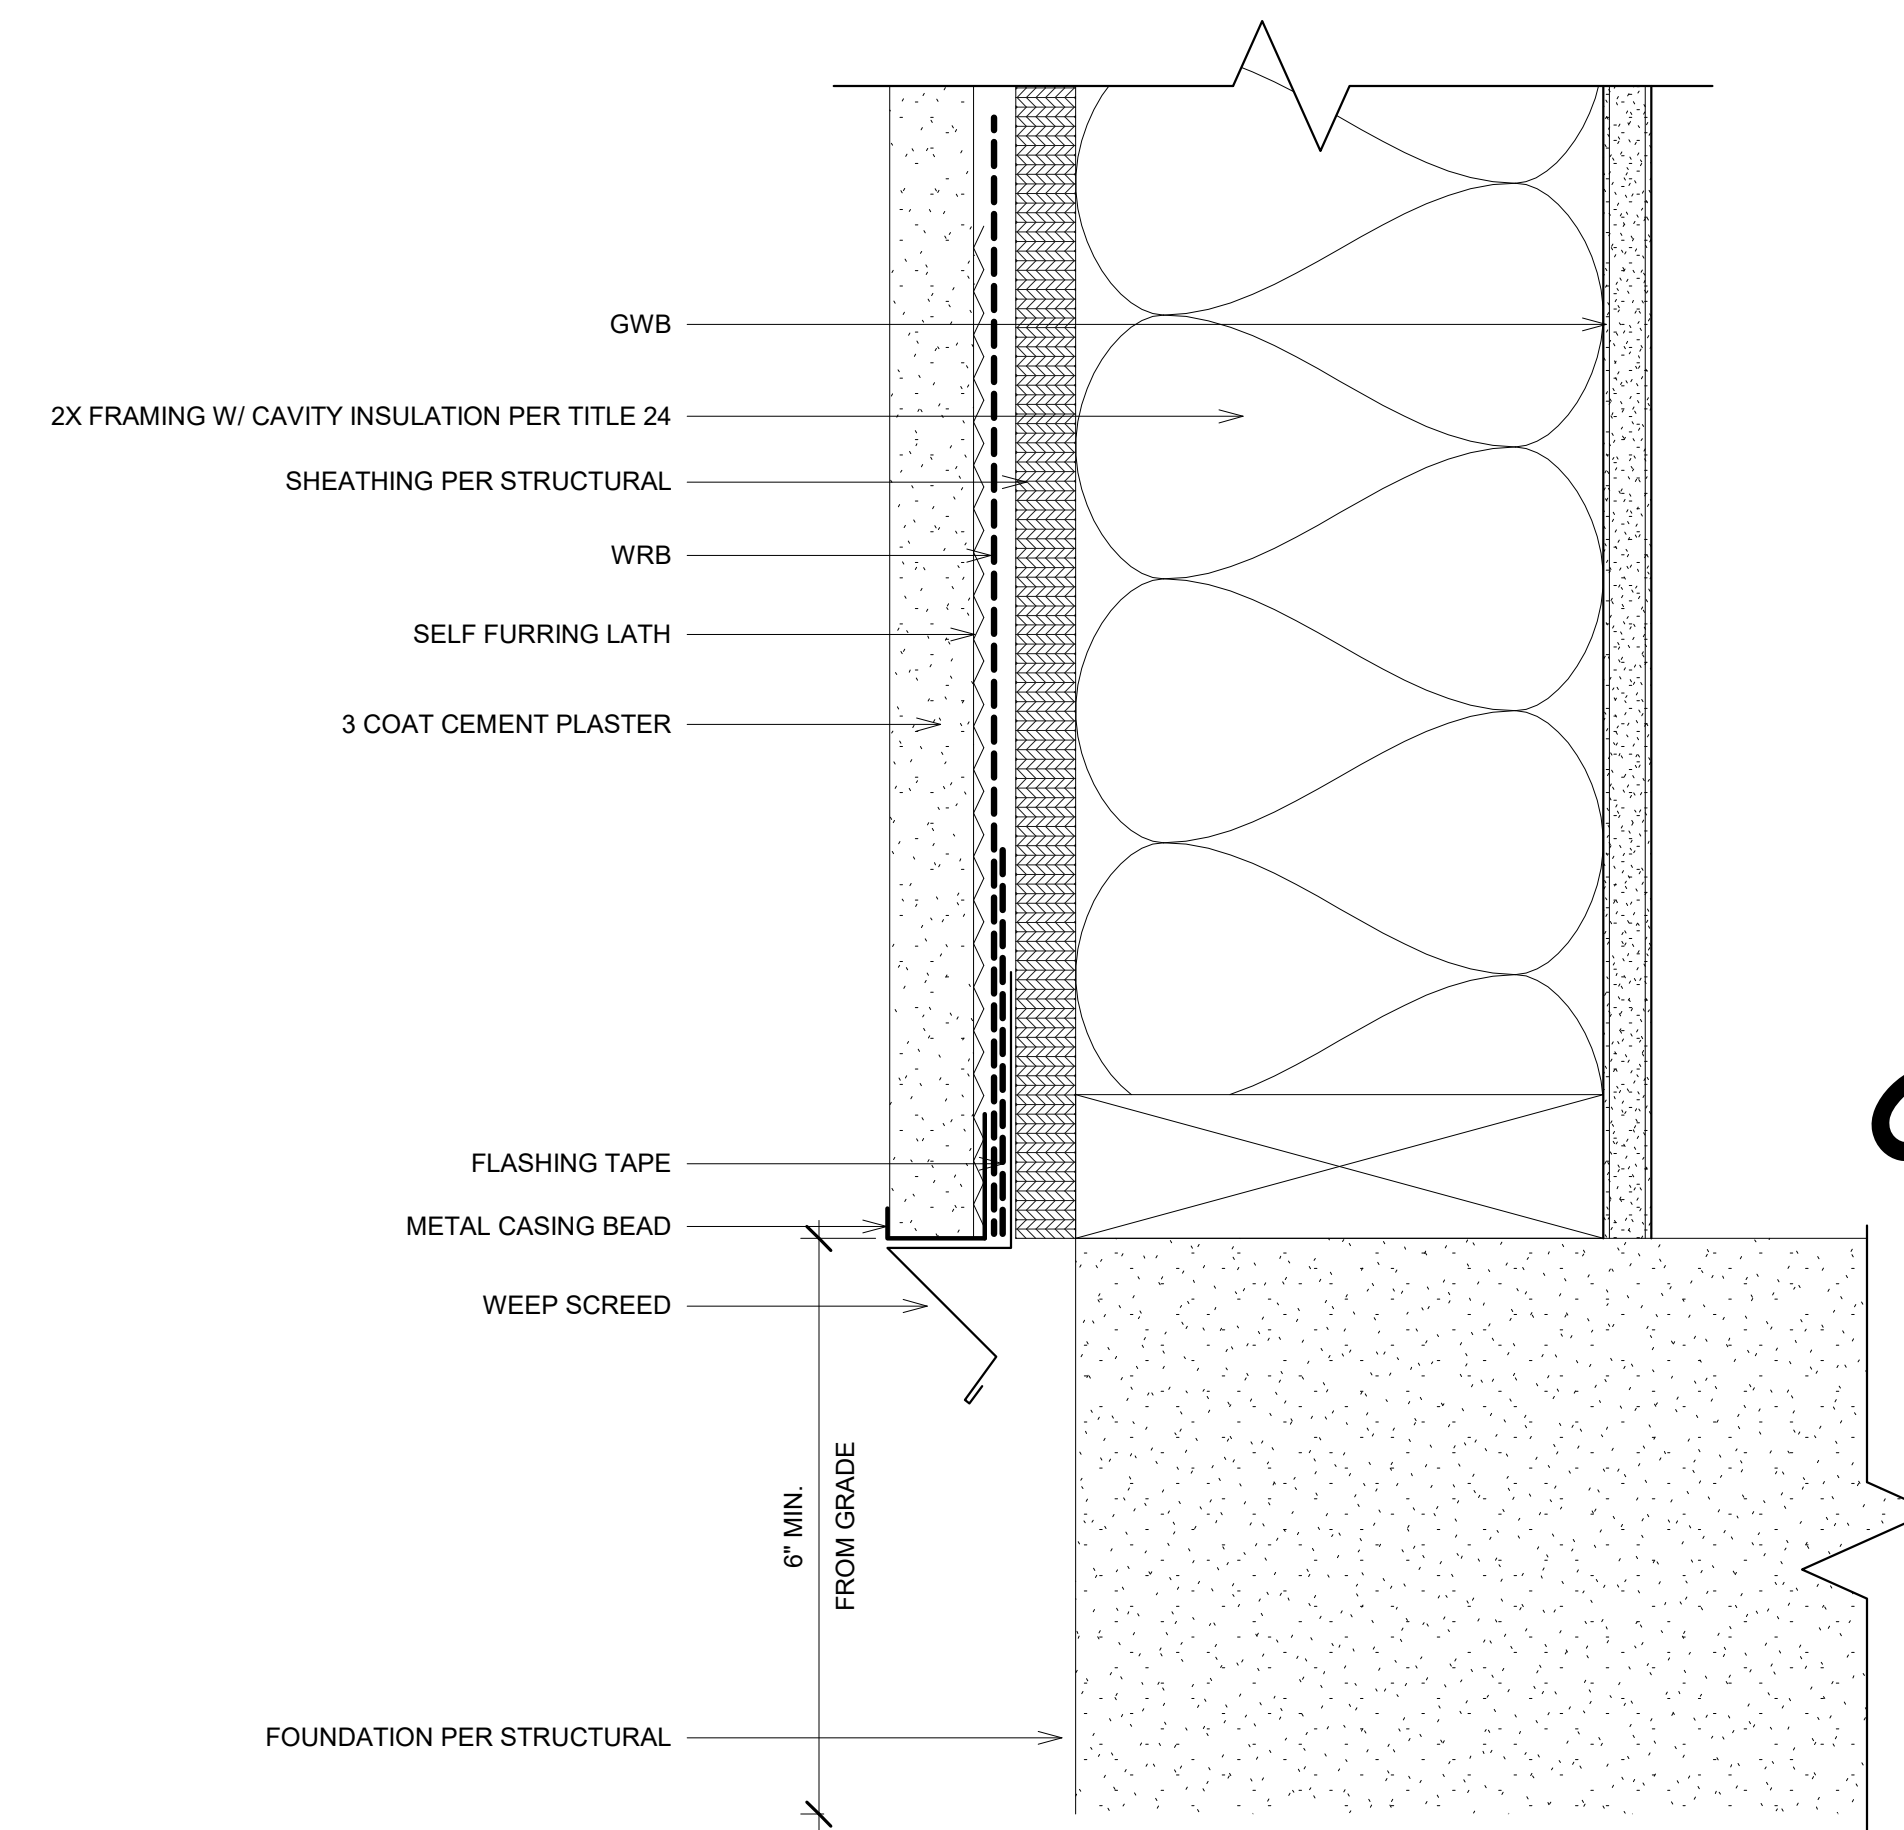


2 STUCCO @ WALL BASE
6" = 1'-0"

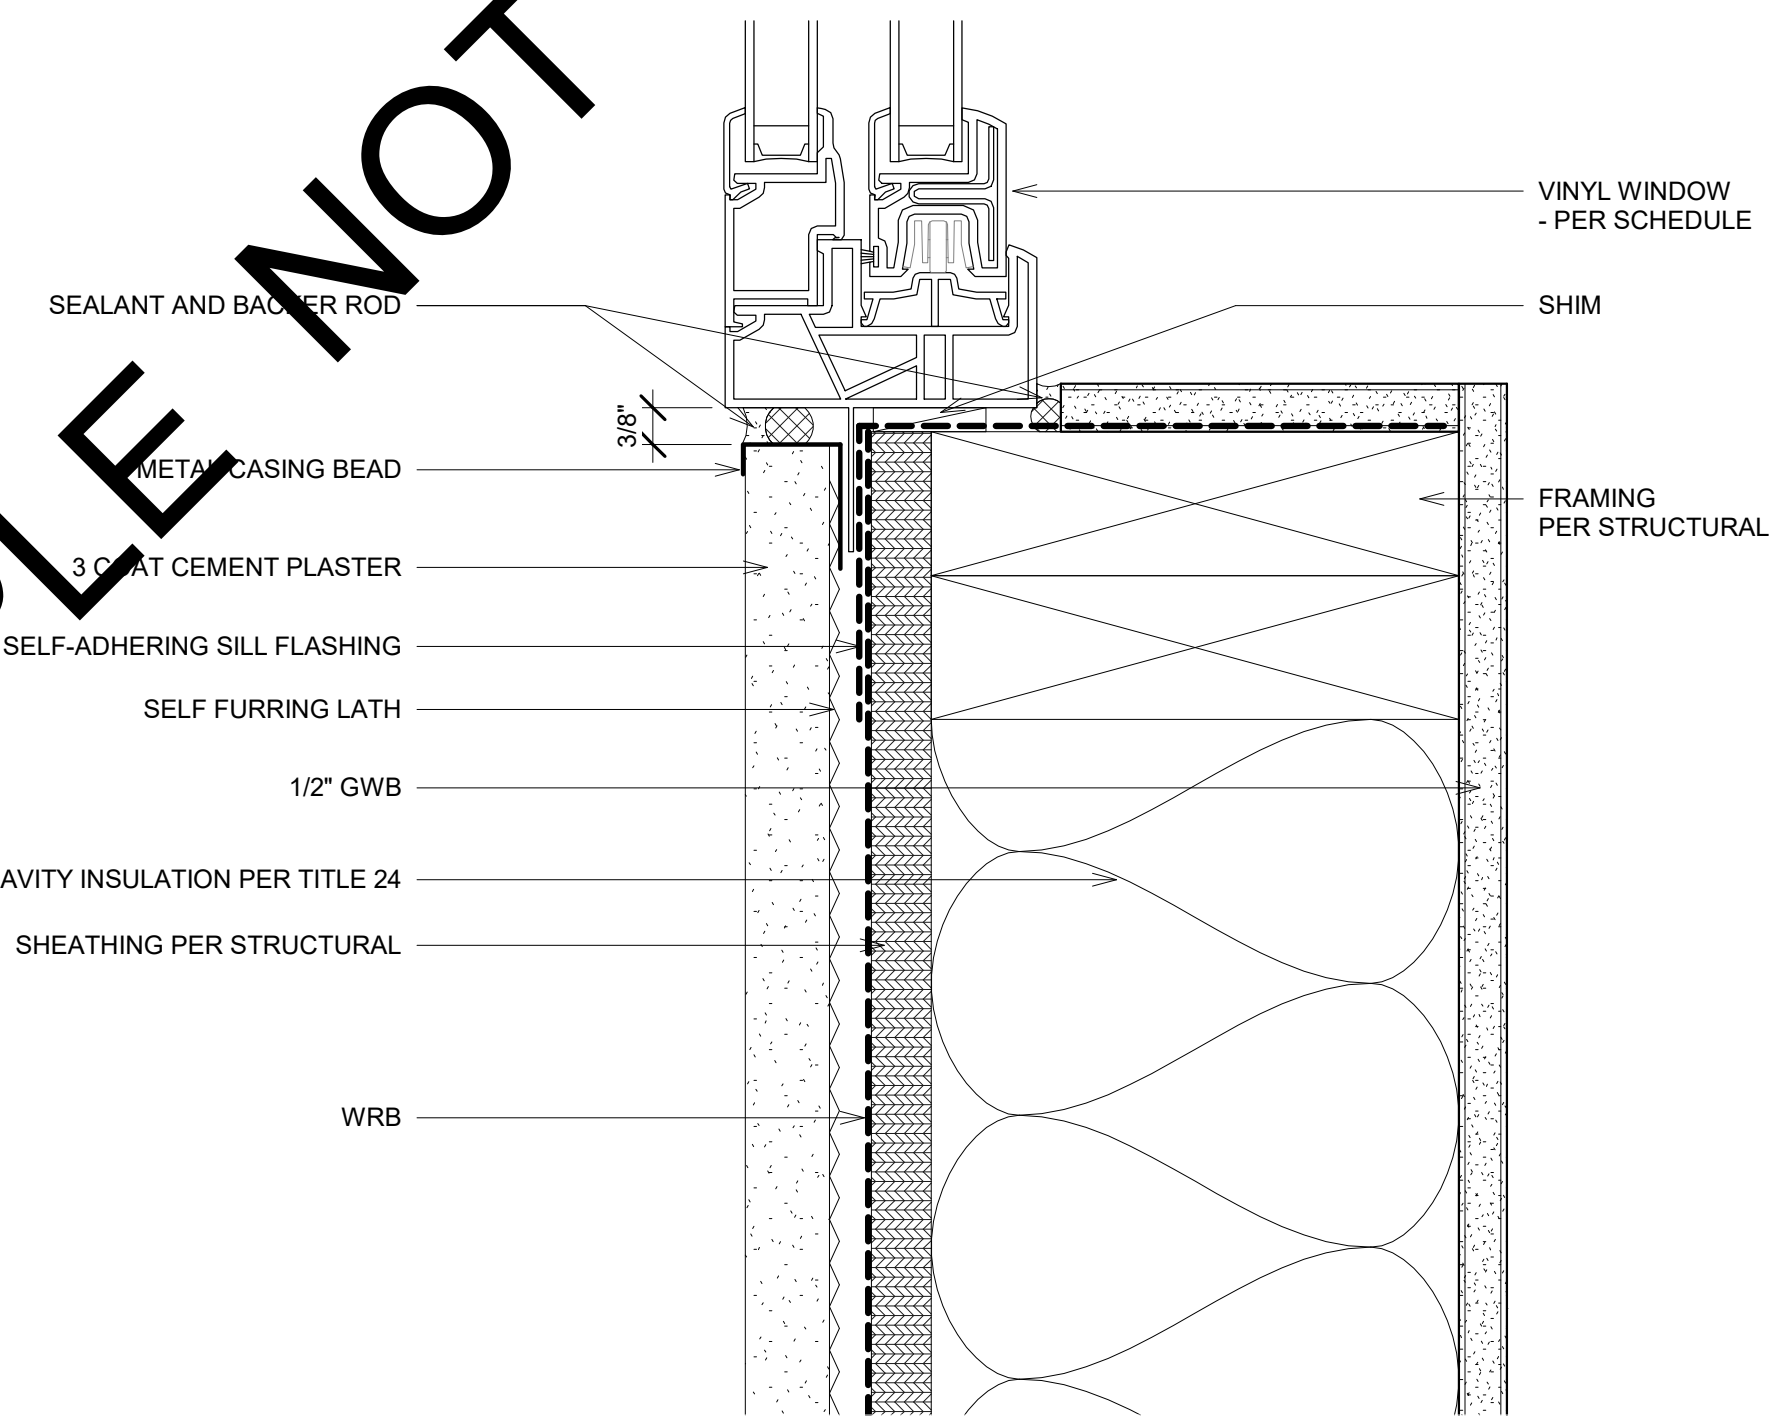


4 STUCCO @ VINYL WINDOW SILL
6" = 1'-0"

SAMPLE NOT FOR CONSTRUCTION

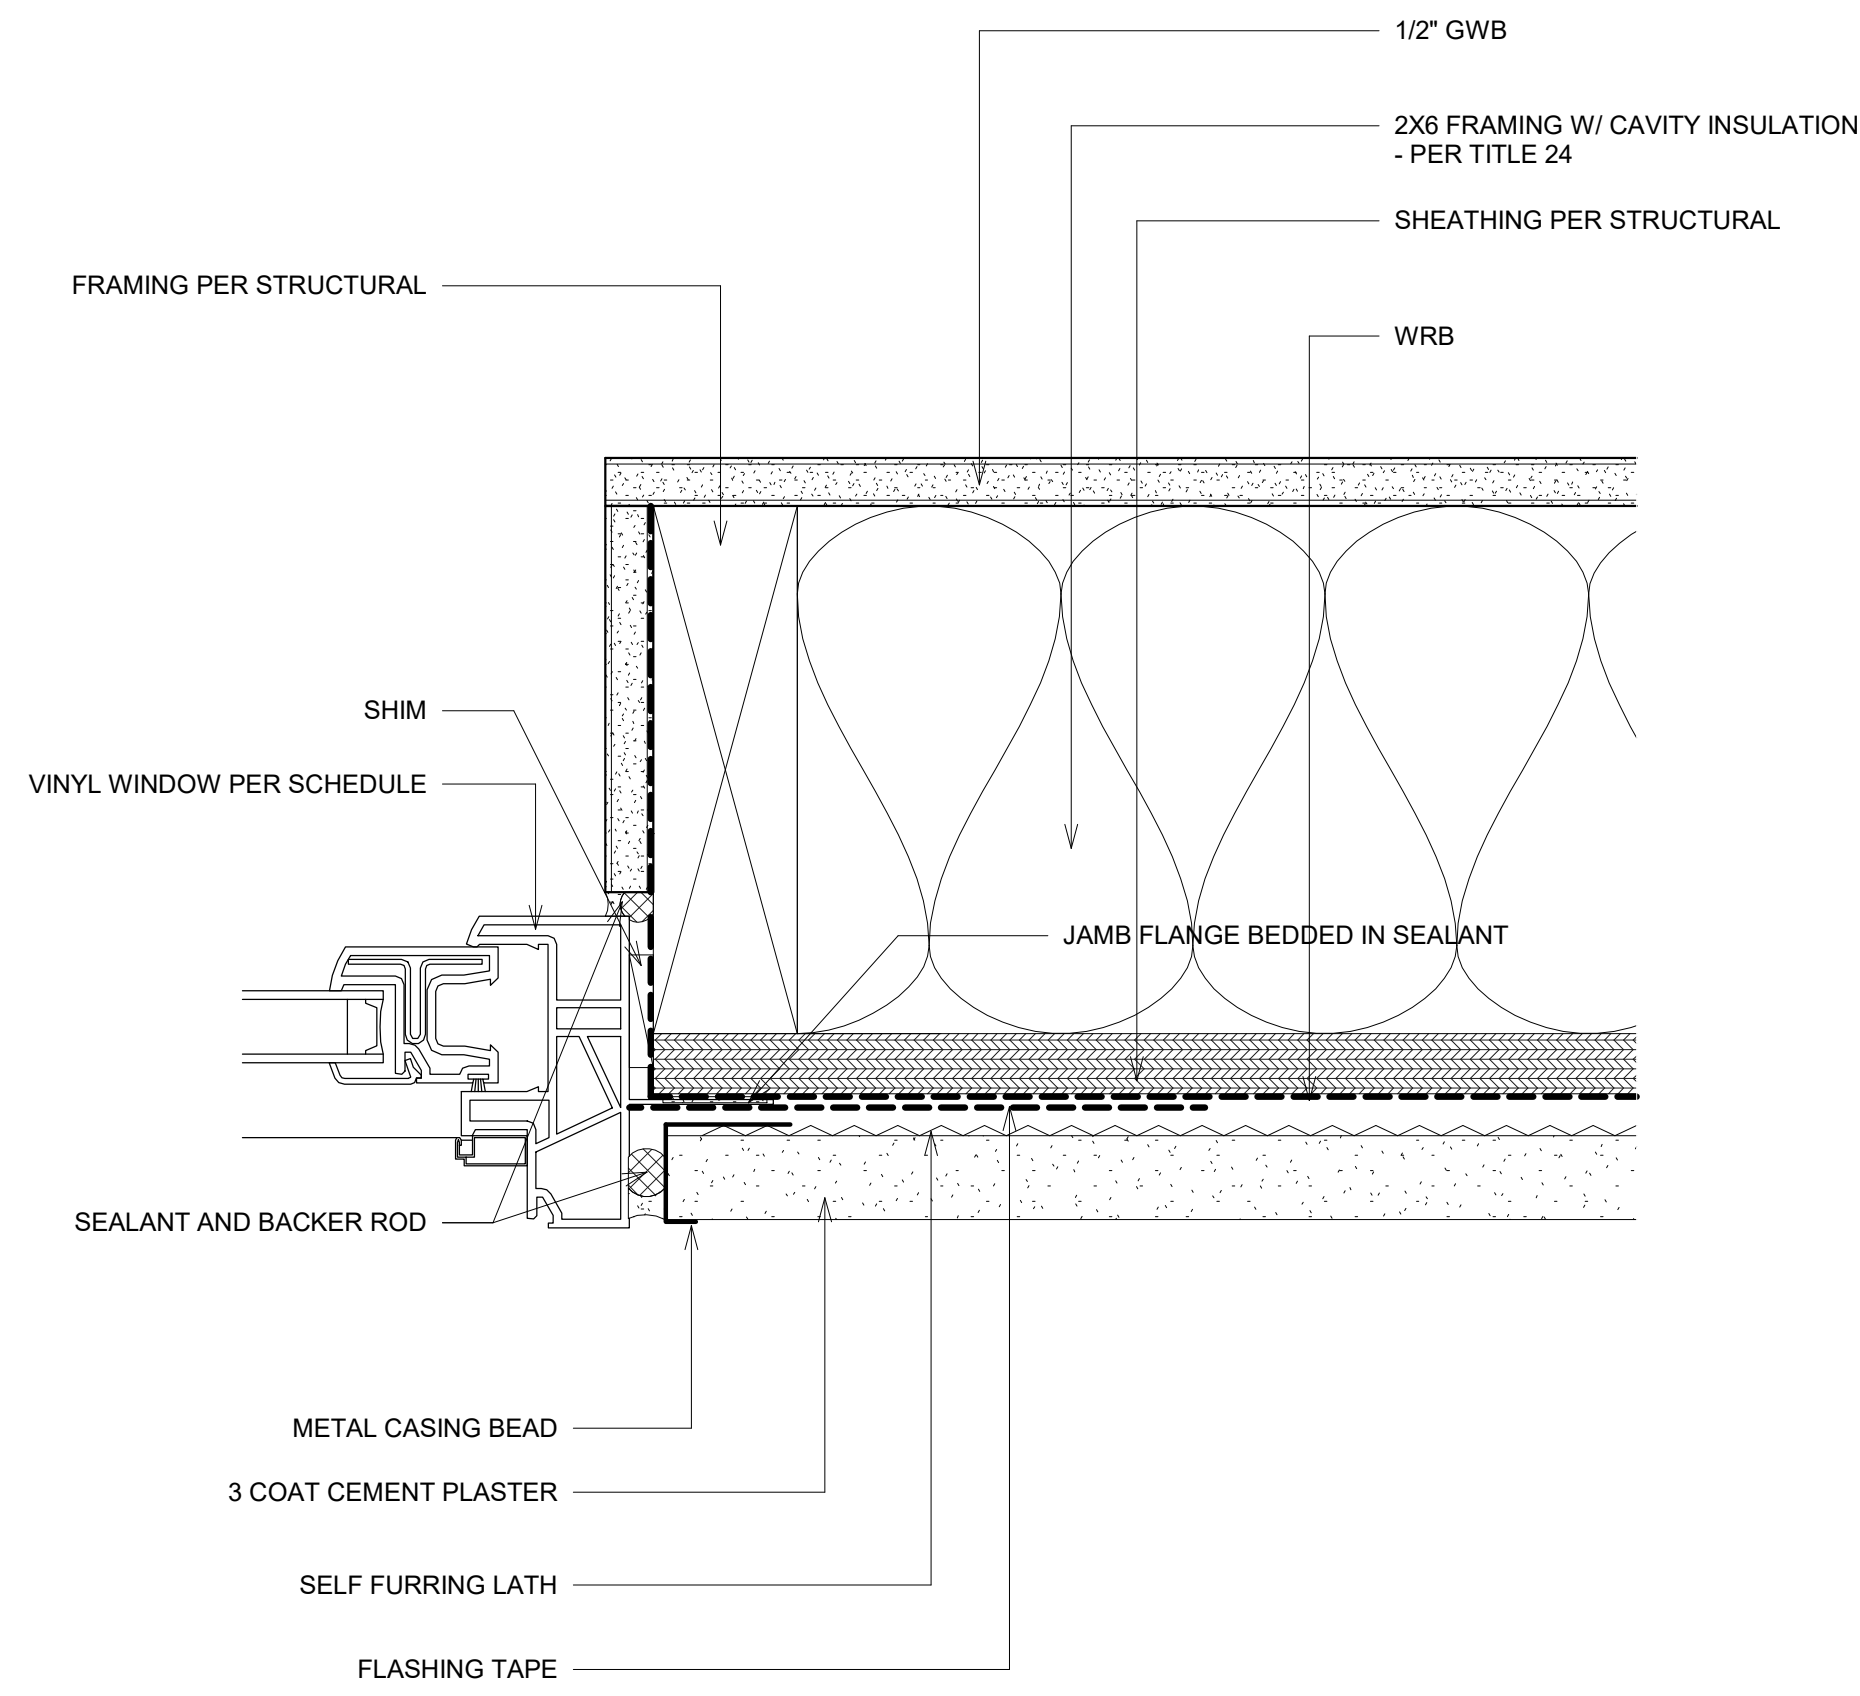

① STUCCO @ VINYL WINDOW JAMB
6" = 1'-0"

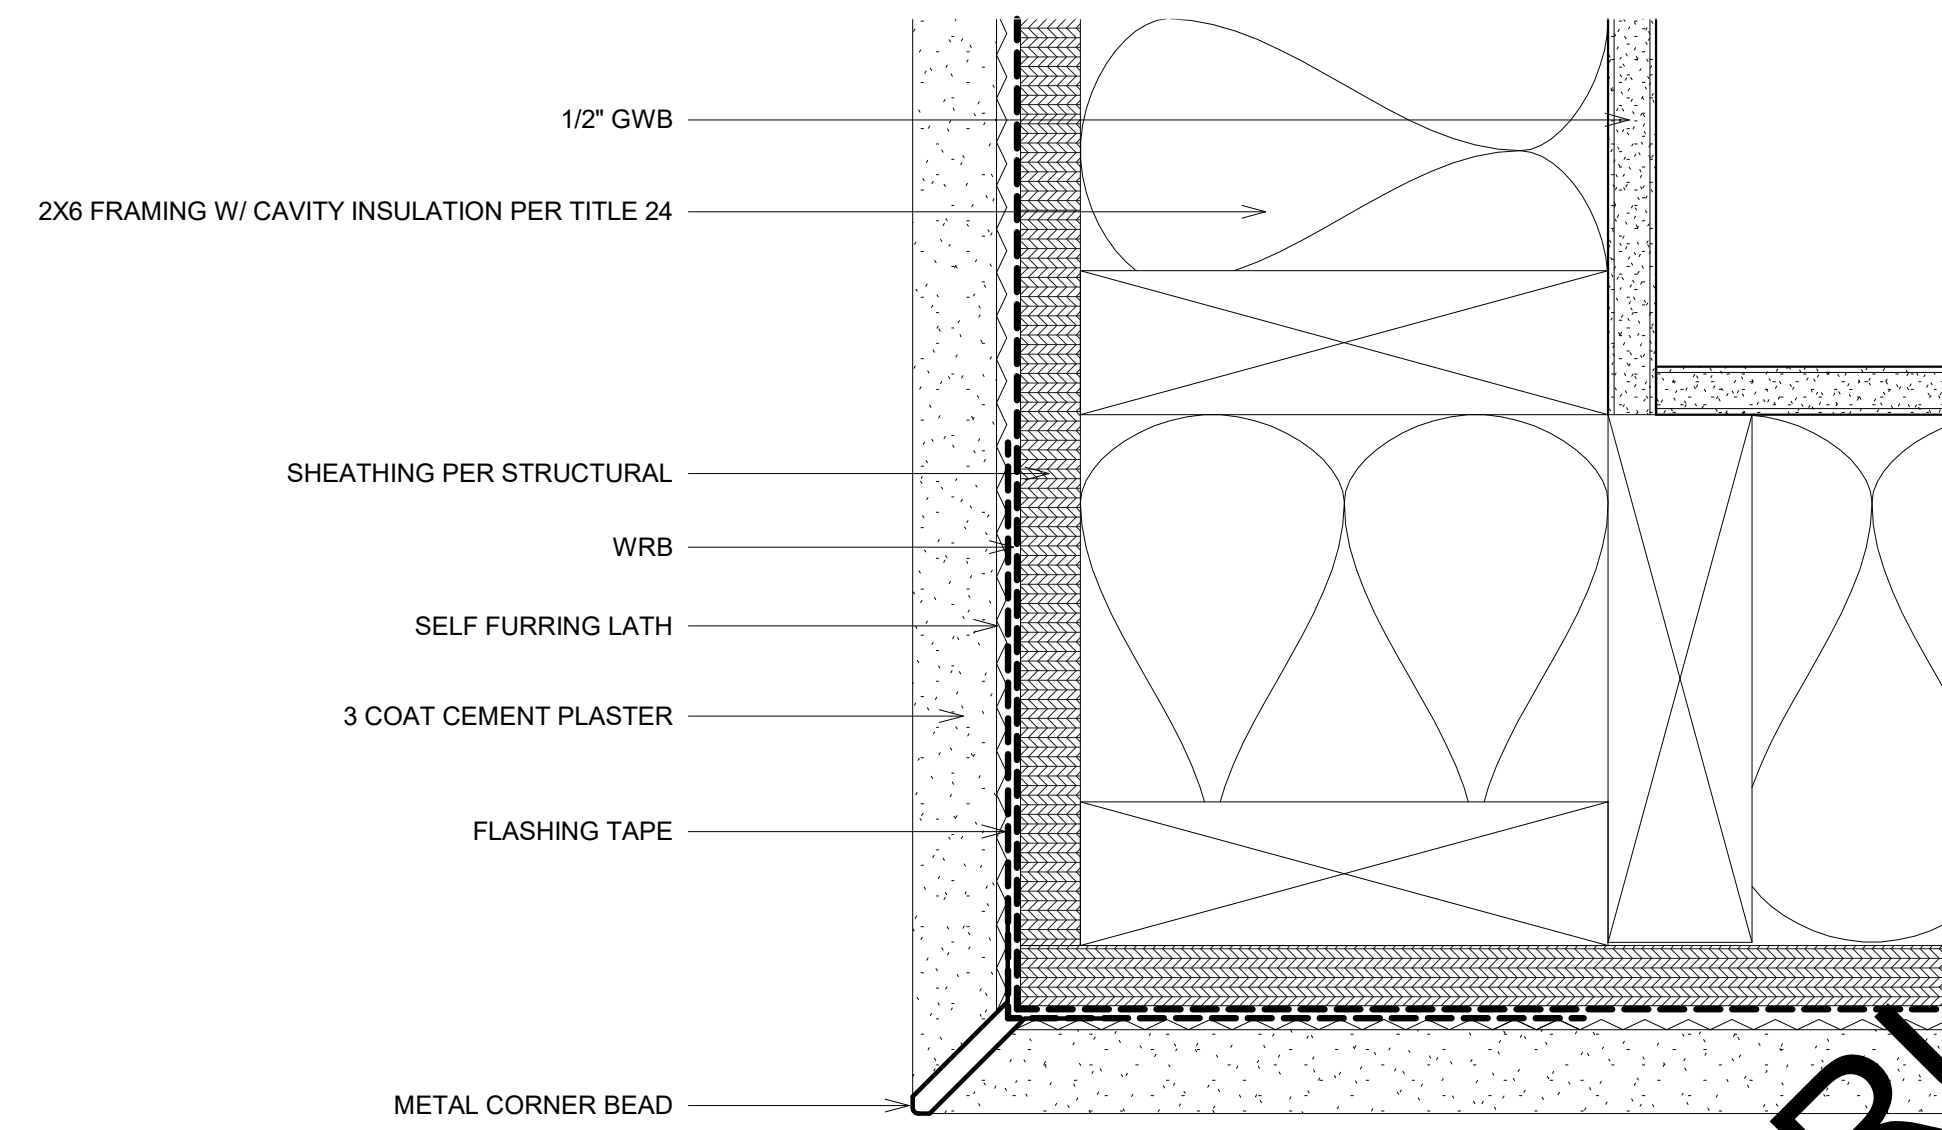


② STUCCO @ OUTSIDE CORNER
6" = 1'-0"

SAMPLE NOT FOR CONSTRUCTION


No.	Date	Description

Sheet Name:
STUCCO PLAN
DETAILS


Scale:
6" = 1'-0"
Date:
MAR 2024
Drawn By:
IS
Approved By:
LM
Sheet Number:

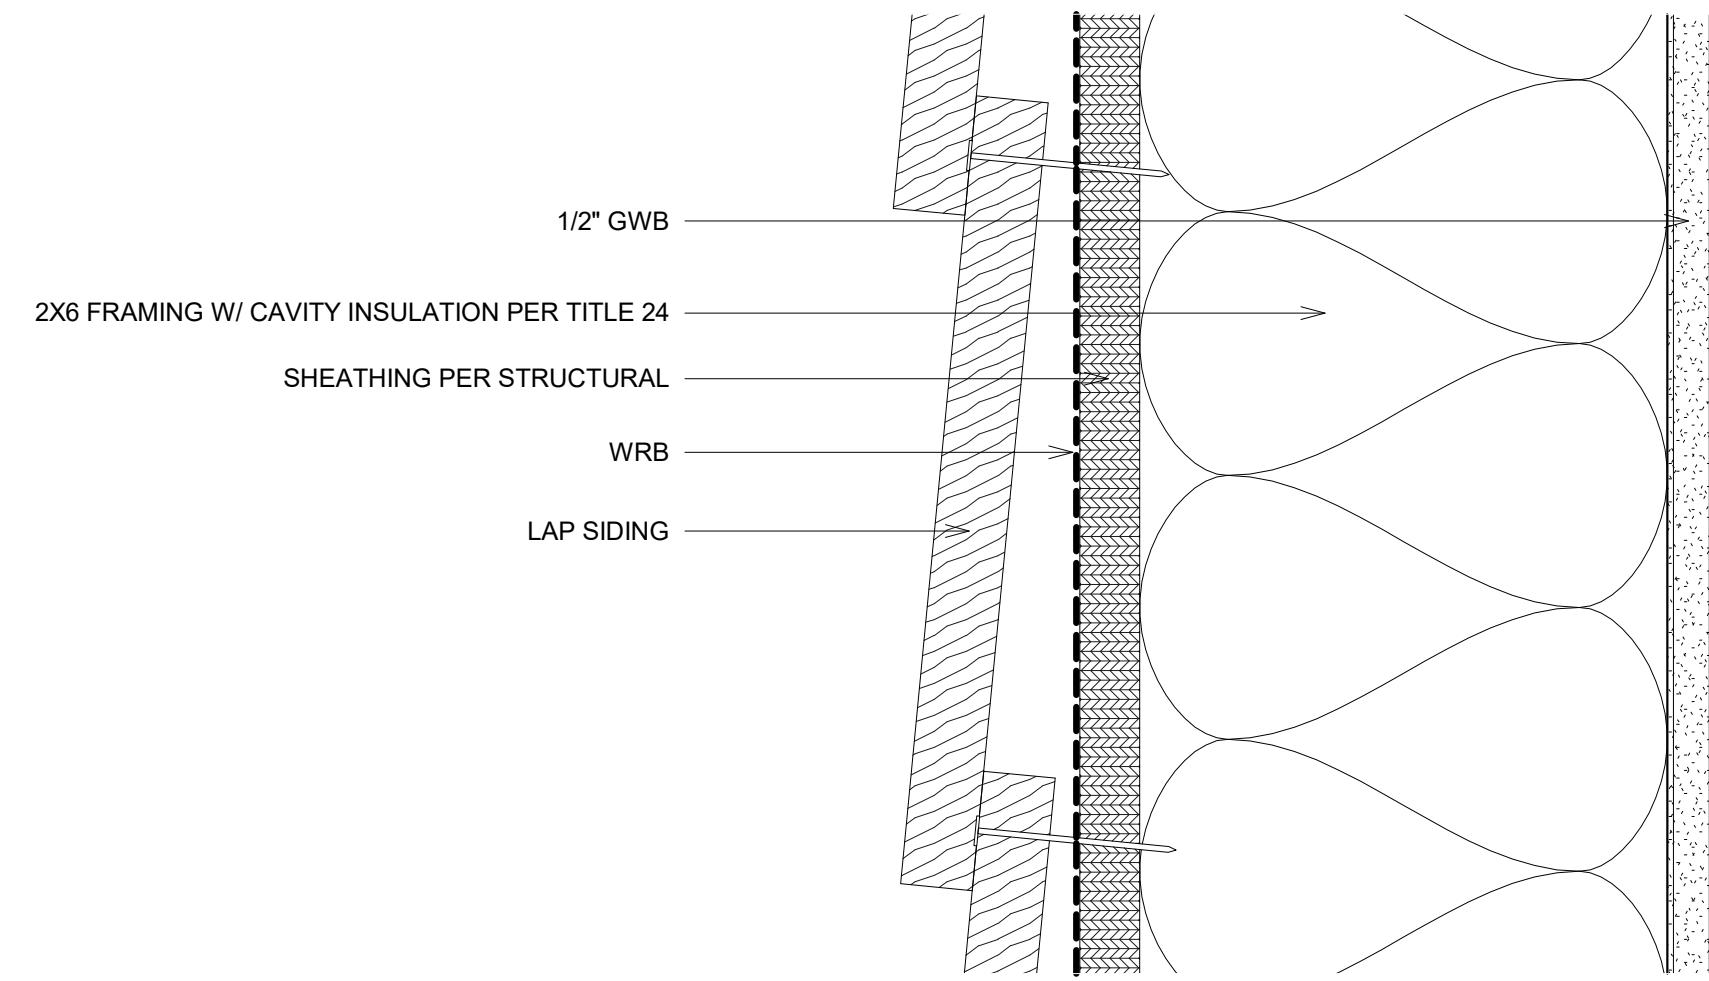


① LAP SIDING WALL SECTION
6" = 1'-0"

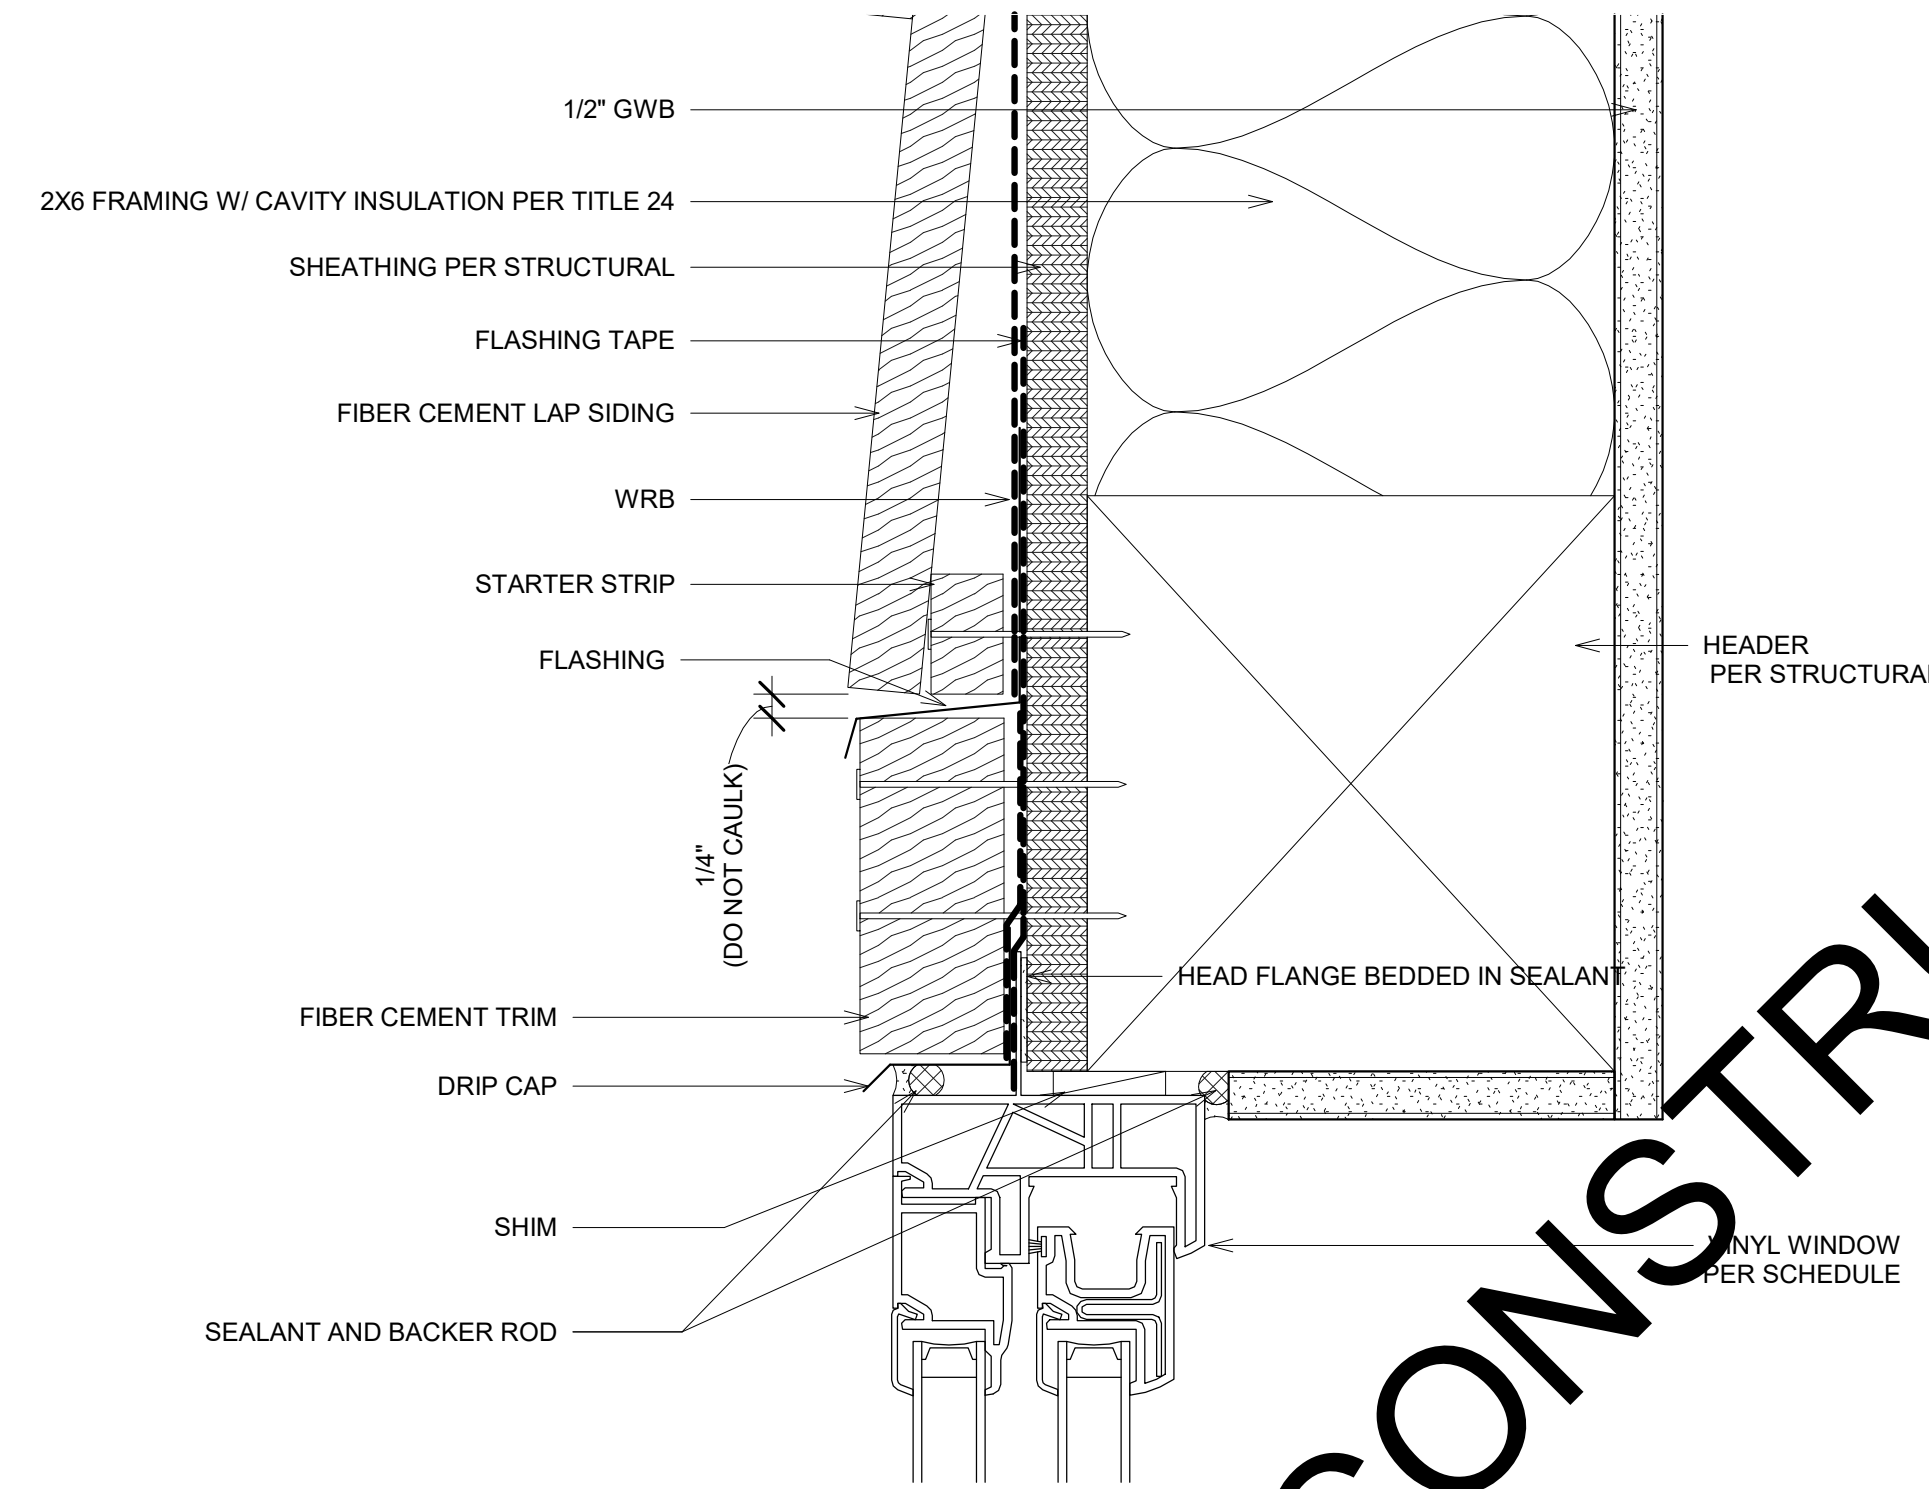

③ LAP SIDING @ VINYL WINDOW HEAD
6" = 1'-0"

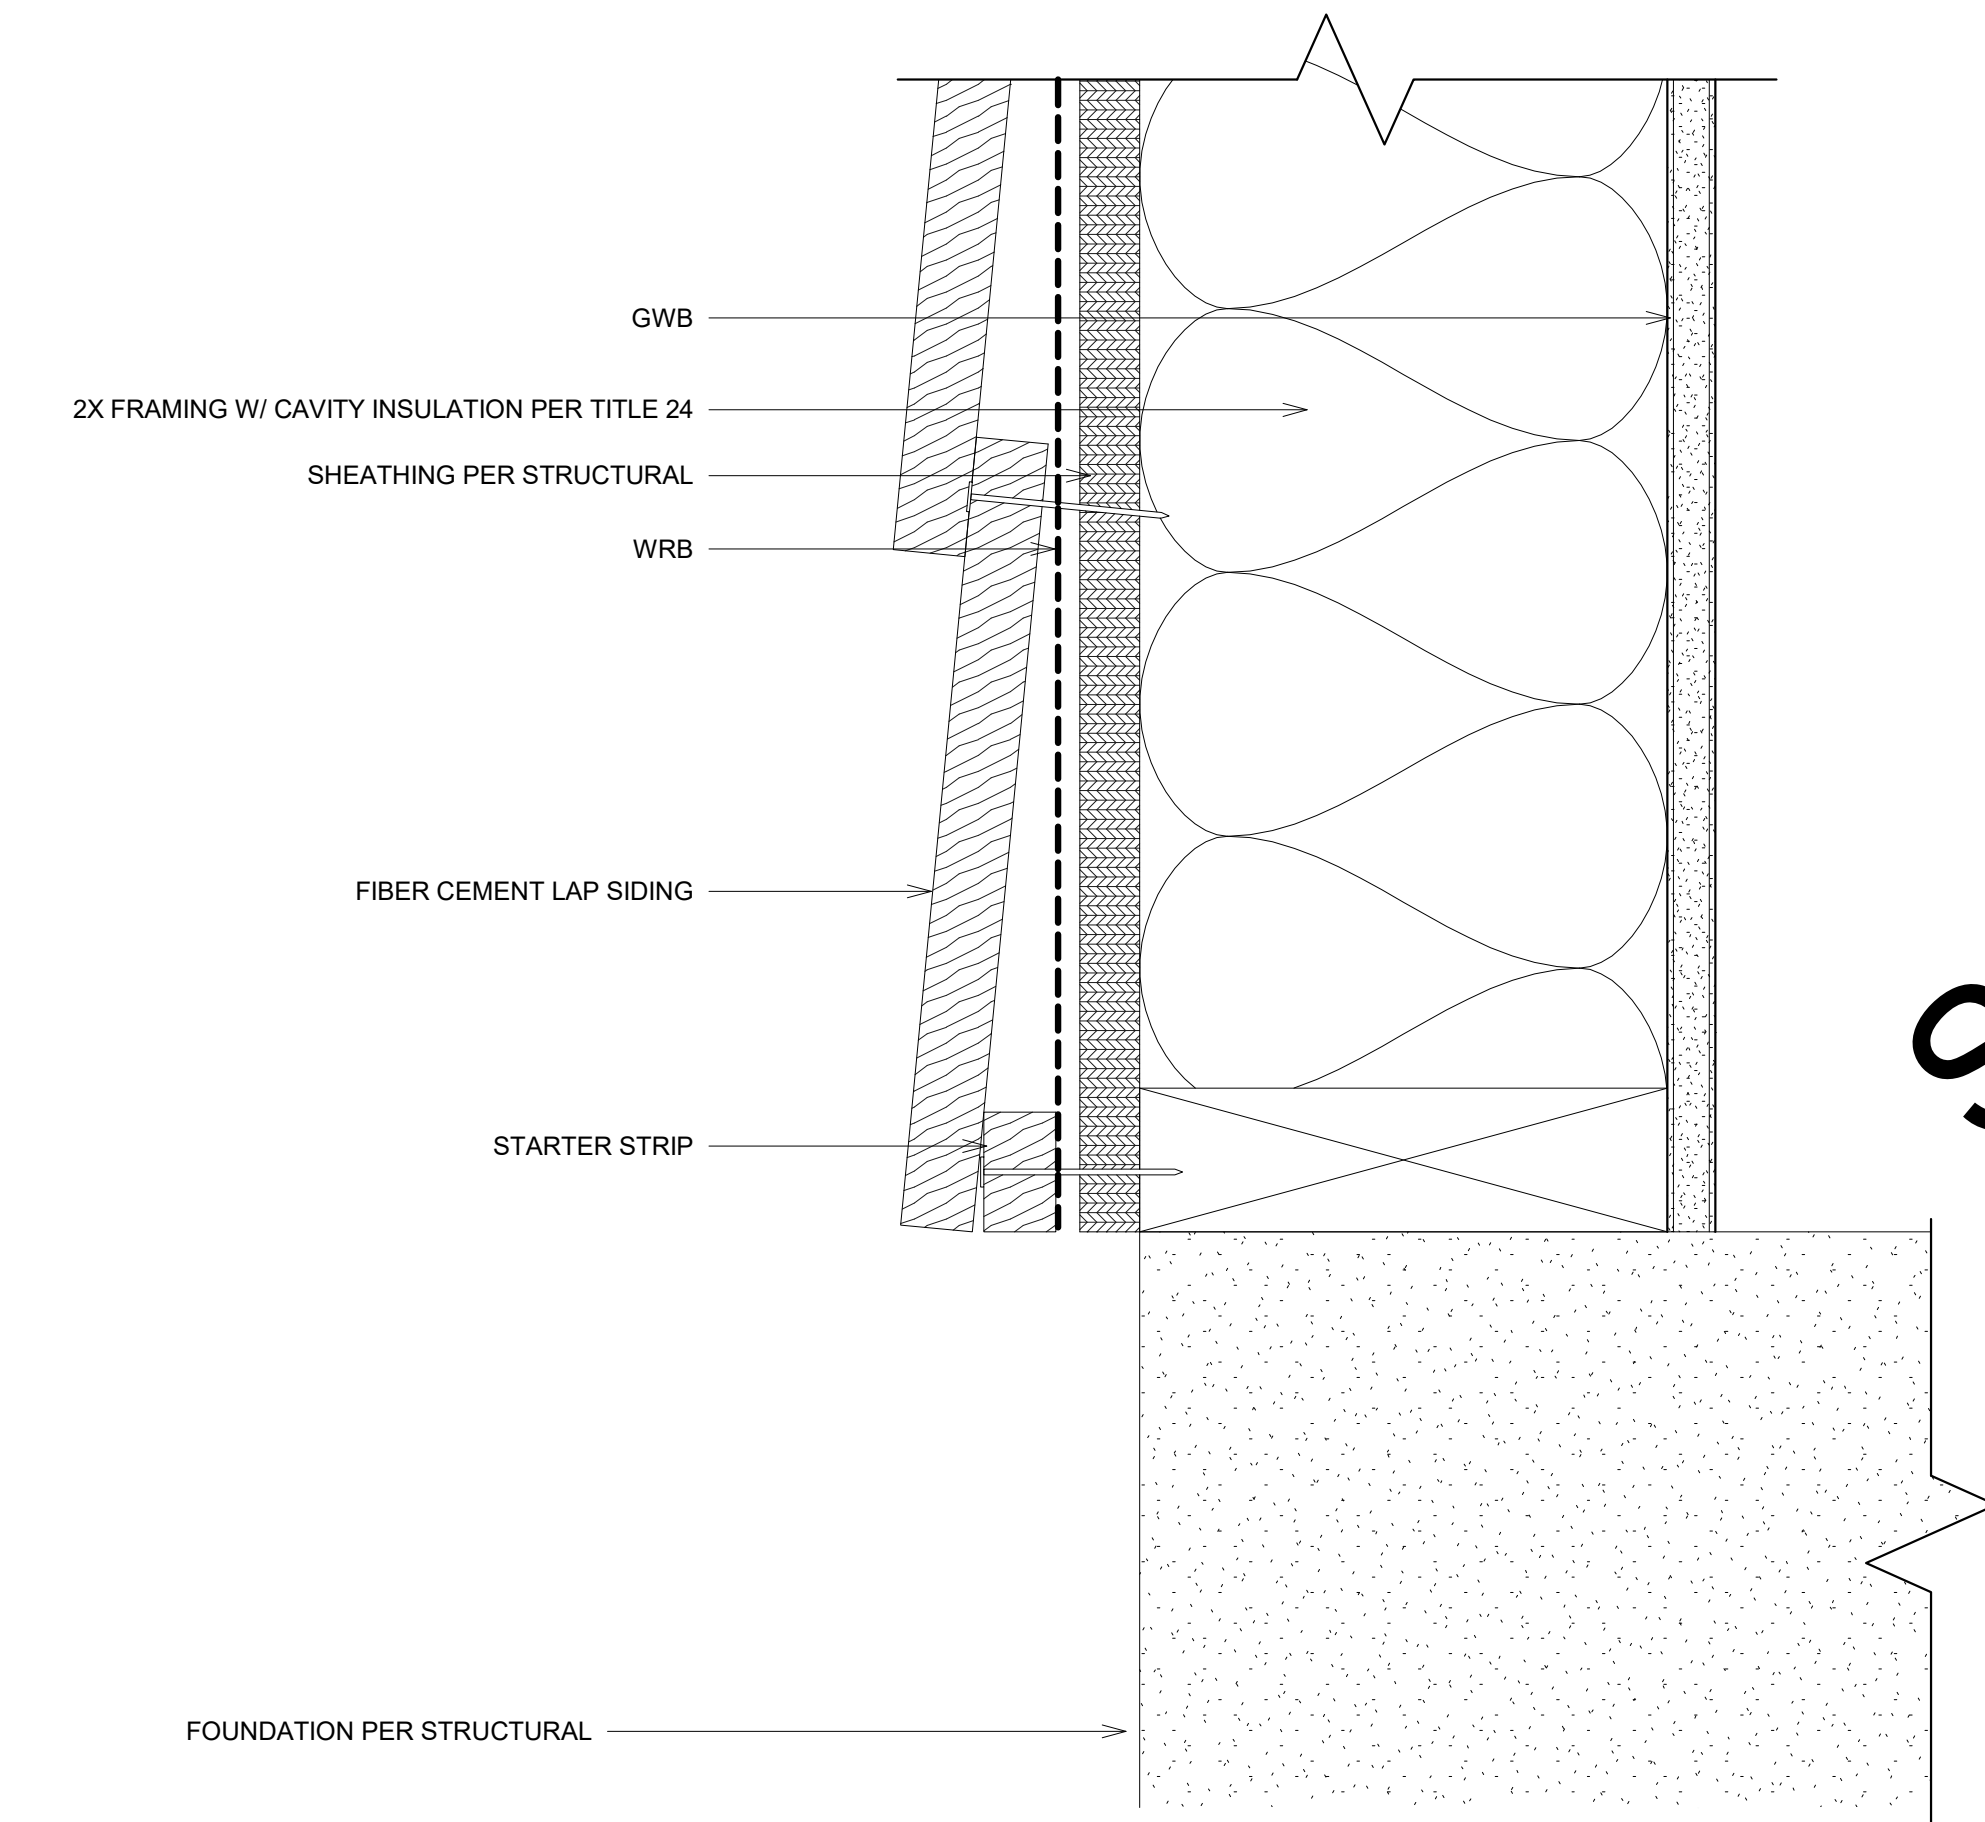

② LAP SIDING @ WALL BASE
6" = 1'-0"

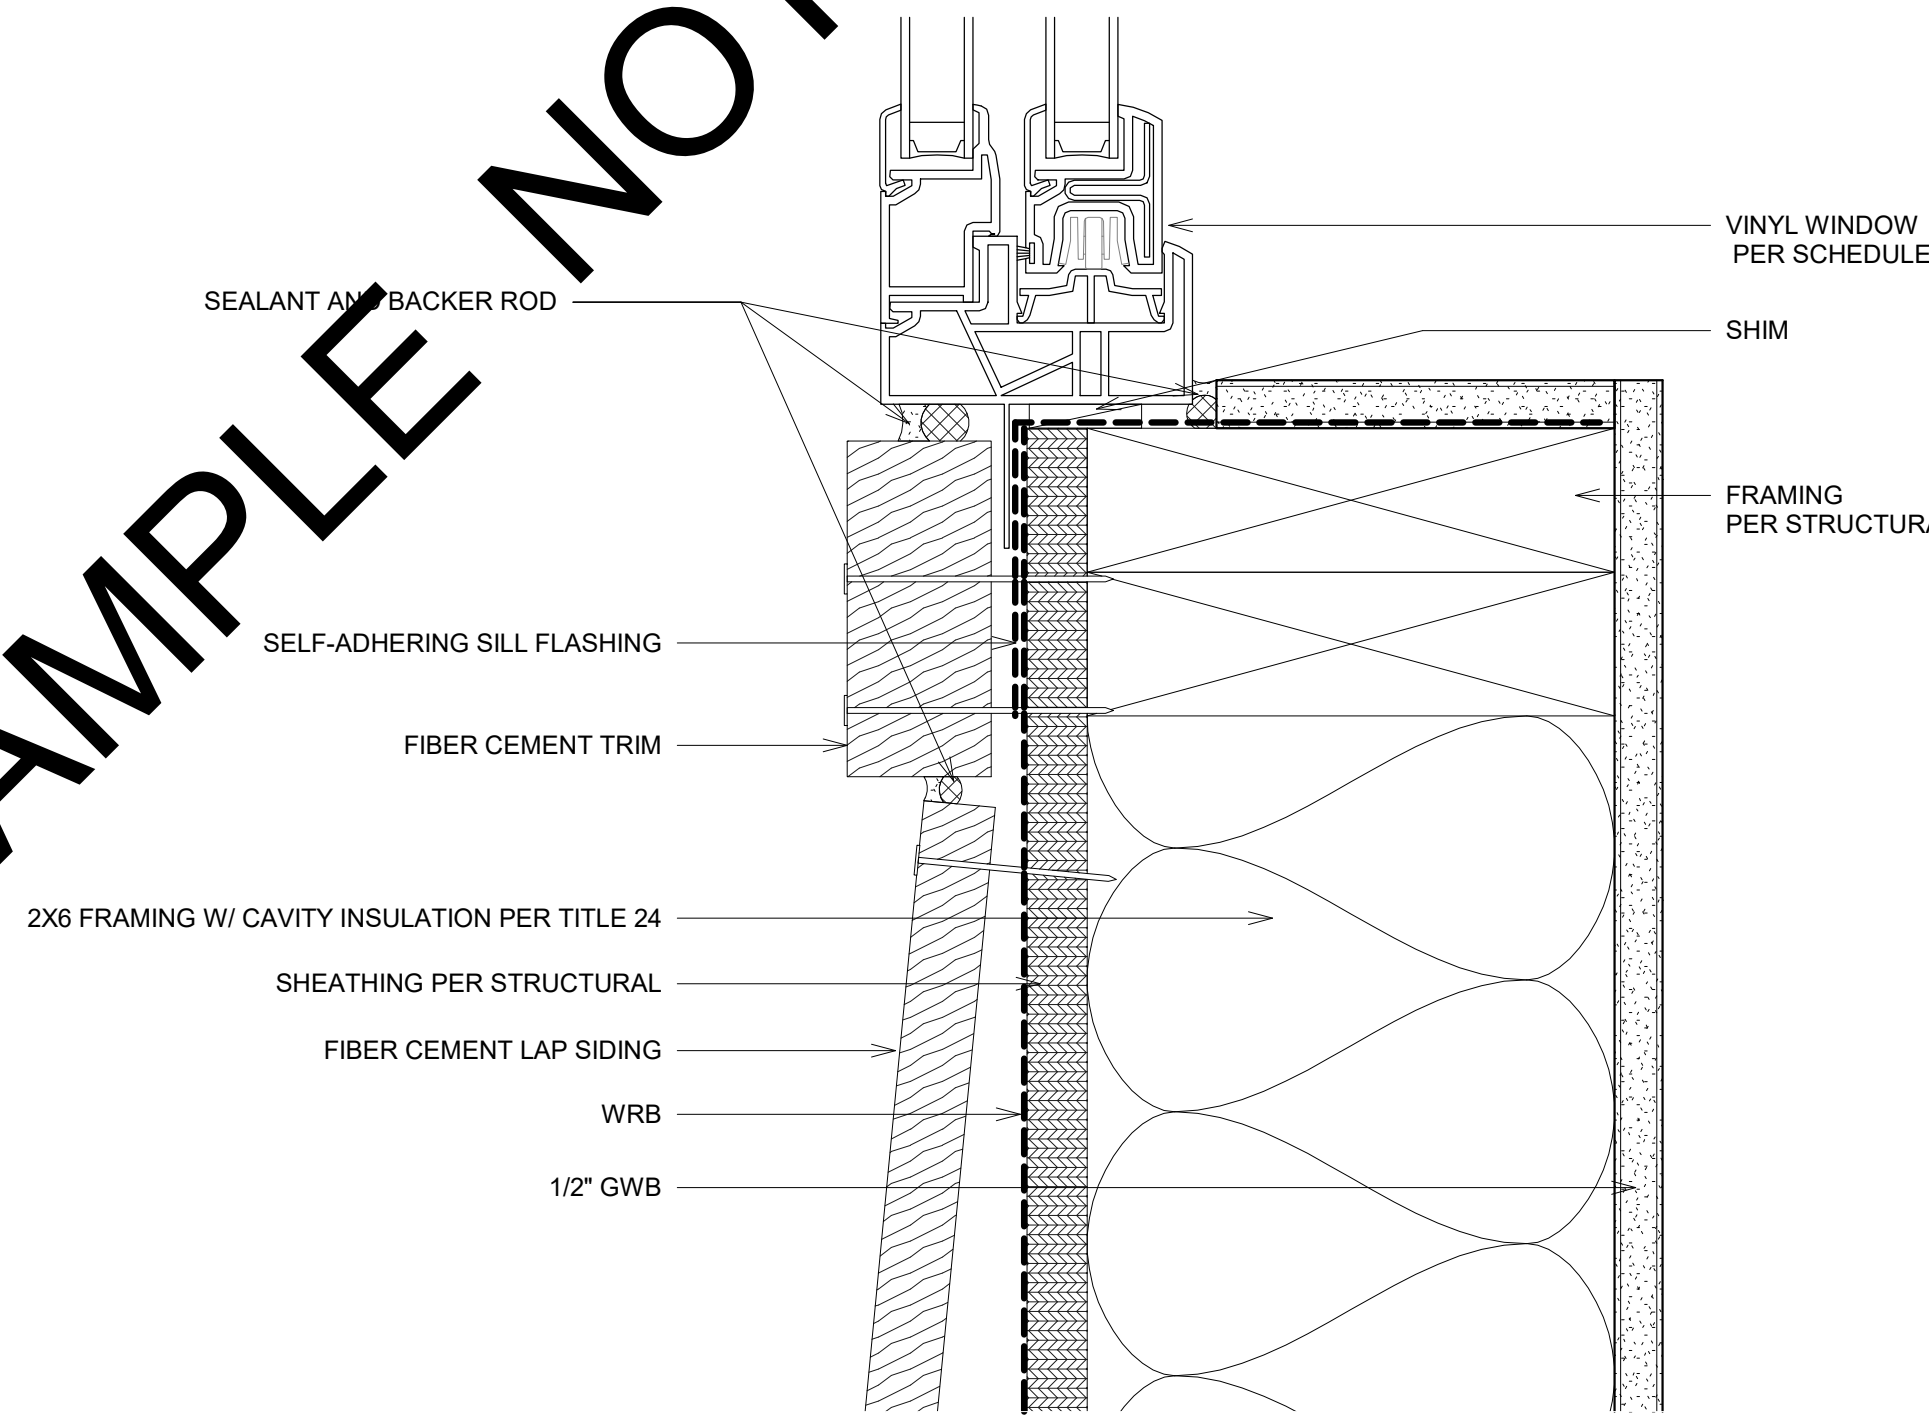

④ LAP SIDING @ VINYL WINDOW SILL
6" = 1'-0"

LAP SIDING NOTES:


- FIBER-CEMENT LAP SIDING HAVING A MAXIMUM WIDTH OF 12 INCHES SHALL COMPLY WITH THE REQUIREMENTS OF ASTM C1186, TYPE A, MINIMUM GRADE II OR ISO 8336, CATEGORY A, MINIMUM CLASS 2. LAP SIDING SHALL BE LAPPED A MINIMUM OF 1 1/4 INCHES (32 MM) AND LAP SIDING NOT HAVING TONGUE AND-GROOVE END JOINTS SHALL HAVE THE ENDS PROTECTED WITH CAULKING, COVERED WITH AN H-SECTION JOINT COVER, LOCATED OVER A STRIP OF FLASHING, OR SHALL BE DESIGNED TO COMPLY WITH SECTION R703.1. LAP SIDING COURSES SHALL BE INSTALLED WITH THE FASTENER HEADS EXPOSED OR CONCEALED, IN ACCORDANCE WITH TABLE R703.3(1) OR APPROVED MANUFACTURER'S INSTRUCTIONS.

SAMPLE NOT FOR CONSTRUCTION


No.	Date	Description

Sheet Name:
 LAP SIDING SECTION DETAILS
 Scale:
 6" = 1'-0"
 Date:
 MAR 2024
 Drawn By:
 IS
 Approved By:
 LM
 Sheet Number:

SAMPLE NOT FOR CONSTRUCTION

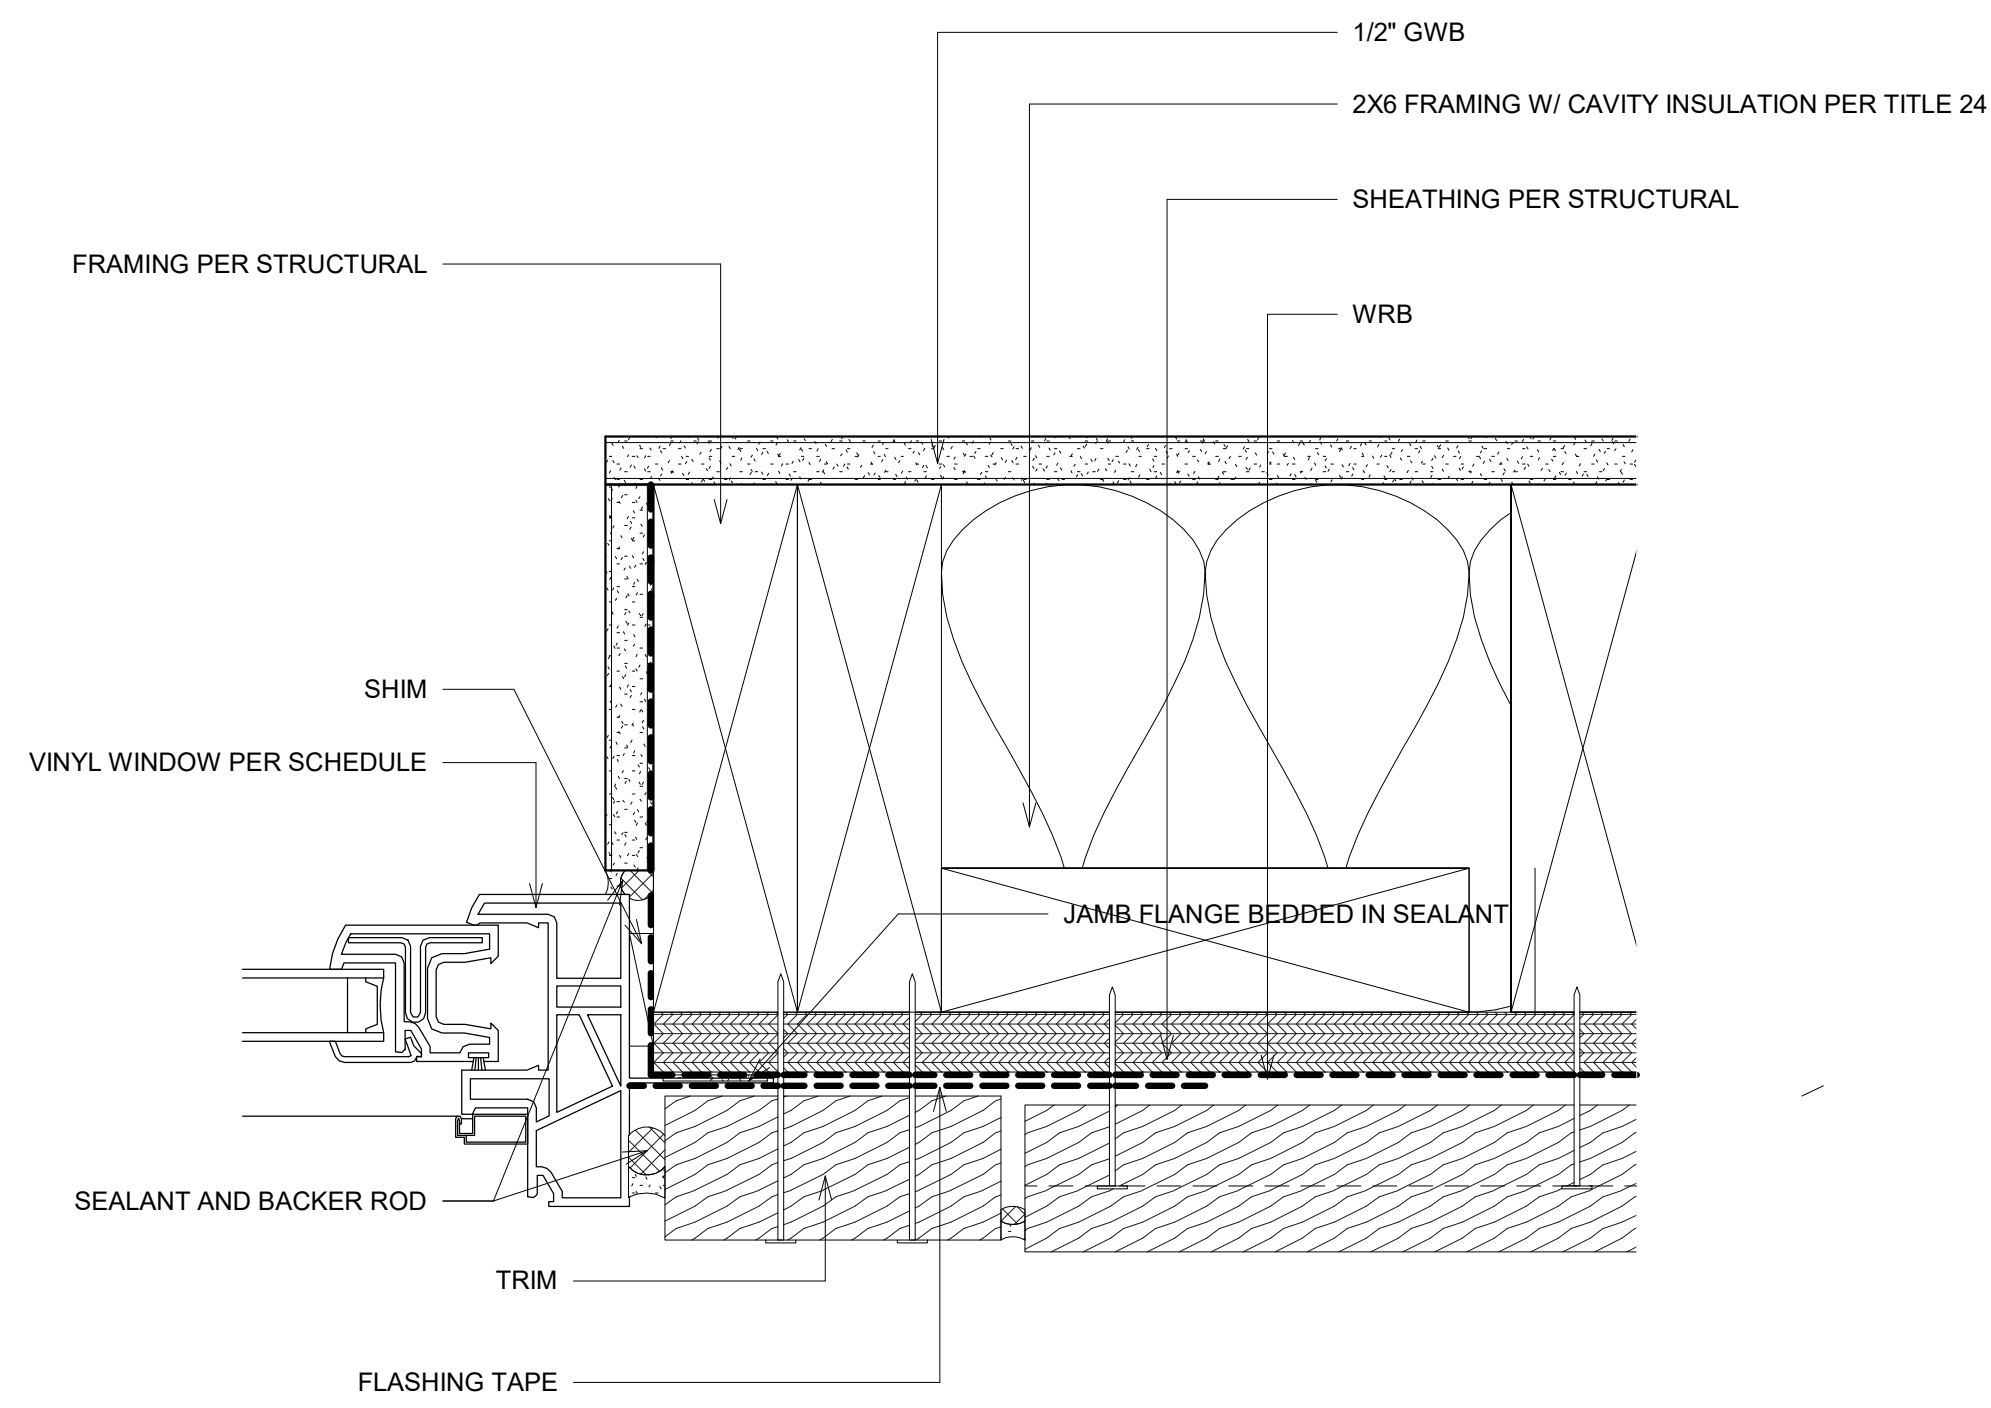

① LAP SIDING @ VINYL WINDOW JAMB
6" = 1'-0"

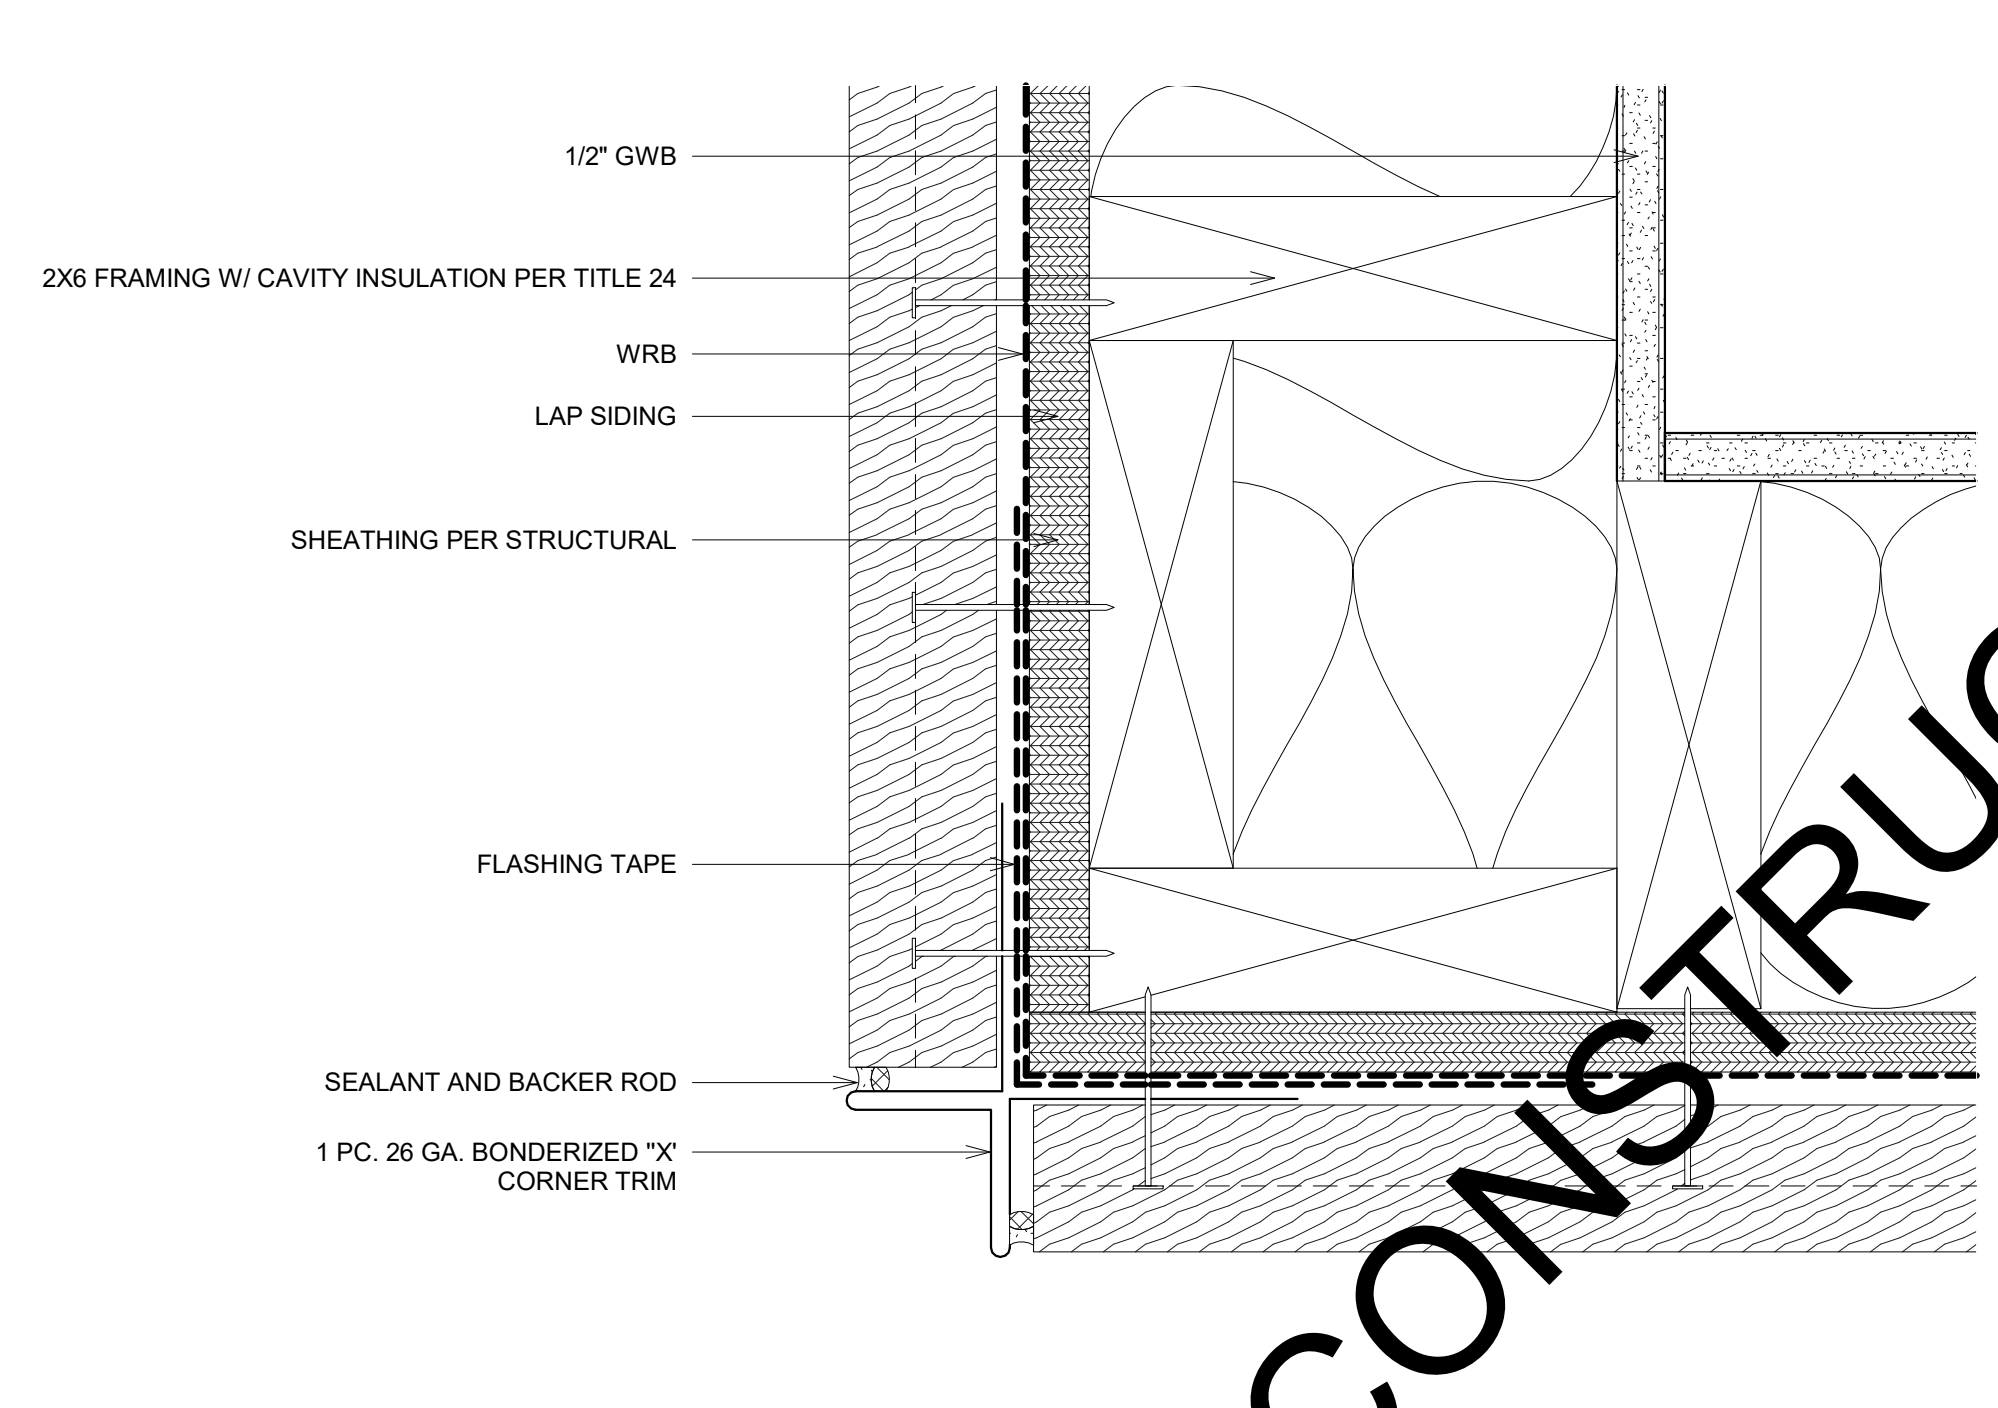

② LAP SIDING @ OUTSIDE CORNER
6" = 1'-0"

No.	Date	Description

Sheet Name:
LAP SIDING
PLAN DETAILS

Scale:
6" = 1'-0"

Date:
MAR 2024

Drawn By:
IS


Approved By:
LM

Sheet Number:


NOTE: DEVIATIONS FROM THE SHOWN MINIMUM REQUIRED FIRE SEPARATION DISTANCES WILL REQUIRE APPLICANT TO PROVIDE/SHOW THE ASSUMED PROPERTY LINE BETWEEN THE PRIMARY DWELLING AND PROPOSED A.D.U. AND TO COMPLY WITH THE FIRE SEPARATION REQUIREMENTS OF CRC 2022 TABLES R302.1(1) AND R302.1(2) FOR THE WALLS, PROJECTIONS, ETC.

FIREBLOCKING NOTES (IF REQUIRED):


- FIREBLOCKING SHALL BE PROVIDED IN WOOD-FRAMED CONSTRUCTION IN THE FOLLOWING LOCATIONS:
 - IN CONCEALED SPACES OF STUD WALLS AND PARTITIONS, INCLUDING FURRED SPACES AND PARALLEL ROWS OF STUDS OR STAGGERED STUDS, AS FOLLOWS:
 1. VERTICALLY AT THE CEILING AND FLOOR LEVELS.
 2. HORIZONTALLY AT INTERVALS NOT EXCEEDING 10 FEET (3048 MM).
 - AT INTERCONNECTIONS BETWEEN CONCEALED VERTICAL AND HORIZONTAL SPACES SUCH AS OCCUR AT SOFFITS, DROP CEILINGS AND COVE CEILINGS.
 - IN CONCEALED SPACES BETWEEN STAIR STRINGERS AT THE TOP AND BOTTOM OF THE RUN. ENCLOSED SPACES UNDER STAIRS SHALL COMPLY WITH SECTION R302.7.
 - AT OPENINGS AROUND VENTS, PIPES, DUCTS, CABLES AND WIRES AT CEILING AND FLOOR LEVEL, WITH AN APPROVED MATERIAL TO RESIST THE FREE PASSAGE OF FLAME AND PRODUCTS OF COMBUSTION.
- FIREBLOCKING MATERIALS SHALL COMPLY WITH R302.11.1

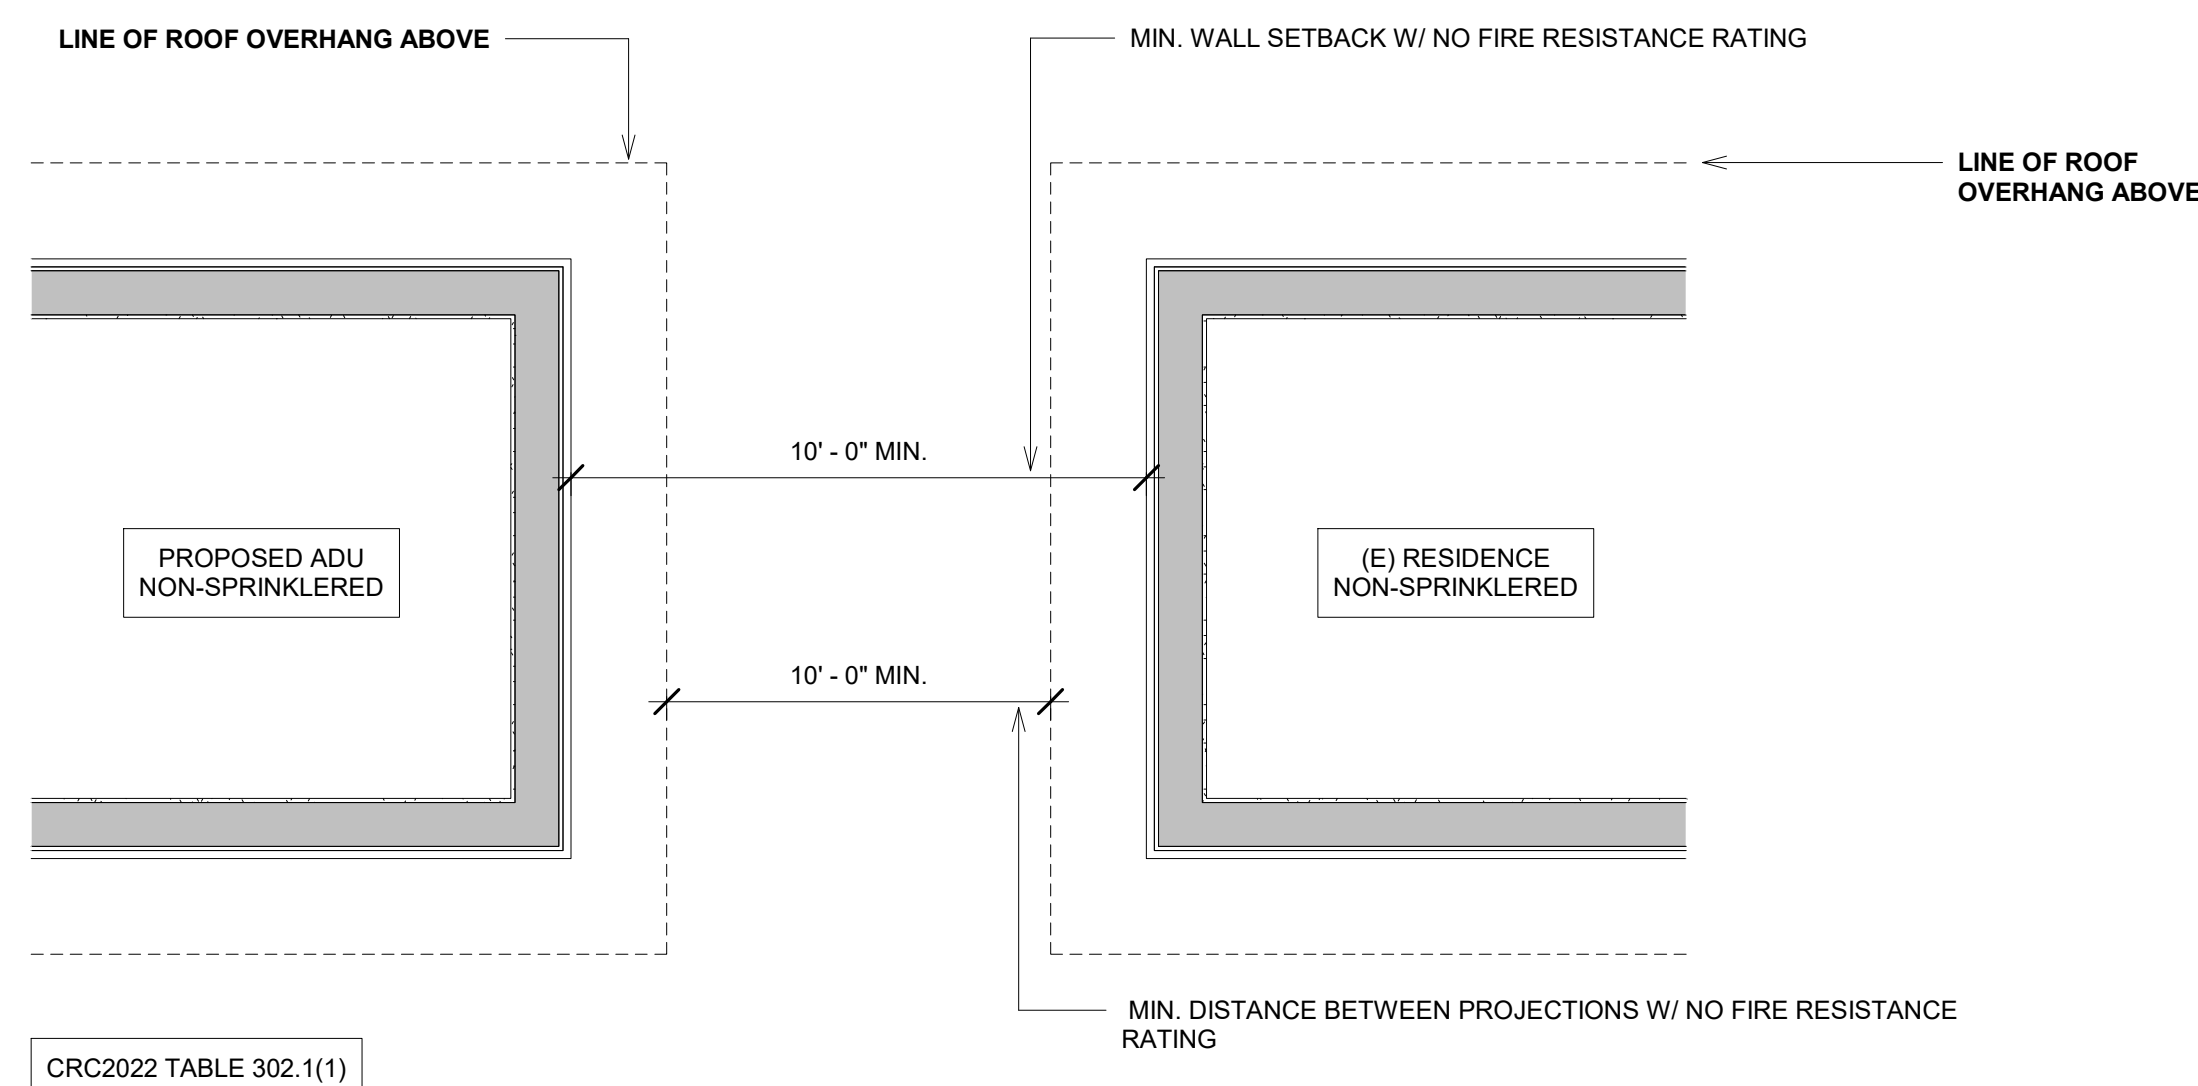

1 NON SPRINKLERED FIRE SEPARATION KEY
1/2" = 1'-0"

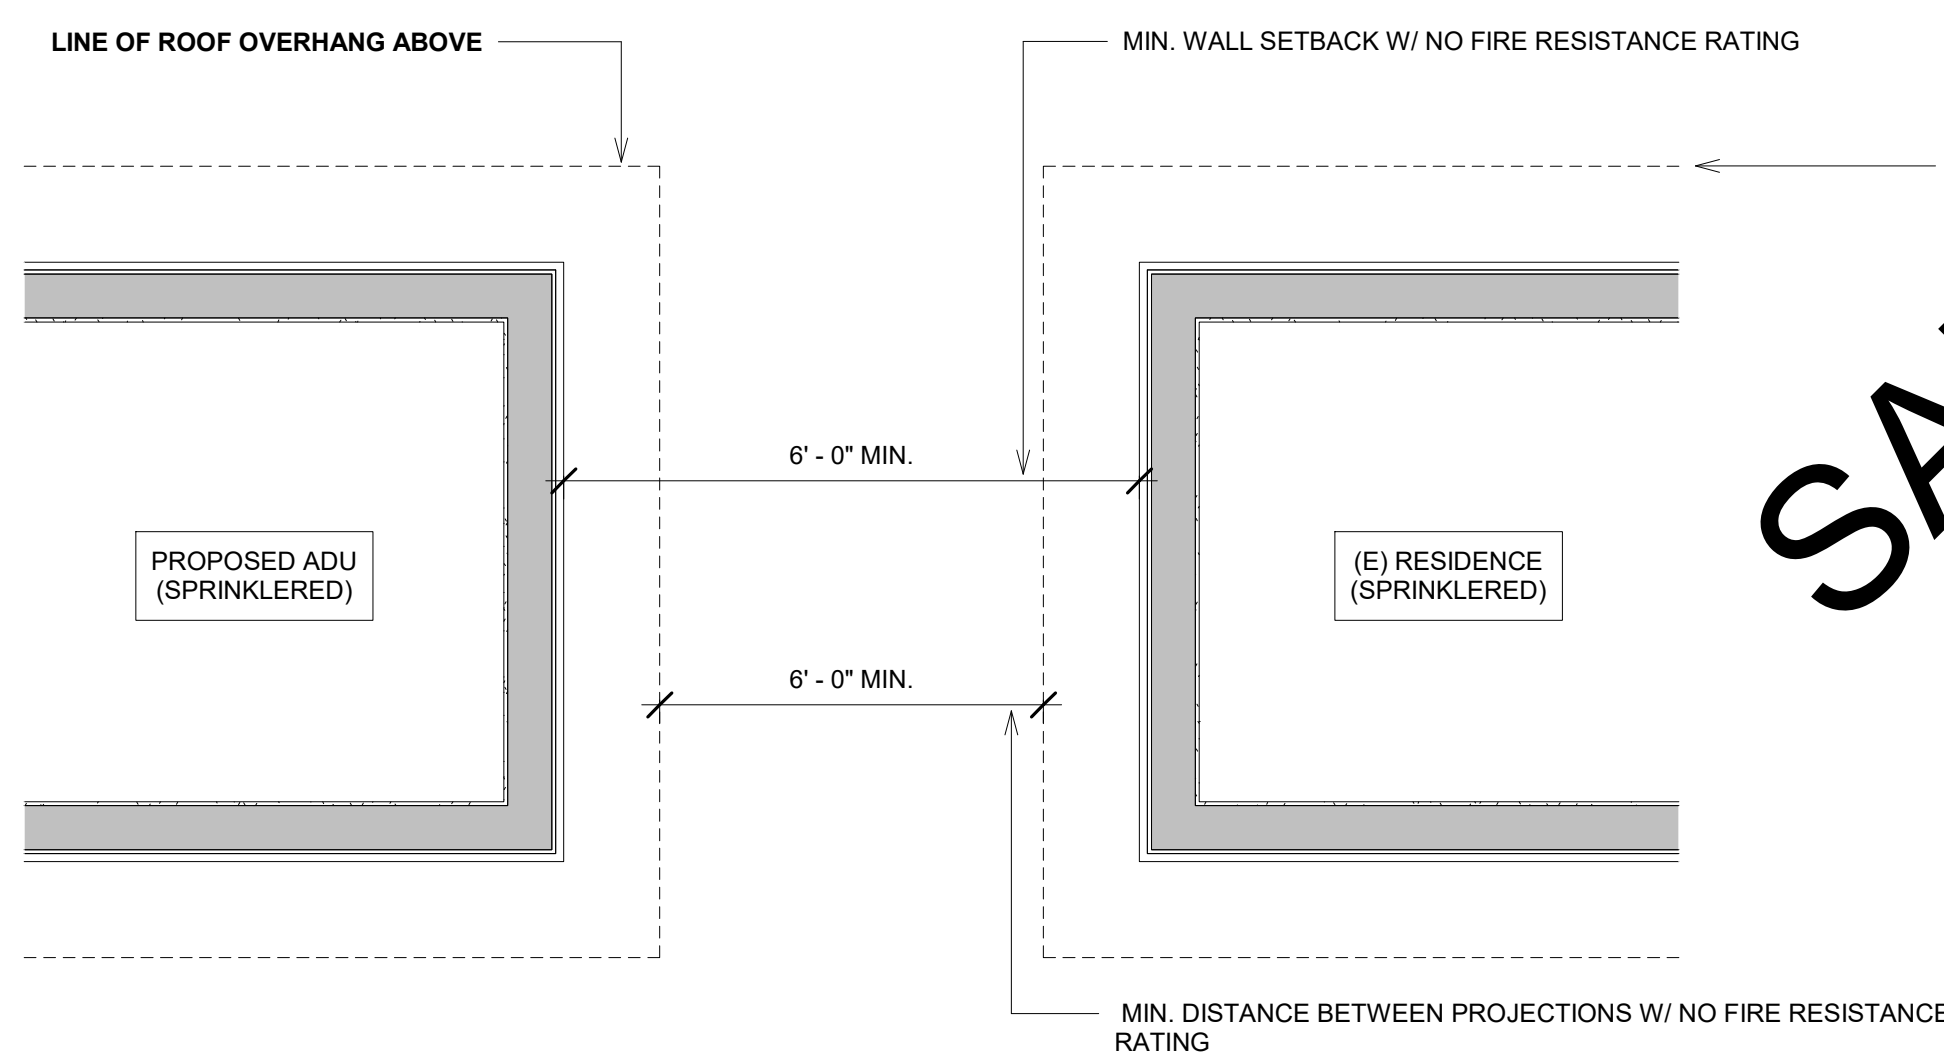


2 SPRINKLERED FIRE SEPARATION KEY
1/2" = 1'-0"

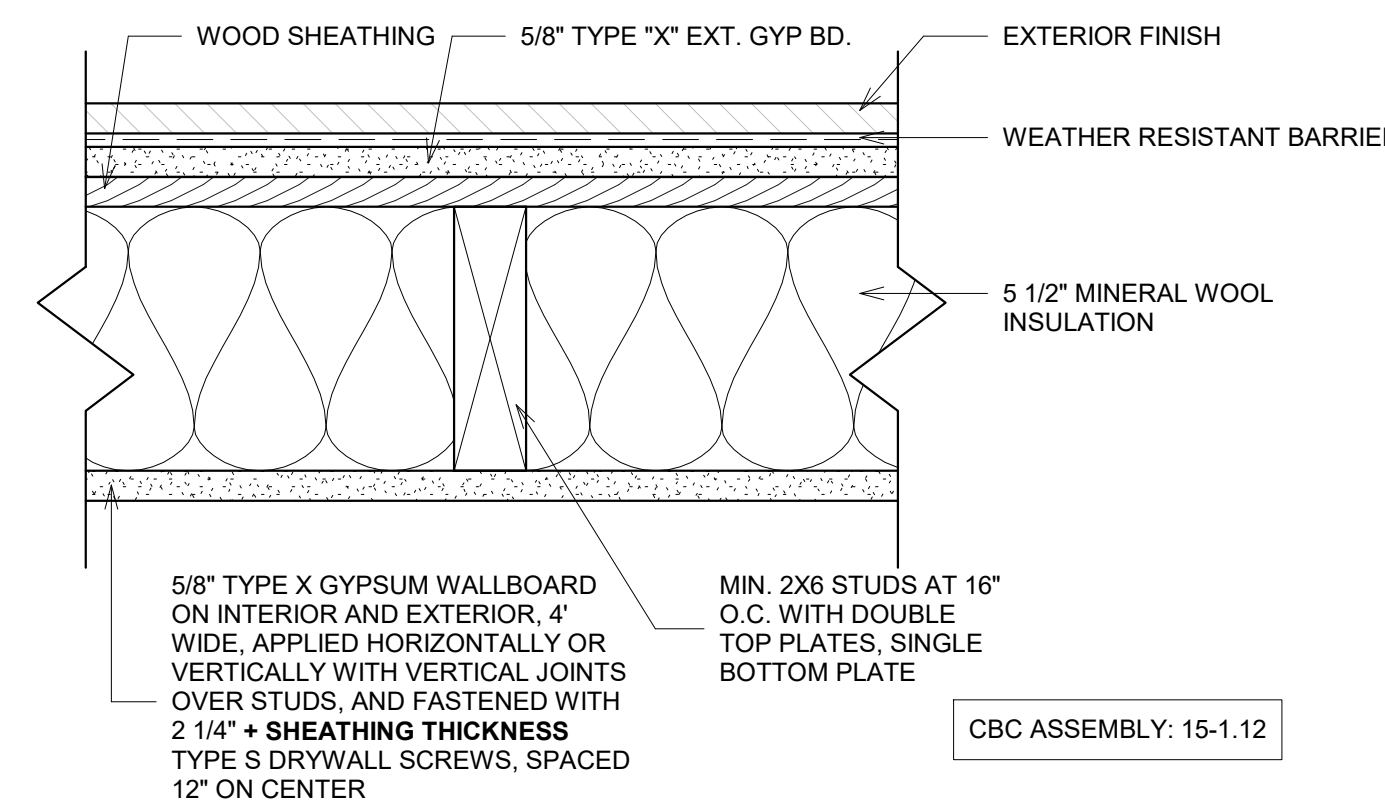

NOTE: NO EAVE AND/OR BLOCKING VENTING ALLOWED OVER 1-HOUR RATED WALLS, TYP.

3 1 HOUR EXTERIOR WALL
3/4" = 1'-0"

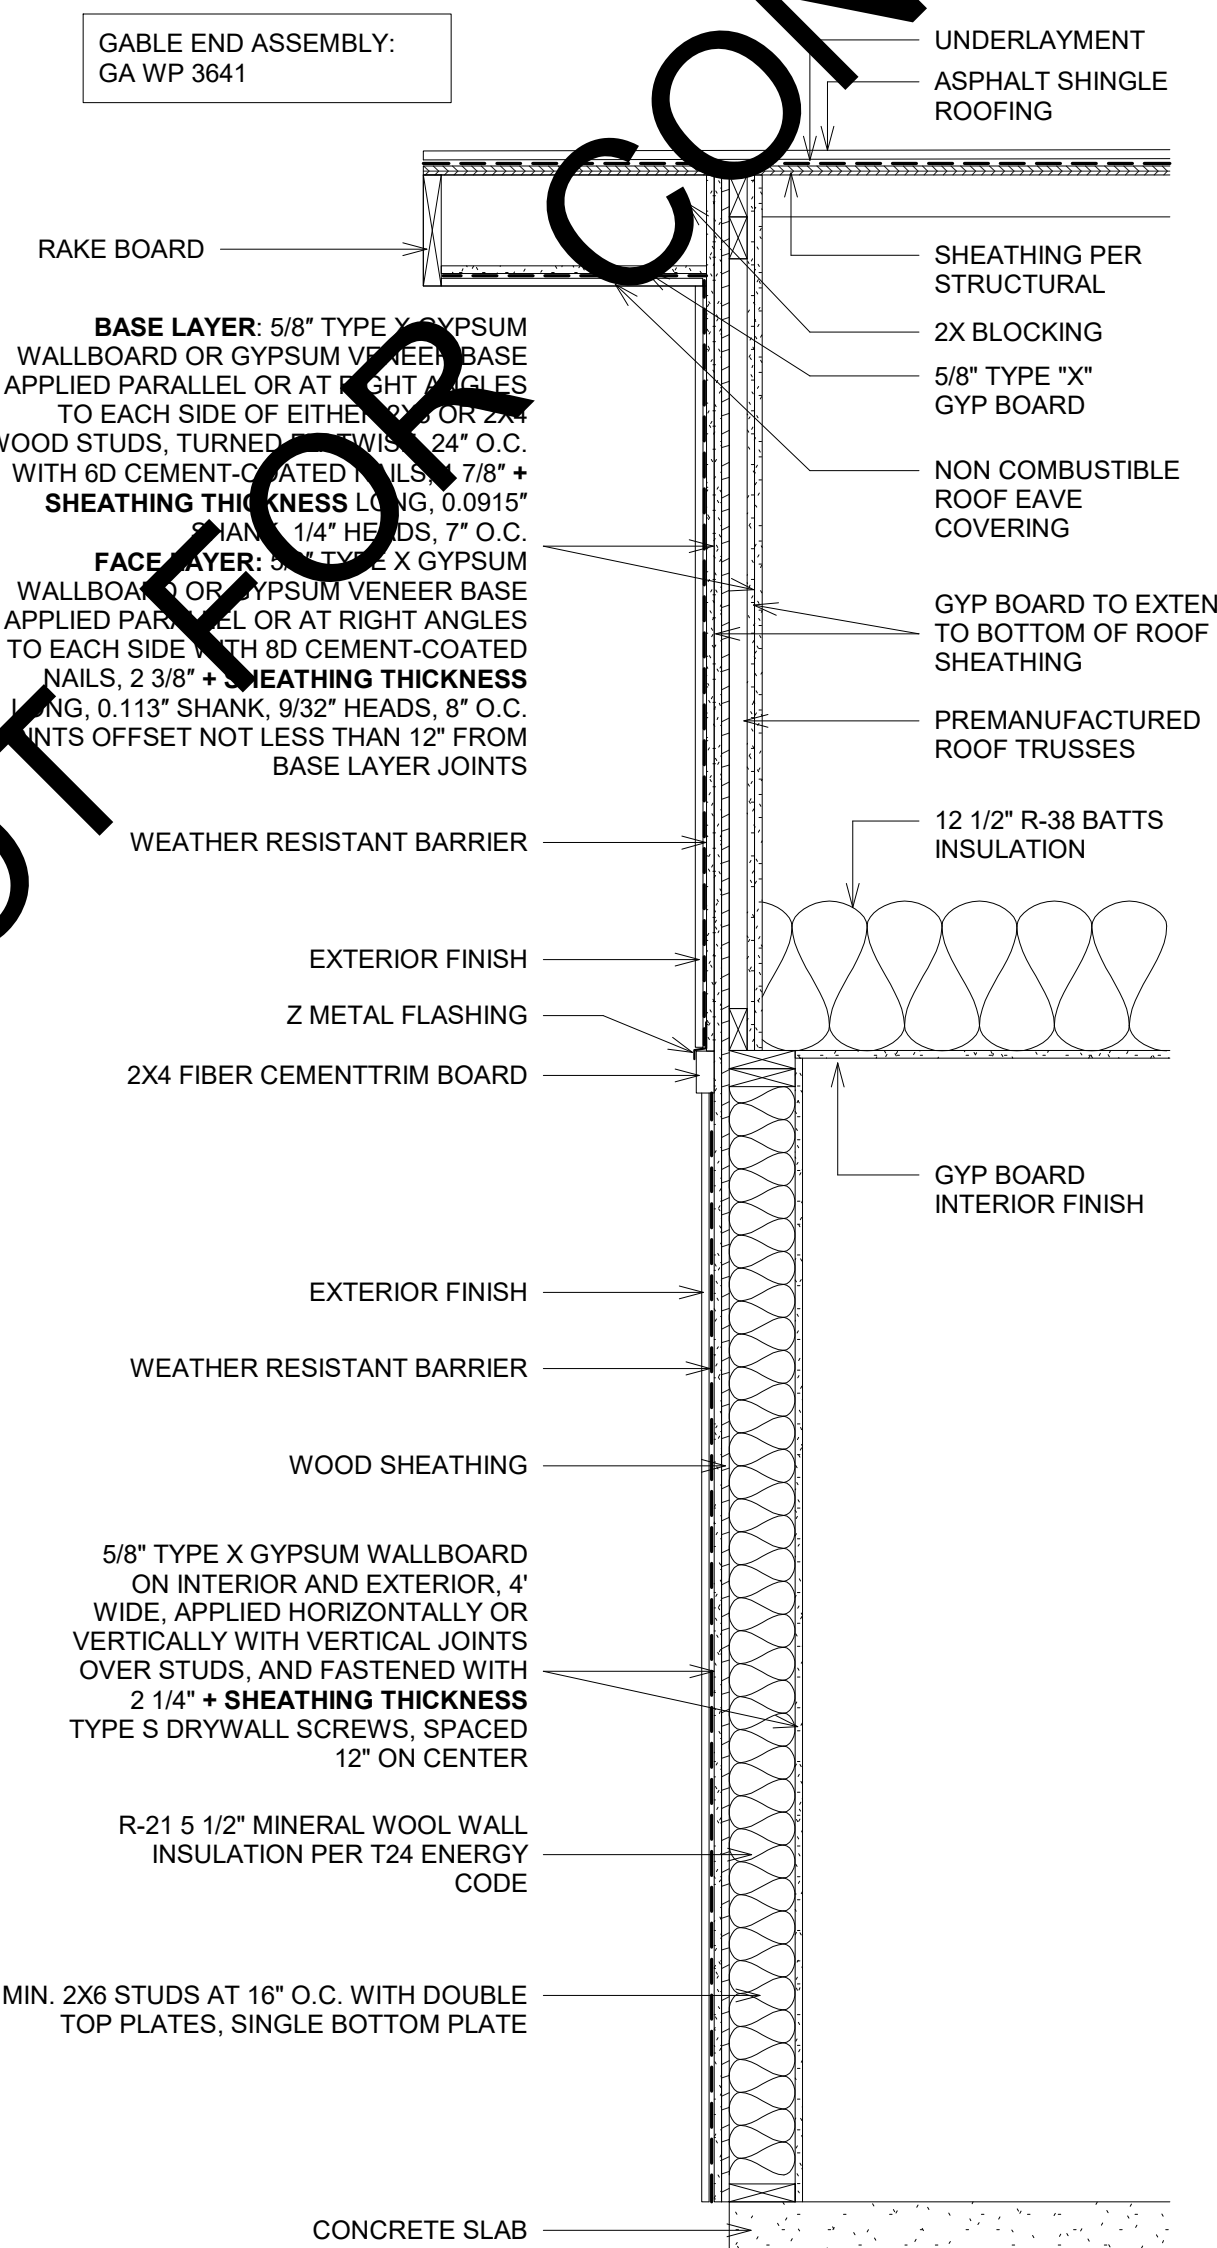

4 TYP. GABLE END 1 HOUR EXTERIOR WALL SECTION
3/4" = 1'-0"

TABLE R302.1(1) EXTERIOR WALLS

EXTERIOR WALL ELEMENT	MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE	
Walls	Fire-resistance rated	1 hour—tested in accordance with ASTM E119, UL 263 or Section 703.3 of the California Building Code with exposure from both sides	0 feet
	Not fire-resistance rated	0 hours	≥ 5 feet
Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood ^{a, b}	≥ 2 feet to < 5 feet
Openings in walls	Not fire-resistance rated	0 hours	≥ 5 feet
	Not allowed	NA	< 3 feet
Penetrations	25% maximum of wall area	0 hours	3 feet
	Unlimited	0 hours	5 feet
All	Comply with Section R302.4	< 3 feet	< 3 feet
	None required	None required	3 feet

For SI: 1 foot = 304.8 mm.

NA = Not Applicable.

- a. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the eave overhang if fireblocking is provided from the wall top plate to the underside of the roof sheathing.
- b. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the rake overhang where gable vent openings are not installed.

TABLE R302.1(2) EXTERIOR WALLS—DWELLINGS AND ACCESSORY BUILDINGS WITH AUTOMATIC RESIDENTIAL FIRE SPRINKLER PROTECTION

EXTERIOR WALL ELEMENT	MINIMUM FIRE-RESISTANCE RATING	MINIMUM FIRE SEPARATION DISTANCE	
Walls	Fire-resistance rated	1 hour—tested in accordance with ASTM E119, UL 263 or Section 703.2.2 of the California Building Code with exposure from the outside	0 feet
	Not fire-resistance rated	0 hours	3 feet ^a
Projections	Not allowed	NA	< 2 feet
	Fire-resistance rated	1 hour on the underside, or heavy timber, or fire-retardant-treated wood ^{a, c}	2 feet ^a
Openings in walls	Not fire-resistance rated	0 hours	3 feet
	Not allowed	NA	< 3 feet
Penetrations	Unlimited	0 hours	3 feet ^a
	All	Comply with Section R302.4	< 3 feet
	None required	None required	3 feet ^a

For SI: 1 foot = 304.8 mm.

NA = Not Applicable.

- a. For residential subdivisions where all dwellings are equipped throughout with an automatic sprinkler system installed in accordance with Section R313, the fire separation distance for exterior walls not fire-resistance rated and for fire-resistance-rated projections shall be permitted to be reduced to 0 feet, and unlimited unprotected openings and penetrations shall be permitted, where the adjoining lot provides an open setback yard that is 6 feet or more in width on the opposite side of the property line.
- b. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the eave overhang if fireblocking is provided from the wall top plate to the underside of the roof sheathing.
- c. The fire-resistance rating shall be permitted to be reduced to 0 hours on the underside of the rake overhang where gable vent openings are not installed.

No.	Date	Description

Sheet Name:
FIRE DETAILS

Scale:
As indicated
Date:
MAR 2024
Drawn By:
IS
Approved By:
LM
Sheet Number:

TRUSS NOTES

DESIGN LOADS:

TOP CHORD PER TRUSS CALCS = 12PSF
BOTTOM CHORD PER TRUSS CALCS = 8PSF


- 1. TOP CHORD TO BE MINIMUM 2X4 TYPICAL - 2X4 ALL OTHER MEMBERS (U.N.O.).
2. TRUSS MEMBERS SHALL BE DOUGLAS FIR (DF) NO.2 OR BETTER.
3. WOOD UNDER PLATES MUST BE FREE OF KNOTS, KNOT HOLES AND GREATLY DISTORTED GRAINS.
4. CALCULATIONS AND TRUSS DRAWINGS SHALL BE SUBMITTED TO THE ARCHITECT AND/OR ENGINEER FOR REVIEW PRIOR TO FABRICATION. GIRDER TRUSSES CALCULATIONS SHALL INCLUDE POINT LOADS FROM CARRIER TRUSS REACTIONS. ALL CALCULATIONS SHALL BE SIGNED BY A CIVIL ENGINEER REGISTERED IN THE STATE OF CALIFORNIA.
5. FABRICATION AND DESIGN SHALL CONFORM TO THE ICBO, CURRENT EDITION AND ANSI/TPI 1-2014 OF THE TRUSS PLATE INSTITUTE.
6. PROVIDE TEMPORARY ERECTION BRACING AS REQUIRED.
7. ALLOWABLE STRESS INCREASE FOR LOAD DURATION SHALL BE 25% (PERCENT) MAXIMUM.
8. INCREASE FOR ALLOWABLE STRESSES FOR REPETITIVE MEMBERS, SHALL BE PERMISSIBLE.
9. EFFECTS OF ECCENTRIC LOADING SHALL BE CONSIDERED IN THE DESIGN OF ALL JOINTS.
10. GENERAL CONTRACTOR TO PROVIDE WEB BRACING AS REQUIRED BY TRUSS MANUFACTURERS DESIGN.
11. BUILT-UP GIRDER TRUSSES SHALL BE LAMINATED USING 1/2" BOLTS AT 24" CC MAXIMUM THROUGH ALL MEMBERS.
12. ALL HARDWARE REQUIRED FOR CONNECTING TRUSSES (JACK TO HIP, HIP TO GIRDER, GIRDER TO GIRDER, ETC) SHALL BE DESIGNED, DETAILED AND SPECIFIED BY TRUSS FABRICATOR.
13. TRUSS MANUFACTURER SHALL SUBMIT LATEST ICBO APPROVED TEST DATA FOR TRUSS METAL PLATE CONNECTIONS TO ARCHITECT AND/OR ENGINEER PRIOR TO FABRICATION.
14. TRUSS MANUFACTURER TO PROVIDE PLAN DRAWING SHOWING TRUSS LOCATIONS AND TRUSS PROFILE SHOP DRAWINGS PRIOR TO FABRICATION.
15. GENERAL CONTRACTOR TO VERIFY ALL DIMENSIONS SHOWN ON TRUSS PROFILES WITH ARCHITECTURAL DRAWINGS AND IN FIELD WITH WALL LAYOUT PRIOR TO FABRICATION. PROVIDE SHOP DRAWINGS WITH DIMENSIONS REVIEWED AND APPROVED BY GENERAL CONTRACTOR.
16. TRUSS MANUFACTURER TO ACCOUNT FOR THE WEIGHT OF ALL MECHANICAL EQUIPMENT IN DESIGN OF ALL TRUSSES WHICH SUPPORT SUCH UNITS.

CONCRETE

- 1. CONCRETE 28 DAY COMPRESSIVE STRENGTH, F'c = 2500PSI, U.N.O.
2. WATER TO CEMENT RATIO SHALL NOT EXCEED 0.50.
3. MOIST CURE SLABS FOR A MINIMUM OF 3 DAYS.
4. CONCRETE MIX DESIGN SHALL BE PREPARED BY A 3RD PARTY INDEPENDENT LABORATORY. SELECTION OF CONCRETE MIX PROPORTIONS SHALL BE PER THE CALIFORNIA BUILDING CODE.
5. CEMENT SHALL CONFORM TO ASTM C-150 TYPE I OR II.
6. CONCRETE AGGREGATES SHALL CONFORM TO ASTM C-33. AGGREGATES FOR LIGHTWEIGHT CONCRETE SHALL CONFORM TO ASTM C-330.
9. REINFORCING DIMENSIONS SHOWN FOR LOCATION OF REINFORCING ARE TO THE FACE OF MAIN BARS AND DENOTE CLEAR COVERAGE. CONCRETE COVERAGE SHALL BE AS FOLLOWS: CONCRETE DEPOSITED AGAINST GROUND (EXCEPT SLABS) - 3". CONCRETE EXPOSED TO GROUND BUT PLACES IN FORMS - 2". SLABS (ON GROUND) - 2" CLEAR FROM TOP U.N.O.
10. ALL PREHEATING AND WELDING OF REINFORCING BARS SHALL BE DONE IN ACCORDANCE WITH AWS D1.4 LATEST EDITION AND SHALL BE CONTINUOUSLY INSPECTED BY A QUALIFIED LABORATORY. CONTRACTOR SHALL FURNISH TO THE LABORATORY, REBAR MILL CERTIFICATES.
11. REINFORCING STEEL SHALL BE FABRICATED ACCORDING TO "MANUAL OF STANDARD PRACTICE FOR REINFORCED CONCRETE CONSTRUCTION".
12. WIRE FABRIC SHALL CONFORM TO ACI 318-3.5.1, ACI 318-3.5.7, AND ASTM A-1064.
13. REINFORCING STEEL SHALL CONFORM TO ASTM A615-GRADE 60 FOR NO. 5 AND LARGER, AND ASTM A615-GRADE 40 FOR NO. 4 AND SMALLER, EXCEPT REINFORCING STEEL TO BE WELDED SHALL CONFORM TO ASTM A706.
14. SPLICES IN CONTINUOUS REINFORCEMENT FOR A CLASS "A" LAP SPLICE FOR NORMAL WEIGHT CONCRETE WHERE LESS THAN 12" OF CONCRETE IS BELOW THE LAP SPLICE SHALL BE 48 BAR DIAMETERS AND SPLICES IN ADJACENT BARS SHALL BE NOT LESS THAN 5'-0" APART. CLASS "B" LAP SPLICES SHALL BE 63 BAR DIAMETERS. SPLICE CONTINUOUS BARS IN SPANDRELS, GRADE BEAMS, ETC., AS FOLLOWS: TOP BARS AT MID-SPAN; BOTTOM BARS AT CENTERLINE AT SUPPORT, UNLESS NOTED OTHERWISE. SPLICES IN WWF SHALL BE 1.5 MESHES WIDE.
15. REINFORCING, DOWELS, BOLTS, ANCHORS, SLEEVES, ETC., TO BE EMBEDDED IN CONCRETE SHALL BE TIED SECURELY IN POSITION BEFORE PLACING CONCRETE PER ACI 318-12.18.
16. CONSTRUCTION JOINTS SHALL BE MADE ROUGH AND SURFACE FREE OF LOOSE DEBRIS. CONCRETE MY BE ROUGHENED BY SAND BLASTING OR CHIPPING THE ENTIRE SURFACE TO PRODUCE 1/4" DEEP DEFORMATIONS.
17. REMOVE ALL DEBRIS FROM FORMS BEFORE CASTING ANY CONCRETE.
18. 3'-0" SHALL BE THE MAXIMUM ALLOWED FREE FALL FOR CONCRETE TO MORE CLOSELY CONFORM TO ACI 318-5.10.
19. CONSOLIDATE CONCRETE PLACED IN FORMS BY MECHANICAL VIBRATING EQUIPMENT SUPPLEMENTED BY HAND-SPADING, RODDING OR TAMPING. USE EQUIPMENT AND PROCEDURES FOR CONSOLIDATION OF CONCRETE IN ACCORDANCE WITH THE RECOMMENDED PRACTICES OF ACI 309 TO SUIT THE TYPE OF CONCRETE AND PROJECT CONDITIONS.
20. NO WOOD SPREADERS ALLOWED. NO WOOD STAKES ALLOWED IN AREAS TO BE CONCRETED.
21. ALL SAW CUTTING SHALL BE DONE AFTER INITIAL SET HAS OCCURRED TO AVOID TEARING OR DAMAGE BY THE SWABBED, BUT BEFORE INITIAL SHRINKING HAS OCCURRED.
22. DRILL THROUGH STEEL COLUMNS, BEAMS AND PLATES TO PASS CONTINUOUS REINFORCING.
23. ADDITIONAL REINFORCING IN PRECAST OR TILT-UP PANELS REQUIRED FOR LIFTING STRESSES SHALL BE SUPPLIED BY THE CONTRACTOR.
24. PROVIDE 2-NO.5X4'-0" DIAGONAL REINFORCING AT MID-DEPTH OF SLAB AT ALL REENTRANT CORNERS TYPICAL.

FOUNDATIONS

- 1. BOTTOMS OF ALL FOUNDATIONS SHALL BE LEVEL. CHANGES IN BOTTOM OF FOUNDATION ELEVATION SHALL BE MADE ACCORDING TO STEPPED FOOTING DETAIL ON THE TYPICAL DETAIL SHEET.
2. ALL PILE CAPS, GRADE BEAMS, TIE BEAMS & OTHER FOOTINGS SHALL BE FORMED UNLESS SPECIFICALLY APPROVED BY THE ENGINEER OF RECORD. FOUNDATIONS MAY BE CAST IN NEAT EXCAVATIONS PROVIDED WRITTEN APPROVAL IS OBTAINED AND FOOTINGS ARE INCREASED 2" IN WIDTH. USE 2X12 PLANK AT EDGE OF EXCAVATION TO PROTECT AGAINST SLUFFING, AS REQUIRED.
3. WORK PERFORMED ON FOUNDATION SHALL BE DONE IN ACCORDANCE WITH THE REQUIREMENTS OF THE CURRENT CBC.
4. IF A TWO POUR FOUNDATION IS UTILIZED, THE COLD JOINT BETWEEN THE EXTERIOR FOOTING AND SLAB-ON-GRADE SHOULD BE LOCATED AT LEAST 4 INCHES ABOVE ADJACENT GRADE. IF THIS IS NOT DONE, A WATERSTOP BETWEEN THE TWO POURS SHALL BE USED.

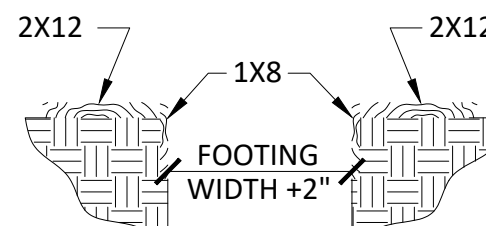

SHEARWALL

- 1. MIN 2X FRAMING MEMBERS OR BLOCKING REQUIRED AT ALL PANEL EDGES IN SHEAR WALL. TABLE VALUES ARE BASED ON 16" O.C. STUD SPACING.
2. ALL ANCHOR BOLTS IN WALLS INCLUDING SHEARWALLS REQUIRE 3"x3"x.229" THICK PLATE WASHERS. ONE EDGE OF THE STEEL PLATE WASHER SHALL EXTEND TO WITHIN 1/2" OF THE MUDSILL ON THE SIDE(S) WITH APA RATED WOOD SHEATHING. THE HOLE IN THE PLATE WASHER IS PERMITTED TO BE DIAGONALLY SLOTTED WITH A WIDTH UP TO 3/16" (44 mm) LARGER THAN THE BOLT DIAMETER AND A SLOT LENGTH NOT TO EXCEED 1 3/4" (44 mm), PROVIDED A STANDARD CUT WASHER IS PLACED BETWEEN THE PLATE WASHER AND THE NUT.
4. SOLE PLATE NAILING LESS THAN 6" O.C. SHALL BE STAGGERED 1/2" ABOUT THE CENTERLINE OF THE SOLID RIM.
5. (2) ANCHOR BOLTS MINIMUM PER SHEAR WALL.
6. 3K AND 4X MEMBERS AT ADJOINING PANEL EDGES MUST BE A SINGLE MEMBER.
7. FOR SHEAR WALLS ON RAISED WOOD FOUNDATIONS AND UPPER FLOORS REQUIRING LTPS CLIPS AT THE 2x SOLE PLATE, A MINIMUM OF TWO LTPS CLIPS MUST ALWAYS BE INSTALLED. SOLE PLATE TO RIM, OR SOLE PLATE TO BE PROTECTED WALL, THE FIELD NAILING SHALL BE 8" O.C. MAX REGARDLESS OF THE SHEAR WALL SPECIFICATIONS. EDGE NAILING AND NAIL SIZE SHALL BE THE SAME AS SPECIFIED ON THE PLANS.
10. DRYWALL SCREWS ARE NOT TO BE SUBSTITUTED FOR THE 5D AND 6D NAILS.
11. ALL FIELD NAILING SHALL BE @ 16" O.C. MAX., U.N.O.

NAILING SCHEDULE

REF. CBC 2022, TABLE 2304.10.2. ALL NAILS FOR STRUCTURAL WORK SHALL BE COMMON WIRE NAILS CONFORMING TO THE FOLLOWING MINIMUM SIZES:

Table with 3 columns: Nail Size, Diameter, and Length. Includes 8D, 10D, 10D SHORTS, 16D, 20D.

HOLES SHALL BE SUB-DRILLED WHERE NECESSARY TO PREVENT SPLITTING. NAILING NOT NOTED BELOW OR ON PLANS SHALL BE MINIMUM OF NAILS AT EACH CONTACT. 8D NAILS FOR 1" MATERIAL AND 16D NAILS FOR 2" MATERIAL.

- 1. BLOCKING BTWN CEILING JSTS, RAFTER OR TRUSS TO TOP PLATE OR FRAMING BELOW; EACH END, TOENAIL 3-8D
2. BLOCKING BTWN RAFTERS OR TRUSS NOT AT THE WALL TOP PLATE, TO RAFTER OR TRUSS; EACH END, TOENAIL 2-8D
3. FLAT BLOCKING TO TRUSS AND WEB FILLER; FACE NAIL 16D
4. CEILING JST TO TOP PLATE; EACH JST, TOENAIL 3-8D
5. CEILING JST NOT ATTACHED TO PARALLEL RAFTER, (NO THRUST); FACE NAIL --- 3-16D
6. CEILING JST ATTACHED TO PARALLEL RAFTER (HEEL JOINT); FACE NAIL --- TABLE 2308.7.3.1
7. COLLAR TIE TO RAFTER; FACE NAIL --- 3-10D
8. RAFTER OR ROOF TRUSS TO TOP PLATE; 2TOENAIL ONE SIDE, 1 OPPOSITE --- 3-10D
9. ROOF RAFTERS TO RIDGE VALLEY OR HIP RAFTERS, OR ROOF RAFTERS TO 2" RIDGE BEAM; END NAIL --- 2-16D
10. STUD TO STUD (NOT AT BRACED WALL PANELS); 24" OC FACE NAIL --- 16D
11. STUD TO STUD AND ABUTTING STUDS AT INTERSECTING WALL CORNERS (AT BRACED WALL PANEL); 16" OC FACE NAIL --- 16D
12. BUILT UP HEADER (2" TO 2" HEADER); 16" OC EACH EDGE, FACE NAIL --- 16D
13. CONTINUOUS HEADER TO STUD; TOENAIL --- 2-8D
14. TOP PLATE TO TOP PLATE; 16" OC FACE NAIL --- 16D
15. TOP PLATE TO TOP PLATE, AT END JOINTS; EA. SIDE END, FACE NAIL, MIN 24" --- 2-16D
16. BOTTOM PLATE TO JST, RIM JST, BAND JST, OR BLOCKING (NOT AT BRACED WALL PANELS); 16" OC FACE NAIL --- 16D
17. BOTTOM PLATE TO JST, RIM JST, BAND JST, OR BLOCKING AT BRACED WALL PANELS; 16" OC FACE NAIL --- 2-16D
18. STUD TO TOP OR BOTTOM PLATE; TOENAIL --- 4-8D
19. TOP OR BOTTOM PLATE TO STUD; END NAIL --- 2-16D
20. TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS; FACE NAIL --- 2-16D
21. 1" BRACE TO EACH STUD & PLATE; FACE NAIL; --- 2-8D
22. 1"X6" SHEATHING TO EACH BEARING; FACE NAIL --- 2-8D
23. WIDER THAN 1"X8" SHEATHING TO EACH BEARING; FACE NAIL --- 2-8D
24. JOIST TO SILL, TOP PLATE, OR GIRDER; TOENAIL --- 3-8D
25. RIM JST, BAND JST, OR BLOCKING TO TOP PLATE, SILL, OR OTHER FRAMING; 6" OC TOENAIL --- 8D
26. 1" X 6" SUBFLOOR OR LESS TO EACH JST; FACE NAIL --- 2-8D
27. 2" SUBFLOOR TO JST OR GIRDER; BUILT UP AND FACE NAIL --- 2-16D
28. 2" PLANKS (PLANK & BEAM - FLOOR AND ROOF) TO EACH BEARING, FACE NAIL --- 2-16D
29. BUILT UP GIRDERS AND BEAMS; 16" OC EACH BEARING; 32" OC FACE NAIL TOP & BOT. STAGGERED ON OPP SIDES --- 20D
30. LEDGER STRIP SUPPORT TO JST, RAFTERS; EACH JST OR RAFTER, FACE NAIL --- 3-16D
31. JOIST TO BAND JOIST OR RIM JOIST; END NAIL --- 3-16D
32. BRIDGING OR BLOCKING TO TOP RAFTER, OR TRUSS; EACH END, TOENAIL --- 2-8D
33. WOOD STRUCTURAL PANELS, COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING --- 8D
34. 3/4" AND LESS --- 8D
35. 7/8" --- 8D
36. 1" --- 10D
37. BRACING SIDING TO FRAMING --- 6D
38. 1/2" OR LESS --- 8D

WOOD

- 1. ALL WOOD IN DIRECT CONTACT WITH EARTH OR CONCRETE SHALL BE PRESSURE TREATED DOUGLAS FIR. BEARING AND SHEAR WALLS SHALL HAVE DOUBLE TOP PLATES, LAPPED AT WALL AND PARTITION INTERSECTION WITH 3-16D NAILS.
3. PROVIDE SOLID BLOCKING BETWEEN JOISTS AND RAFTERS AT ALL SUPPORTS.
4. PROVIDE BLOCKING AT ALL CEILING LEVELS.
5. ALL STRUCTURAL WOOD SHALL CONFORM WITH THE FOLLOWING SPECIFICATION: DOUGLAS FIR - COAST REGION - WCLIB GRADING RULES NO.17 DF NO.2, U.N.O. REDWOOD - CALIFORNIA REDWOOD ASSOCIATION GRADING RULES, LATEST EDITION. GLUED LAMINATED BEAMS - SHALL BE 24F-V4 OR 24F-V8 FOR CANTILEVERED BEAMS. BEAMS SHALL ALSO BE MANUFACTURED AND IDENTIFIED AS REQUIRED IN ANSI/AITC A190.1 AND ASTM D3737. STANDARD SPEC. FOR STRUCTURAL GLUED LAMINATED TIMBER AITC 117 LATEST ADDITION. SUBMIT SHOP DRAWINGS PRIOR TO FABRICATION OF GLUED-LAMINATED MEMBERS. PLYWOOD - U.S. PRODUCT STANDARDS PSI AND PS2. PLYWOOD SHALL BE APA RATED EXPOSURE 1, OR EXTERIOR, AS REQUIRED; STRUCTURAL 1 AND C-D TO MEET PS1 AND PS2 AS REQUIRED. CDX (C-D EXPOSURE 1) OR OSB (ORIENTED STRAND BOARD) @ FLOORS AND ROOF - U.N.O.
6. PRESSURE TREATED DOUGLAS FIR - AWPA (AMERICAN WOOD PRESERVERS' ASSOCIATION) U1. USE CATEGORY UC2 FOR INTERIOR USE. WATERBORNE PRESERVATIVES SHALL HAVE A MINIMUM RETENTION LEVEL OF 0.25 LB/FT^3 AND SHALL NOT CONTAIN CHROMIUM, COPPER, OR ARSENATE. NEWLY EXPOSED SURFACES, RESULTING FROM FIELD MODIFICATION SUCH AS CUTTING, BORING, OR HANDLING, SHALL BE FIELD TREATED IN ACCORDANCE WITH AWPA M-4.
7. HOLES FOR BOLTS IN WOOD SHALL BE BORED WITH A BIT OF THE SAME NOMINAL DIAMETER AS THE BOLT PLUS 1/16".
8. HOLES FOR LAG SCREW SHALL BE BORED TO THE SAME DIAMETER AND DEPTH AS THE SHANK AND THE REST NO LARGER THAN THE ROOT OF THE THREAD.
9. LAG SCREWS AND WOOD SCREWS SHALL BE SCREWED AND NOT DRIVEN INTO PLACE. SOAP MAY BE USED TO LUBRICATE THE SCREWS.
10. ALL BOLTS AND LAG SCREWS SHALL BE PROVIDED WITH METAL WASHERS UNDER HEADS AND NUTS WHICH BEAR ON WOOD. APPLIES ALSO TO INSERTED EXPANDING FASTENERS, RED HEAD ETC.

Table with 3 columns: Bolt Diameter, MI Washer, Steel Washer. Lists sizes from 1/2" to 1" diameter.

- 11. ALL BOLTS AND LAG SCREWS SHALL BE TIGHTENED ON INSTALLATION AND RETIGHTENED BEFORE CLOSING IN OR AT COMPLETION OF JOB.
12. BLOCK SP JOINTS WITH 2X4 FLAT BLOCKING WHERE NOTED ON ROOF OR FLOOR FRAMING PLANS AND WITH BLOCKING SAME AS STUDS AT WALLS.
13. LAY ALL STRUCTURAL PLYWOOD ON ROOF AND FLOORS WITH FACE GRAIN PERPENDICULAR TO SUPPORT UNLESS NOTED OTHERWISE.
14. CONNECTOR HARDWARE MODEL NUMBER ARE THOSE FOR SIMPSON STRONG-TIE COMPANY. EQUIVALENT CONNECTORS WITH ICC ACCEPTANCE MAY BE SUBSTITUTED WITH WRITTEN APPROVAL FROM THE ENGINEER OF RECORD. ALL JOIST HANGERS SHALL BE SIMPSON U SERIES UNLESS NOTED OTHERWISE.
15. FASTENERS FOR PRESERVATIVE TREATED & FIRE RETARDANT TREATED WOOD SHALL BE OF HOT DIPPED ZINC COATED GALVANIZED STEEL (PER ASTM A153, CLASS G185), STAINLESS STEEL, SILICON BRONZE OR COPPER. THE COATING WEIGHTS FOR ZINC COATED FASTENERS SHALL BE IN ACCORDANCE WITH ASTM A 153.
16. ALL WOOD FRAMING SHALL HAVE LESS THAN 19% MOISTURE CONTENT AT TIME OF INSTALLATION.

ABBREVIATIONS

Table listing abbreviations for materials and components such as ANCHOR BOLT, BETWEEN, CENTER TO CENTER, CONSTRUCTION JOINT, CONTROL JOINT, CLEAR, CONCRETE, CONTINUOUS COMPLETE PENETRATION, DOUGLAS FIR, DEAD LOAD, EXISTING, EXPANSION JOINT, EDGE NAILING, FACE OF BLOCK, FACE OF CONCRETE, FINISH FLOOR, FLOOR, FACE OF STUD, FOOTING, GAUGE, GLUED-LAMINATED BEAM, HEADER, HIGH STRENGTH BOLT (A-325), HEIGHT, JOIST HANGER (SIMPSON), LIVE LOAD, LAG SCREW, LAMINATED STRAND LUMBER, LIGHT WEIGHT, LAMINATED VENEER LUMBER, MANUFACTURER, MALLEABLE IRON, NEW, PRESSURE TREATED DOUGLAS FIR, PARALLEL STRAND LUMBER, NOT TO SCALE, OPPOSITE HAND, PIECE, PARTIAL PENETRATION, PANEL WALL, REDWOOD, SCHEDULE, SHEAR CONNECTOR, SELF DRILLING SLY TAPPING SCRW, STRUCTURAL PLY EDGE NAILING, STIFFENER, STAGGERED, TOP & BOTTOM, TONGUE & GROOVE, TOE NAIL, TOP OF FRAMING, TOP OF STEEL, UNLESS NOTED OTHERWISE, WITH, WITHOUT, WORK POINT, WOOD SCREW, WELDED WIRE FABRIC, CENTERLINE, PLATE, NUMBER OF POUNDS, SQUARE, ROUND OR DIAMETER, CONTINUOUS WOOD IN SECTION, WOOD BLOCKING IN SECTION, END OF WOOD PIECE.

GENERAL CONSTRUCTION NOTES


- 1. THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT ALL WORK AND CONSTRUCTION MEETS ALL CURRENT FEDERAL, STATE, COUNTY, AND LOCAL CODES, ORDINANCES, REGULATIONS, ETC. THESE CODES ARE TO BE CONSIDERED PART OF THE SPECIFICATIONS FOR THIS BUILDING AND SHOULD BE ADHERED TO EVEN IF THEY ARE IN VARIANCE OF THE PLAN.
2. DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE DRAWING (DO NOT SCALE DRAWING.)
3. THE ENGINEER HAS NOT BEEN ENGAGED FOR CONSTANT CONSTRUCTION SUPERVISION AND ASSUMES NO RESPONSIBILITY FOR CONSTRUCTION COORDINATING WITH THESE PLANS, NOR RESPONSIBILITY FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCE, OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK. THERE ARE NO WARRANTIES FOR A SPECIFIC USE EXPRESSED OR IMPLIED IN THE USE OF THESE PLANS.
4. REFER TO ARCHITECTURAL SHEETS FOR FLOOR PLANS, EXTERIOR ELEVATIONS, AND WINDOW AND DOOR SIZES AND TYPES.

DESIGN CRITERIA

Table of design criteria including Seismic Criteria (SDC, Risk Category, etc.), Gravity Loading (Roof Live, Roof Dead, Wall Dead), Wind Criteria (Ultimate Wind, Basic Wind, etc.), and Soil Bearing.

STRUCTURAL INDEX

Table mapping drawing numbers to titles: S.M1 STRUCTURAL NOTES AND SPECIFICATIONS, S1.0 FOUNDATION AND SHEARWALL PLAN, S2.0 SHEARWALL PLAN, S3.0 ROOF FRAMING PLAN, SD1 STRUCTURAL DETAILS, SD2 STRUCTURAL DETAILS, SD3 STRUCTURAL DETAILS.

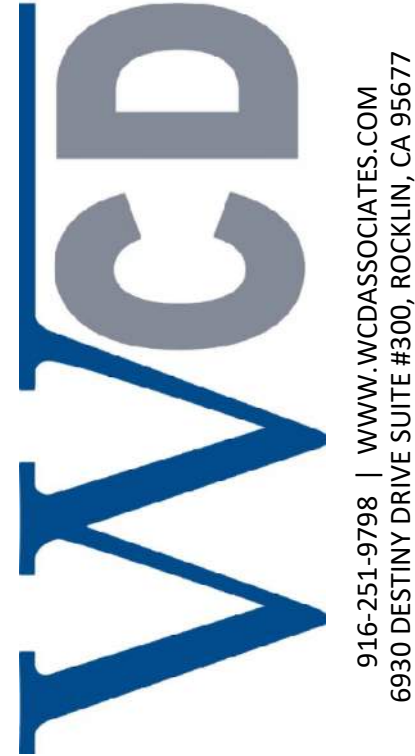

THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO WCD & ASSOCIATES, AND IS FURNISHED FOR THE PURPOSES OF REVIEW, BIDDING OR CONSTRUCTION OF THE PROJECT LISTED IN THE JOB TITLE BOX BELOW, AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF WCD. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF WCD. ALL RIGHTS RESERVED COPYRIGHT 2023.

STRUCTURAL NOTES AND SPECIFICATIONS

PERMIT READY


ACCESSORY DWELLING UNIT PLANS - MODEL C

TITLE:



Table for revisions with columns for NO. and REVISIONS. Includes fields for SCALE (AS NOTED), DATE (4/15/2024), DESIGNED BY (E.VILLALPANDO), DRAWN BY (E.COURPET), REVIEWED BY (W.CULLUMBER), JOB NO. (RN101022), and SHEET NO.

SN1

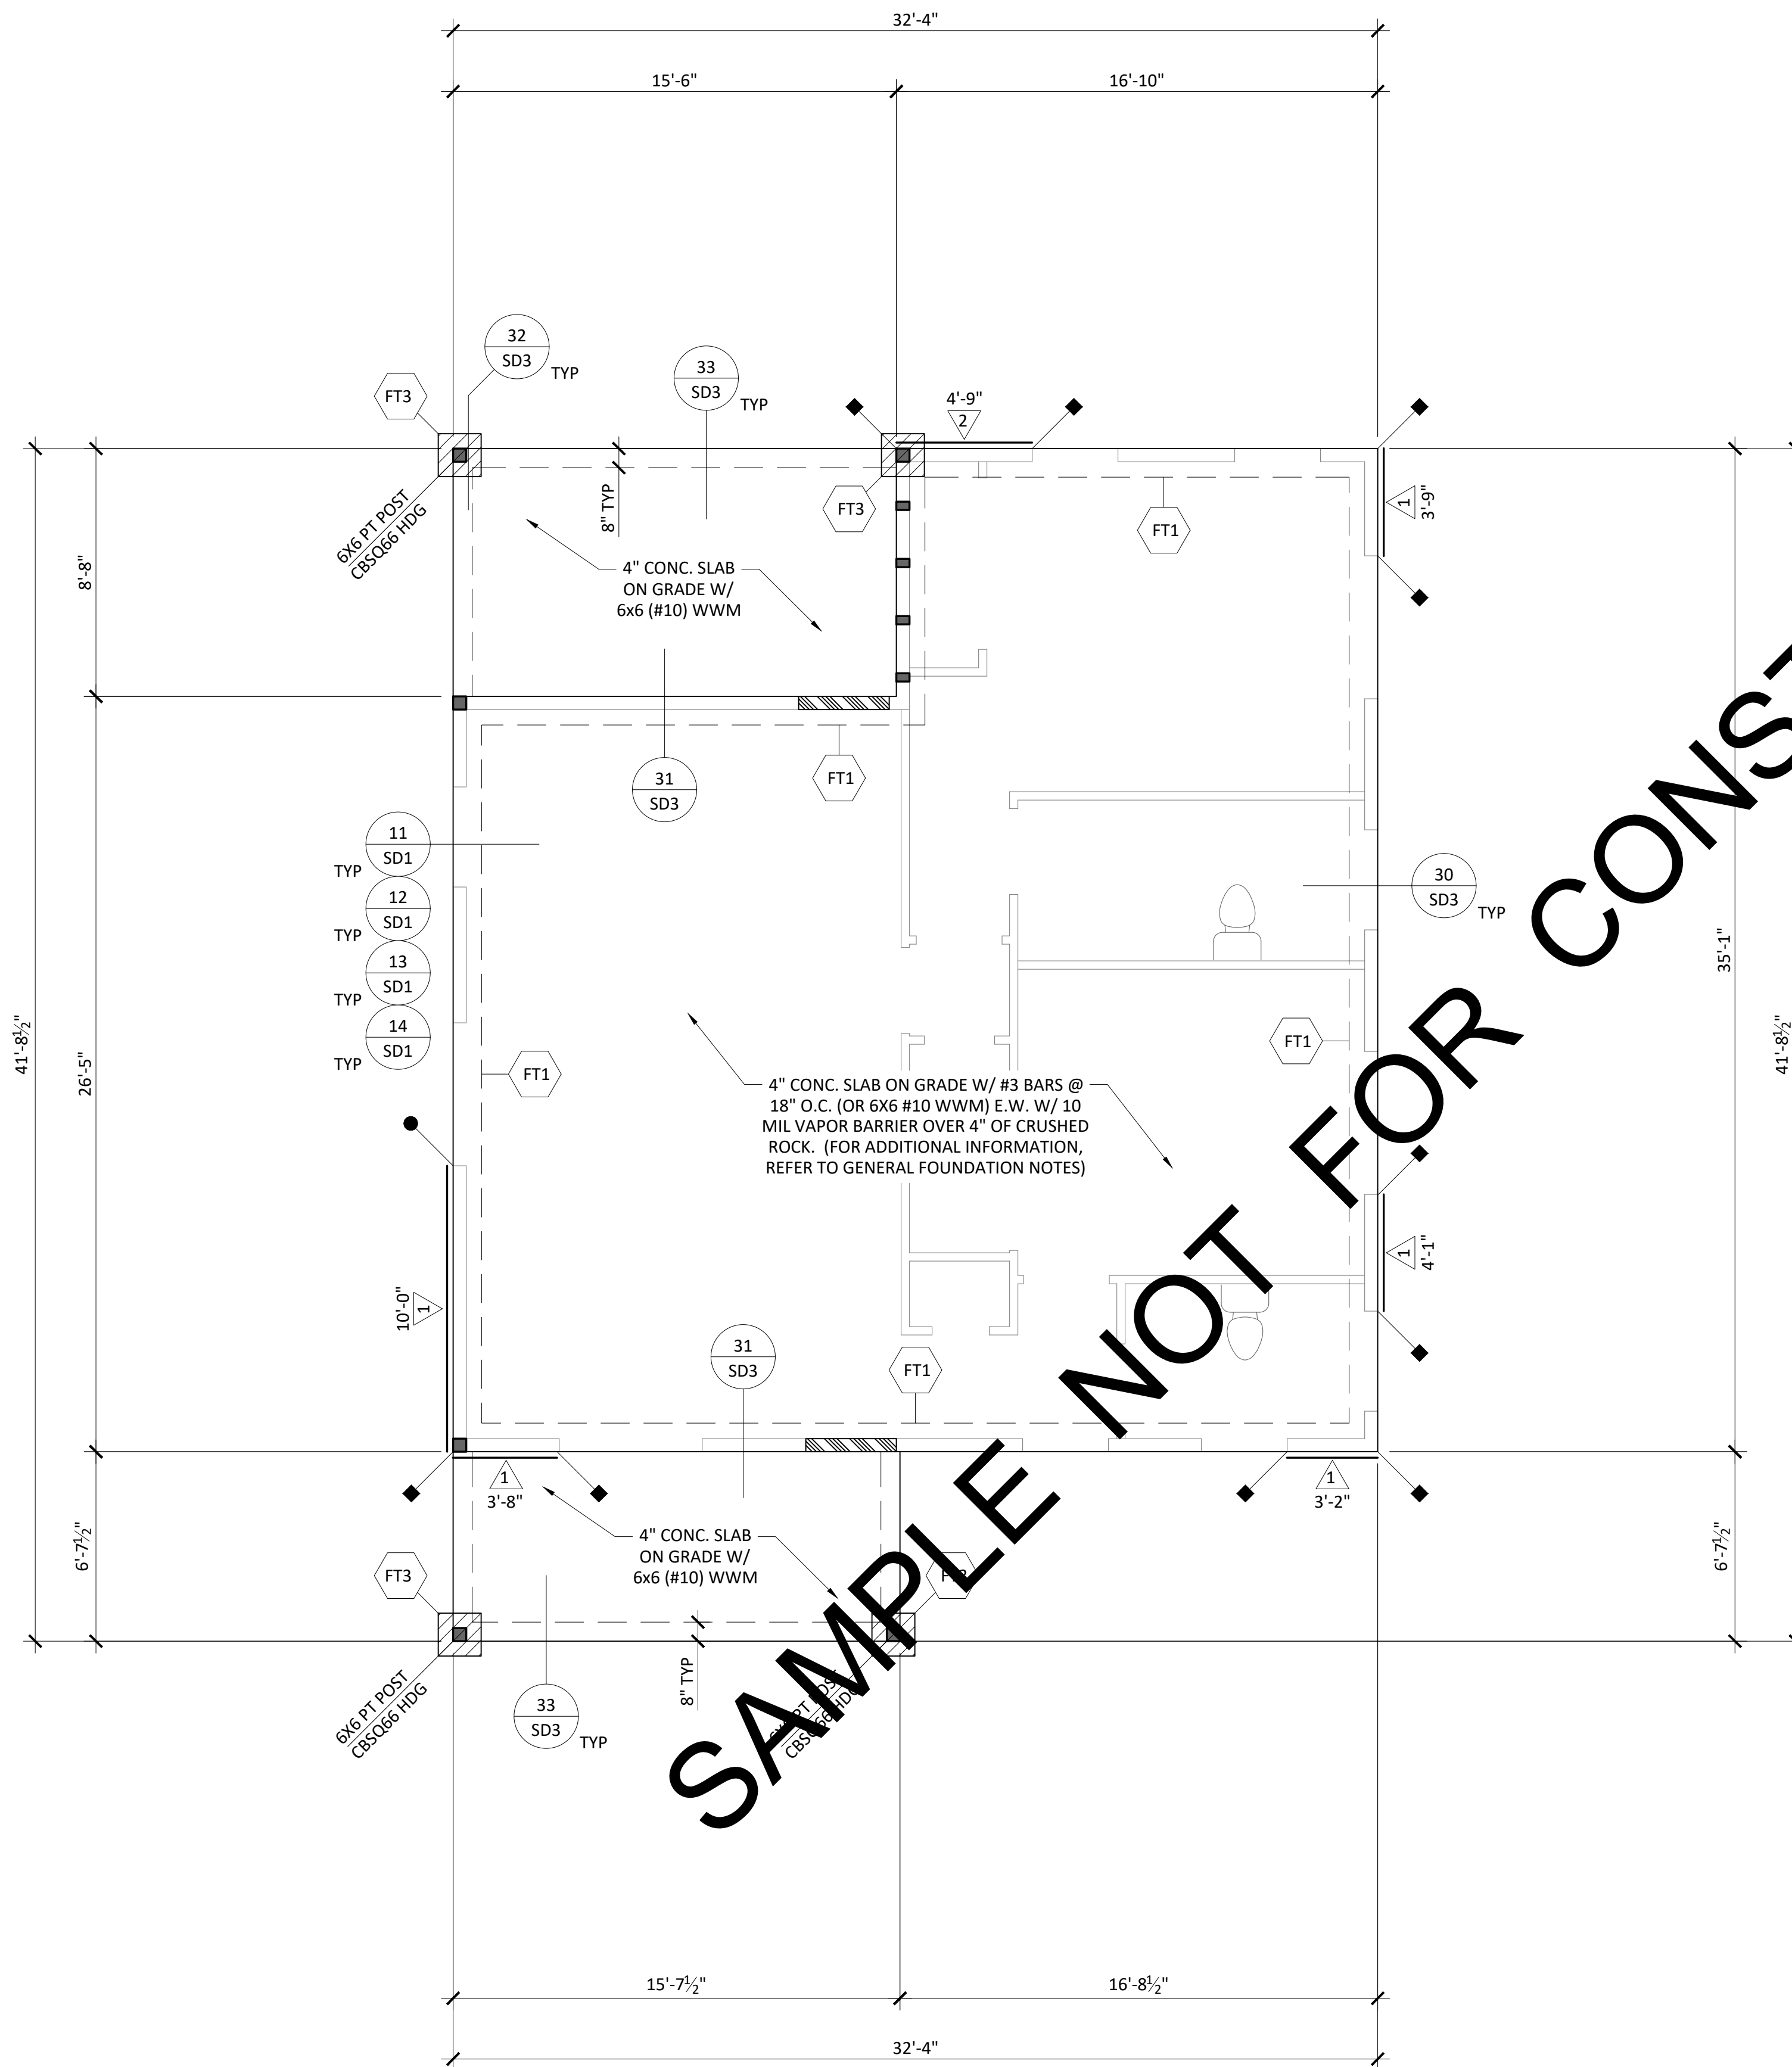

FOUNDATION AND SHEARWALL PLAN
SCALE: 3/4" = 1'-0"


FOOTING SCHEDULE

TYPE	DIMENSIONS			REINFORCEMENT			MAX. CAPACITY	NOTES		
	LENGTH	WIDTH	DEPTH	NO.	SIZE	LENGTH			NO.	SIZE
FT1	CONT.	12"	12"	2	#4	CONT.	-	-	1,500 PLF	(1) TOP, (1) BOT
FT3	18"	18"	12"	3	#4	12"	3	#4	12"	3,375 LBS

GENERAL FOUNDATION NOTES

- THE CONTRACTOR IS RESPONSIBLE FOR REFERRING TO THE PLANS TO VERIFY HOLDOWN LOCATIONS, STRUCTURAL PLYWOOD SHEATHING SPECIFICATIONS AND NAILING SCHEDULE.
- POSTS SHOWN ON THE FOUNDATION PLAN ARE THOSE DIRECTLY CONNECTED TO THE FOUNDATION WITH A HOLDOWN OR POST BASE CONNECTOR.
- TYPICAL ONE STORY FOUNDATION, U.N.O. - 12" WIDE X 12" DEEP FOOTING WITH (1) #4 REBAR TOP AND BOTTOM (TOT. 2).
- PROVIDE 3/4"x10" ANCHOR BOLTS @ 4'-0" O.C. AND 12" FROM ALL EDGES AT THE BEARING WALLS AND EXTERIOR NON-SHEAR WALLS W/ 7" MIN. EMBEDMENT. FASTEN TO BOTTOM PLATE USING 3"x3"x1/4" STEEL WASHERS.
- PROVIDE 2X PTDF SLEEPER EMBEDDED IN SLAB AT DOORS LEADING TO EXTERIOR AND GARAGE. EXTEND 6" PAST DOOR CASING. (2) 20d @ EA END & 24" O.C.
- ALL FOOTINGS, FOUNDATIONS, EXCAVATIONS, GRADING, AND FILL SHALL COMPLY TO THE PROVISIONS OF THE CALIFORNIA BUILDING CODE.
- SLAB REINFORCEMENT SHALL BE PROVIDED EACH WAY, AS INDICATED ON THE PLANS, IN THE MIDDLE THIRD OF SLAB. WHERE VAPOR BARRIER IS REQUIRED, VAPOR RETARD BARRIER SHALL BE SEALED AT ALL PENETRATIONS AND SHALL CONFORM TO CLASS A VAPOR RETARDER IN ACCORDANCE WITH THE MOST CURRENT VERSION OF ASTM E 1745, "STANDARD SPECIFICATIONS FOR PLASTIC WATER VAPOR RETARDERS USED IN CONTACT WITH SOIL OR GRANULAR FILL UNDER CONCRETE SLABS". VAPOR BARRIER SHALL BE UNDERLAIN WITH 4" DEEP 3/4" CRUSHED ROCK WITH 100% PASSING THE 3/4" SIEVE AND LESS THAN 5% PASSING THE NO. 4 SIEVE.
- CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL MEASUREMENTS AGAINST THE ARCHITECTURAL PLAN SET. ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE EOR AND DESIGNER BEFORE FORMING AND/OR POURING CONCRETE.

FOUNDATION LEGEND

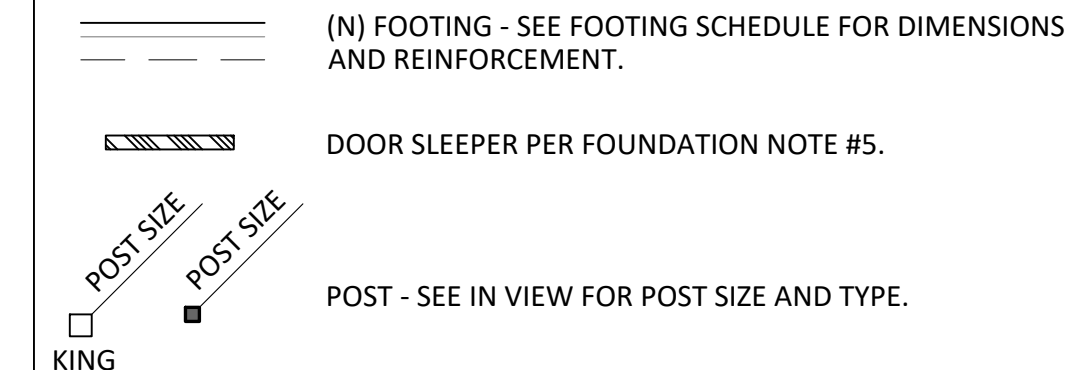

SHEARWALL SCHEDULE

#	### PLF	SHEATHING/NAILING	MUD SILL	ANCHOR BOLTS	VERT. MEMBER @ ADJ. PANEL EDGES	SOLE PLATE TO RIM	RIM TO SILL PLATE (A35 CLIPS)
1	260 PLF	3/4" APA RATED ONE FACE w/8d COMMONS @ 6" O.C. EDGE & 12" O.C. FIELD. 8" O.C. FIELD AT FIRE RATED WALLS ONLY.	2x	5/8" @ 48" O.C.	2x	SDWS22500DB @ 12" O.C.	@ 24" C.C.
2	350 PLF	3/4" APA RATED ONE FACE w/8d COMMONS @ 4" O.C. EDGE & 12" O.C. FIELD. 8" O.C. FIELD AT FIRE RATED WALLS ONLY.	2x	5/8" @ 48" O.C.	(2) 2x	SDWS22500DB @ 8" O.C.	@ 20" C.C.

- REFER TO "SHEARWALL NOTES" ON SHEET SN1 FOR ADDITIONAL INFORMATION.

HOLDOWN SCHEDULE

1,435 LBS	STHD10/10RJ HOLDOWN (MAY SUBSTITUTE W/HDU2 AS DESIRED) INSTALL PER DETAIL 17/SD2 & 18/SD2
2,685 LBS	STHD14/14RJ HOLDOWN (MAY SUBSTITUTE W/HDU2 AS DESIRED) INSTALL PER DETAIL 17/SD2 & 18/SD2

- ALL HOLDOWN CONNECTORS SHALL BE RE-TIGHTENED JUST PRIOR TO ENCLOSURE.
- CONTRACTOR SHALL PLACE ALL HOLDOWNS IN THE CORRECT LOCATION TO TIE INTO HD POST.
- REFER TO DETAIL 18/SD2 FOR HD PLACEMENT AT WINDOW OR DOOR OPENING.




THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO WCD & ASSOCIATES. AND IS FURNISHED FOR THE PURPOSES OF REVIEW, BIDDING OR CONSTRUCTION OF THE PROJECT LISTED IN THE JOB TITLE BOX BELOW, AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF WCD. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF WCD. ALL RIGHTS RESERVED COPYRIGHT 2023.

FOUNDATION AND SHEARWALL PLAN

PERMIT READY

ACCESSORY DWELLING UNIT PLANS - MODEL C

TITLE: _____
ADDRESS: _____

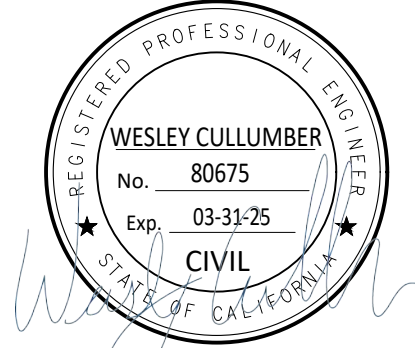

NO.	REVISIONS

SCALE: AS NOTED
DATE: 4/15/2024
DESIGNED BY: E.VILLALPANDO
DRAWN BY: E.COURPET
REVIEWED BY: W.CULLUMBER
JOB NO: RN101022
SHEET NO.

S1.0

SHEARWALL SCHEDULE


### PLF	SHEATHING/NAILING	MUD SILL	ANCHOR BOLTS	VERT. MEMBER @ ADJ. PANEL EDGES	SOLE PLATE TO RIM	RIM TO SILL PLATE (A35 CLIPS)
1 260 PLF	3/8" APA RATED ONE FACE w/8d COMMONS @ 6" O.C. EDGE & 12" O.C. FIELD. 8" O.C. FIELD AT FIRE RATED WALLS ONLY.	2x	5/8" @ 48" O.C.	2x	SDWS22500DB @ 12" O.C.	@ 24" C.C.
2 350 PLF	3/8" APA RATED ONE FACE w/8d COMMONS @ 4" O.C. EDGE & 12" O.C. FIELD. 8" O.C. FIELD AT FIRE RATED WALLS ONLY.	2x	5/8" @ 48" O.C.	(2) 2x	SDWS22500DB @ 8" O.C.	@ 20" C.C.

- REFER TO "SHEARWALL NOTES" ON SHEET SN1 FOR ADDITIONAL INFORMATION.

HOLDOWN SCHEDULE

● 1,435 LBS	STHD10/10RJ HOLDOWN (MAY SUBSTITUTE W/HDU2 AS DESIRED) INSTALL PER DETAIL 17/SD2 & 18/SD2
■ 2,685 LBS	STHD14/14RJ HOLDOWN (MAY SUBSTITUTE W/HDU2 AS DESIRED) INSTALL PER DETAIL 17/SD2 & 18/SD2

- ALL HOLDOWN CONNECTORS SHALL BE RE-TIGHTENED JUST PRIOR TO ENCLOSURE.
- CONTRACTOR SHALL PLACE ALL HOLDOWNS IN THE CORRECT LOCATION TO TIE INTO HD POST.
- REFER TO DETAIL 18/SD2 FOR HD PLACEMENT AT WINDOW OR DOOR OPENING.

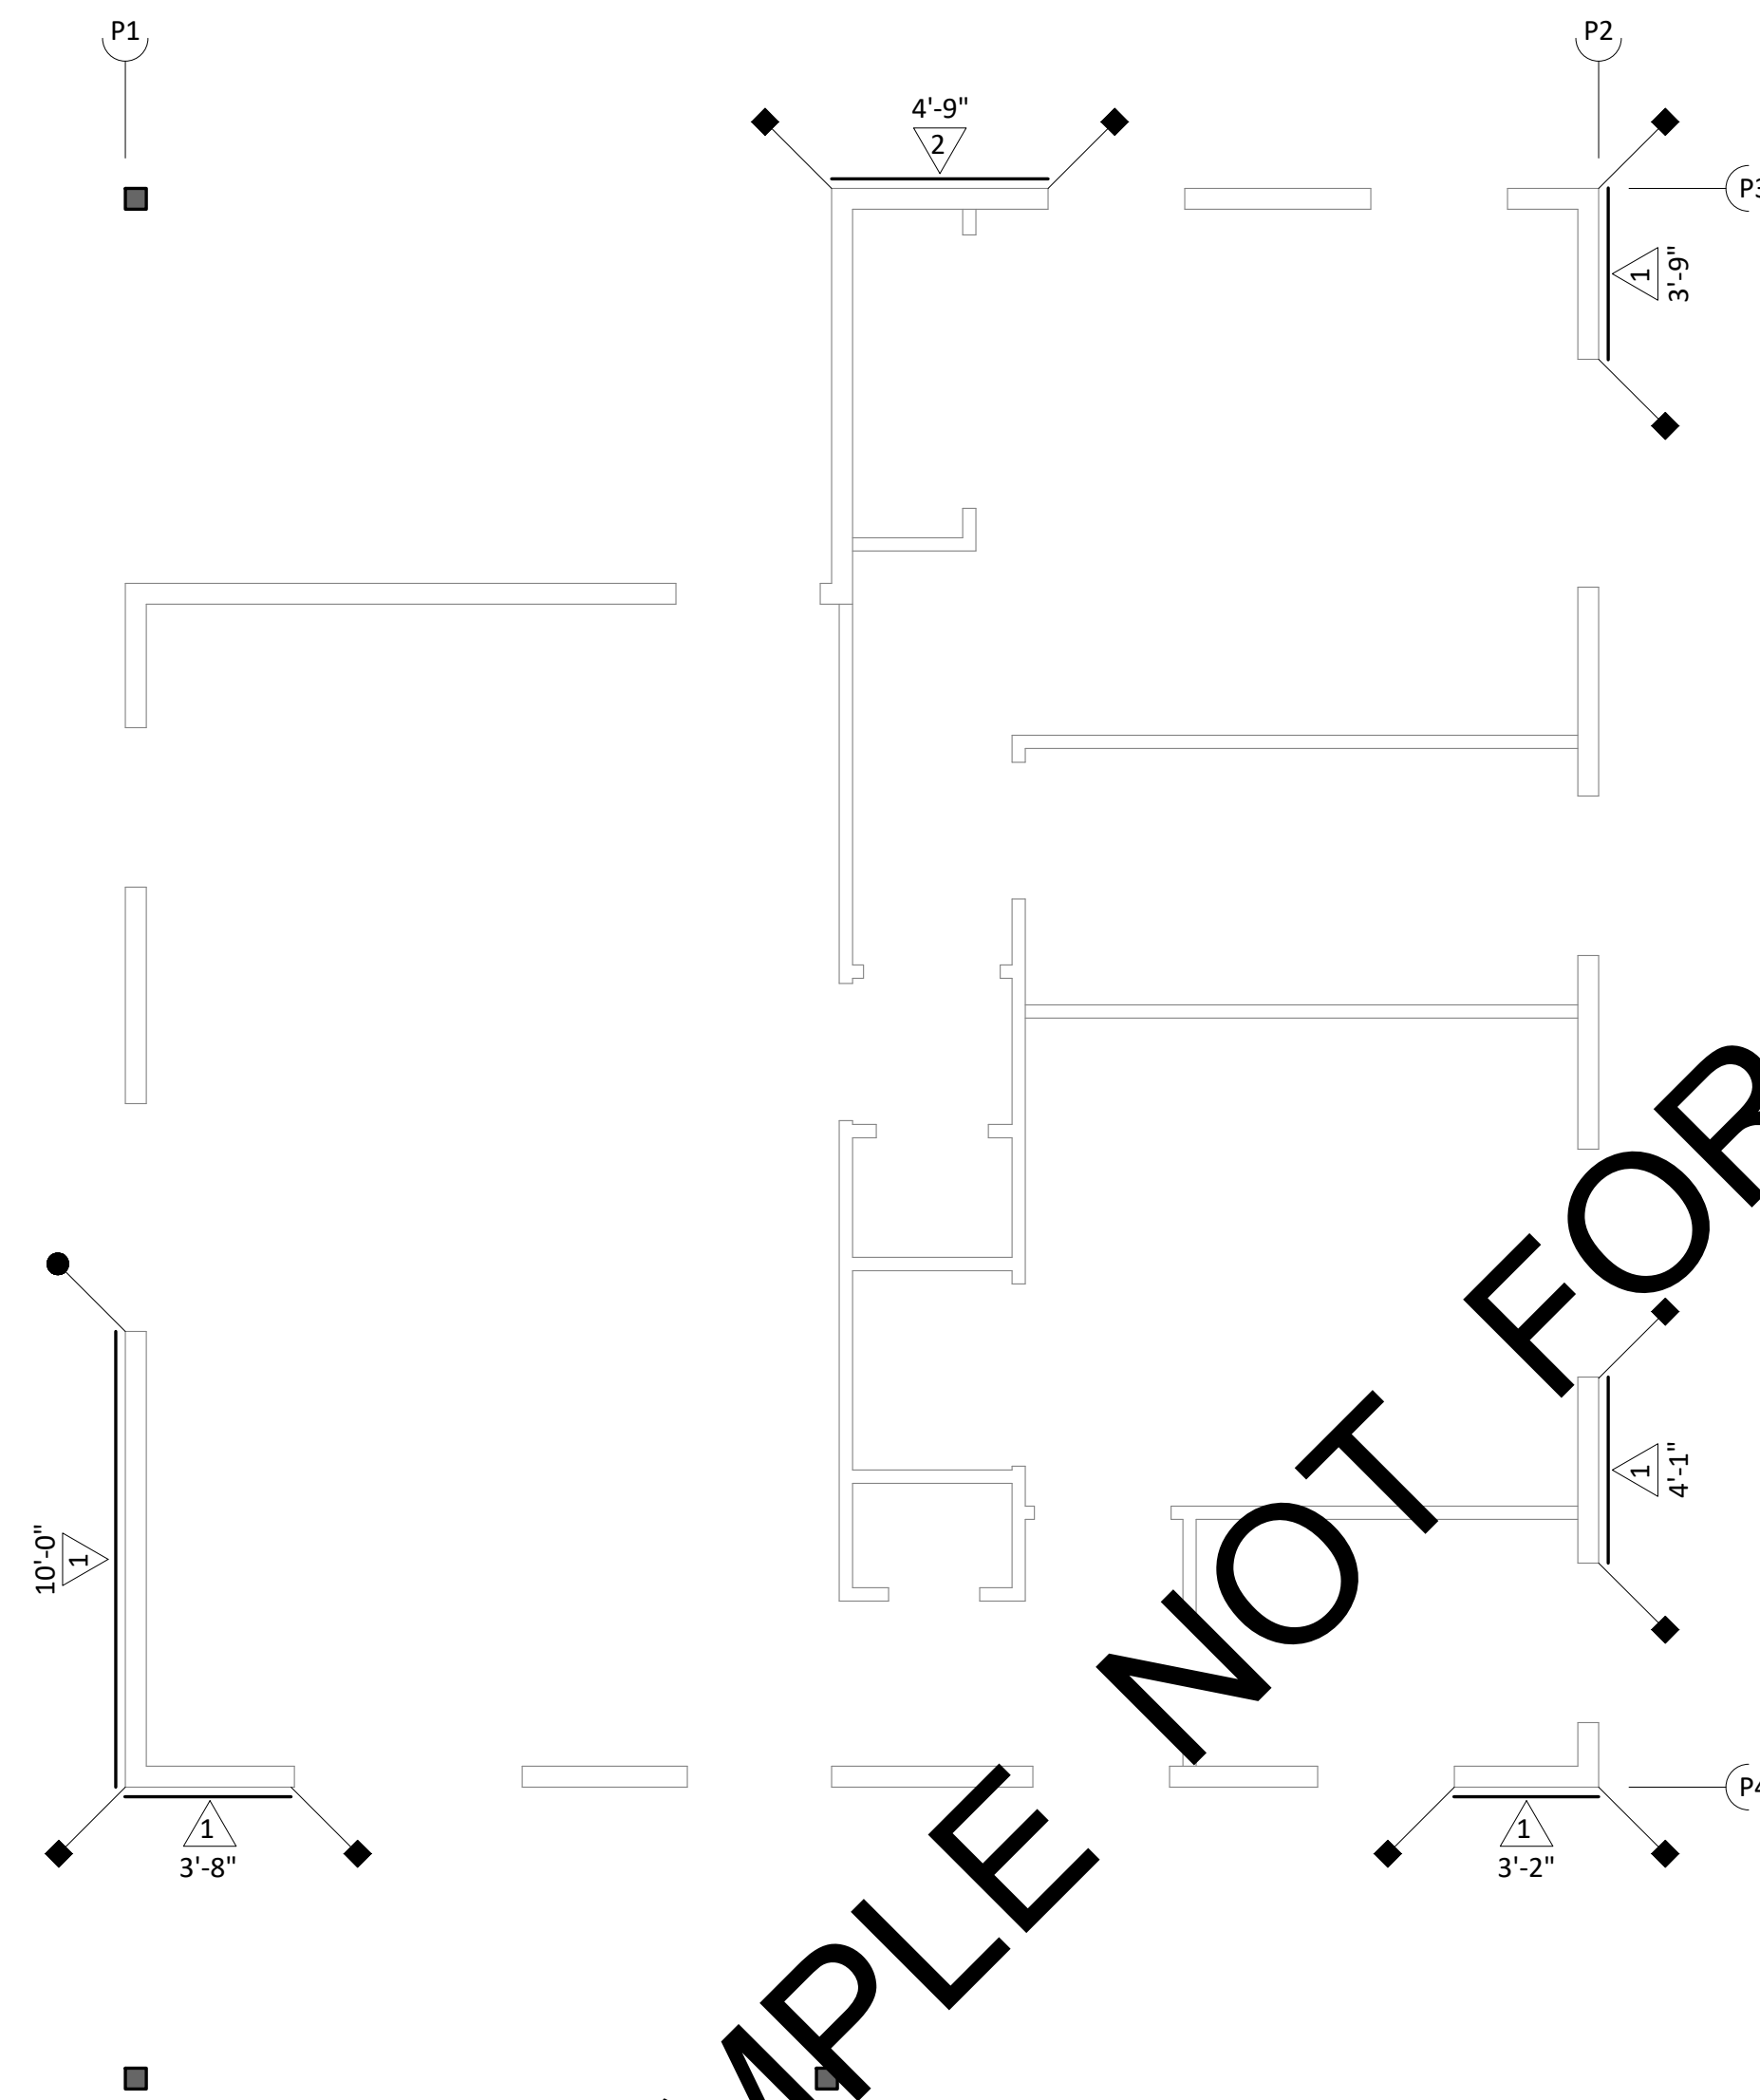

SHEARWALL PLAN

SCALE: 1/4" = 1'-0"



THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO WCD & ASSOCIATES, AND IS FURNISHED FOR THE PURPOSES OF REVIEW, BIDDING OR CONSTRUCTION OF THE PROJECT LISTED IN THE JOB TITLE BOX BELOW, AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF WCD. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF WCD. ALL RIGHTS RESERVED COPYRIGHT 2023.

TITLE: SHEARWALL PLAN
 ADDRESS: PERMIT READY
 ACCESSORY DWELLING UNIT PLANS - MODEL C

TITLE:
ADDRESS:



NO.	REVISIONS

SCALE: AS NOTED
 DATE: 4/15/2024
 DESIGNED BY: E.VILLALPANDO
 DRAWN BY: E.COURPET
 REVIEWED BY: W.CULLUMBER
 JOB NO: RN101022
 SHEET NO.

S2.0

ROOF BEAM SCHEDULE

NAME	PLY	SIZE	TYPE	LOCATION
RB1	1	6X6	DF-L#2	HEADER
RB2	1	6X8	DF-L#2	HEADER
RB3	1	6X6	DF-L#2	HEADER
RB4	1	6X12	PTDF-L#2	DROP
RB5	1	6X12	PTDF-L#2	DROP


- BEAMS SPECIFICATIONS:
- PSL 2900Fb, 290Fv, 2.2E
 - LVL 2600Fb, 285Fv, 1.8E
 - LSL 2300Fb, 285Fv, 1.55E
 - GLB 2400Fb, 265Fv, 1.9E

ROOF FRAMING NOTES

- SEE SHEET SD1 AND SD2 FOR ADDITIONAL FRAMING DETAILS.
- SEE "WOOD NOTES" ON SHEET SN1.
- ALL BEAM SUPPORTING POSTS ARE TO BE AT LEAST THE WIDTH OF THE BEAM BEING SUPPORTED.
- ROOF SHEATHING SHALL BE $\frac{3}{4}$ " STRUCT GRADE I WITH 8D @ 6" OC EN & 6" OC FIELD NAILING, U.N.O. 6" EDGE & 6" INTERMEDIATE AT EAVE END & OVERHANGS. $\frac{3}{2}$ SPAN RATING.
- NO EDGE BLOCKING REQUIRED, U.N.O.
- TOP PLATE SPLICE AT INTERIOR AND EXTERIOR WALLS SHALL BE 48" MIN. LENGTH AND NAILED WITH (16) 16d NAILS.
- ROOF OVERFRAME - 2x DF-L#2 @ 24" O.C. (ONE NOMINAL SIZE SMALLER THAN RIDGE BOARD) OVERFRAME AREA PROVIDE OPENINGS THROUGH ROOF SHEATHING BELOW INTO MAIN ATTIC SPACE FOR ADEQUATE VENTILATION. IN AREAS OF HEAD ROOM OF MORE THAN 30" HIGH PROVIDE A 22" x 30" ACCESS THROUGH MAIN ROOF SHEATHING (TYP).
- FOR BUILT-UP COLUMNS, PROVIDE (2) 10d NAILS @ 8" O.C. TO PROVIDE SOLID CONNECTION.
- EXTERIOR STUD WALLS SHALL BE 2X6 DF-L#2 @ 16" O.C. U.N.O.. WALL SIZES SHALL BE VERIFIED TO MATCH THE ARCHITECTURAL PLAN SET.
- BEAMS MAY BE SUBSTITUTED FOR LARGER WIDTHS AND/OR DEPTH OF EQUAL SPECIFICATIONS TO ACCOMMODATE WALL FRAMING. POSTS SHALL BE EQUAL OR LARGE SIZE THAN BEAM WIDTH.
- CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL TRUSS DIMENSIONS AND LOCATIONS BEFORE ORDERING TRUSSES. ENGINEER HAS ONLY VERIFIED SPECIFIC TRUSS MEMBERS FOR INTEGRATION WITH THE BUILDING DESIGN. NO DIMENSIONS HAVE BEEN CHECKED BY THE ENGINEER.
- ALL WOOD EXPOSED TO WATER FROM DIRECT OR BLOWING RAIN, SNOW, OR IRRIGATION TO BE PRESSURE TREATED.
- MAX GABLE END RAKE OVERHANG TO BE HALF OF THE TRUSS SPACING.

ROOF LEGEND


- BEAM PER BEAM SCHEDULE
 - INTERIOR NON-BEARING WALL
- *NOTE: ALL EXTERIOR WALLS SHALL BE BEARING WALLS
- POST SIZE
KING
POST - SEE IN VIEW FOR POST SIZE AND TYPE.

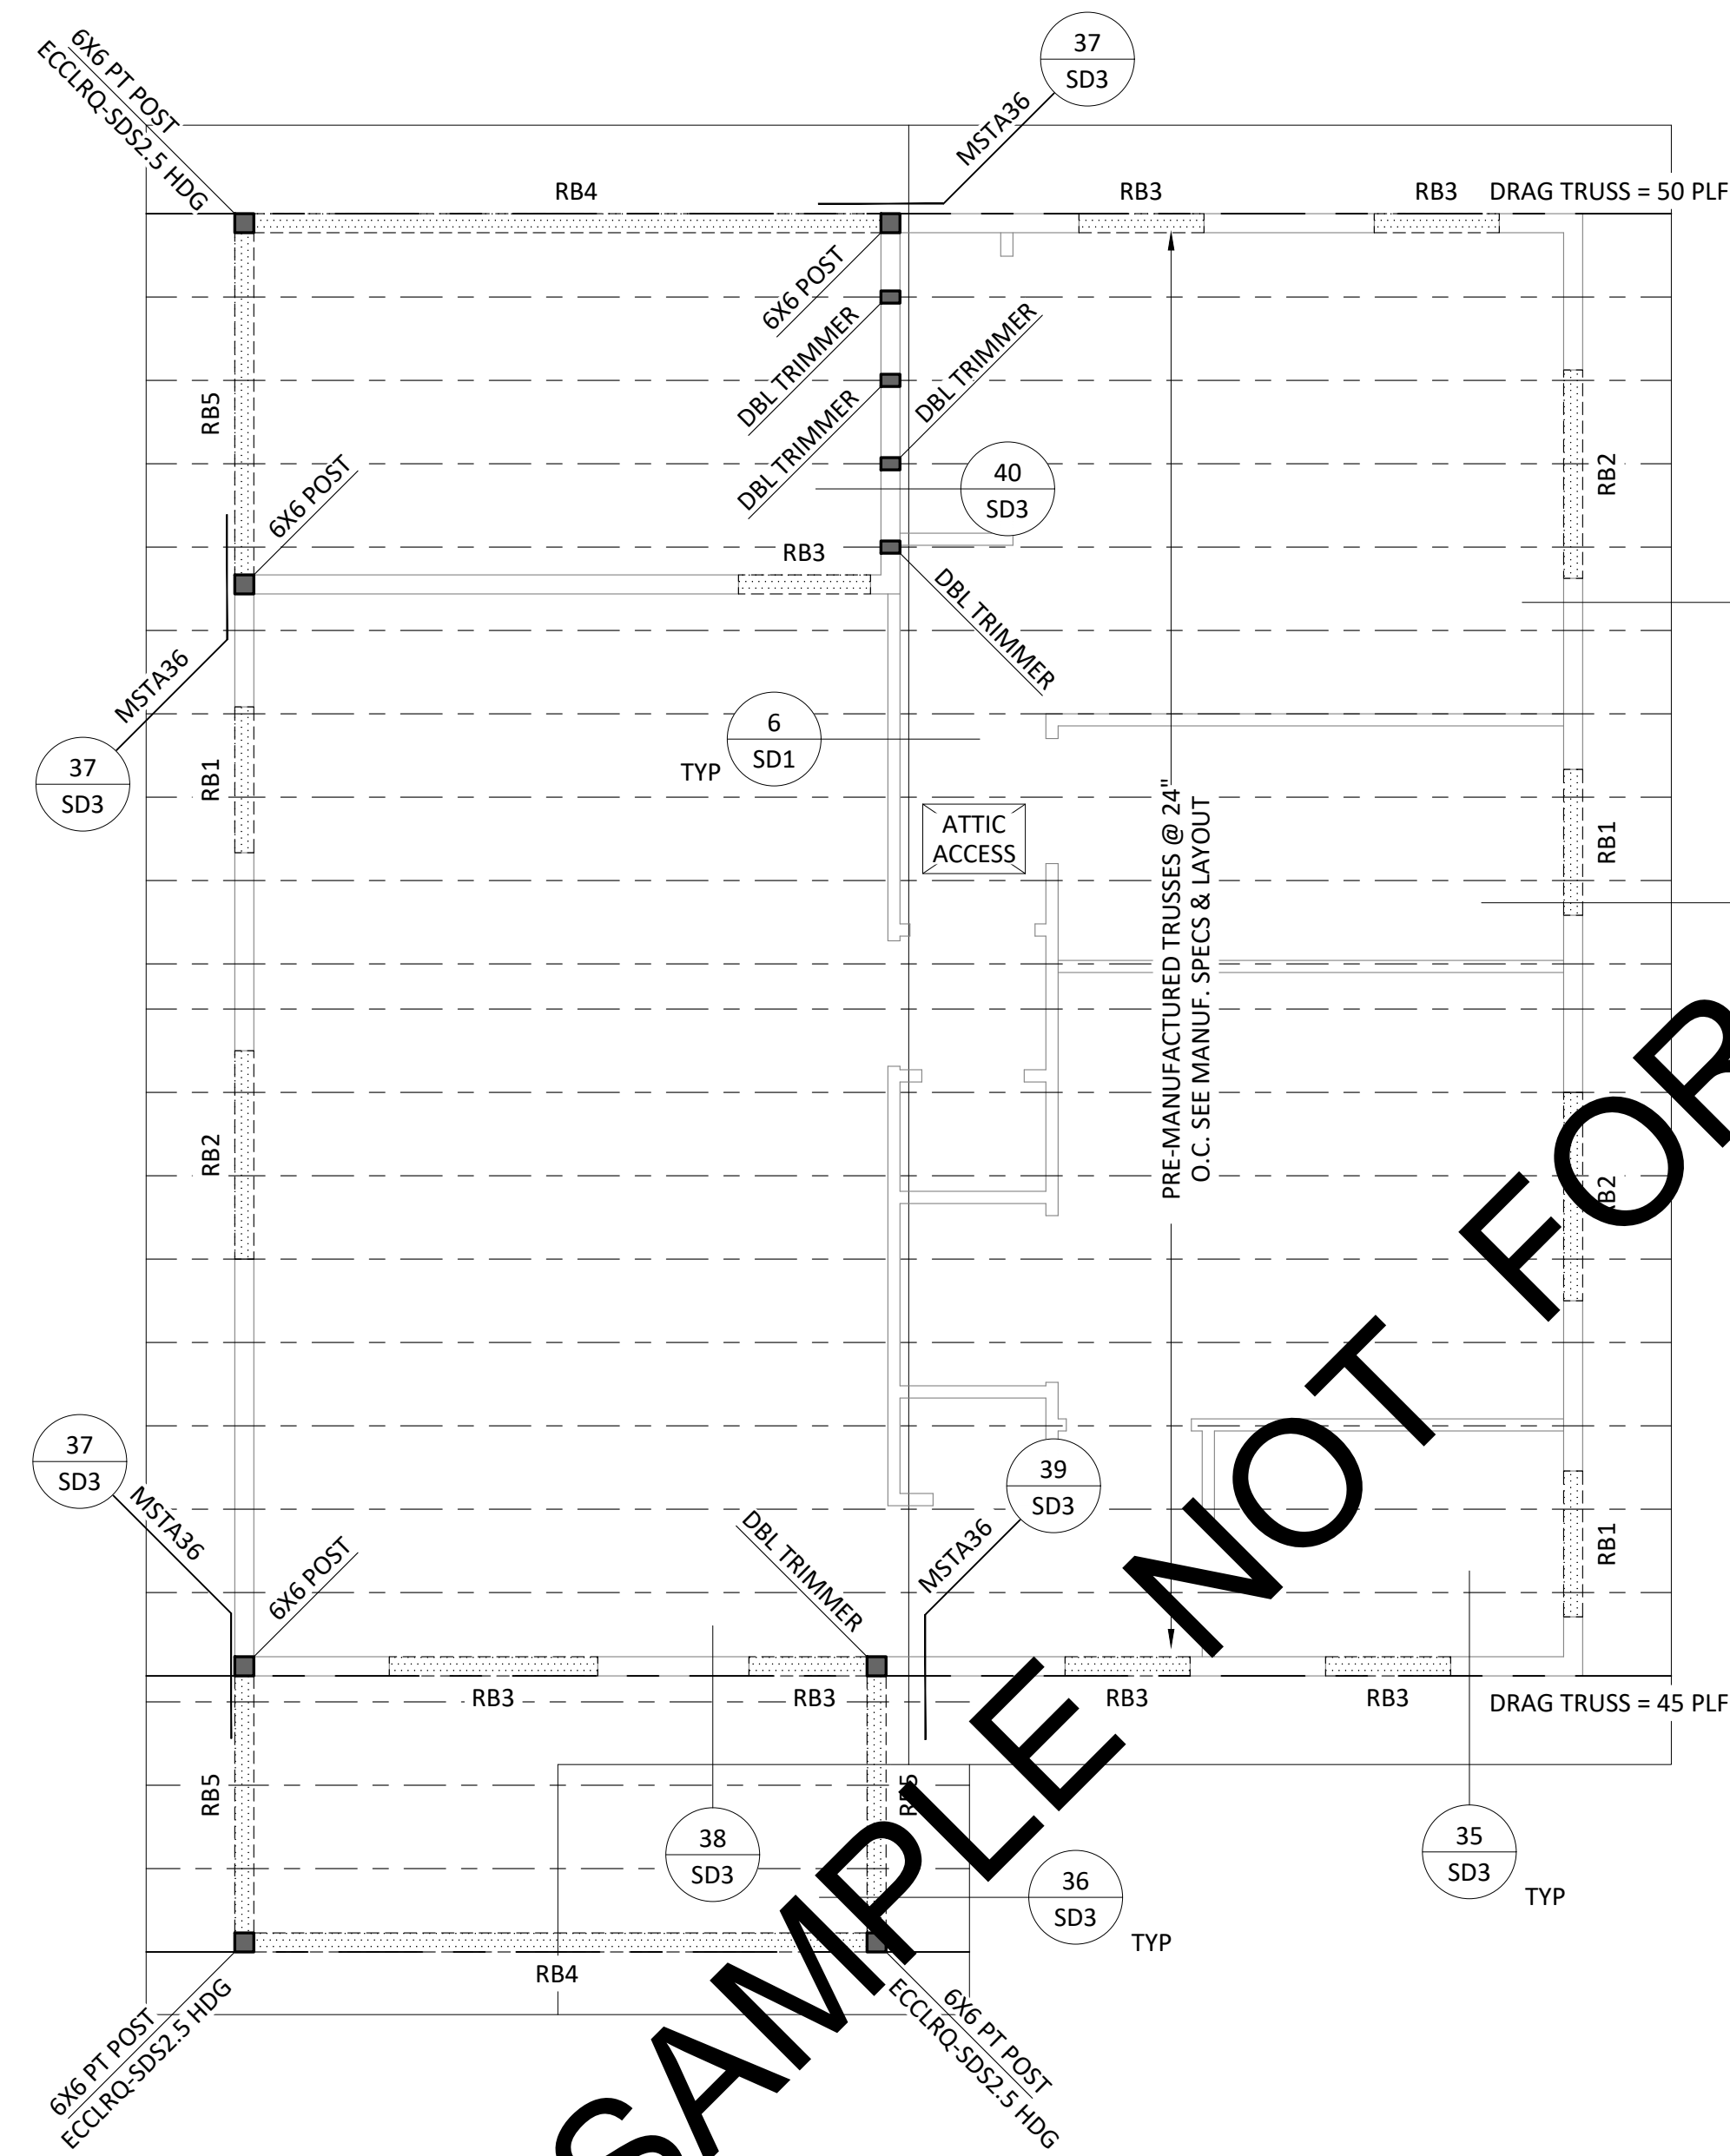

ROOF FRAMING PLAN

SCALE: 3/4" = 1'-0"

SAMPLE NOT FOR CONSTRUCTION

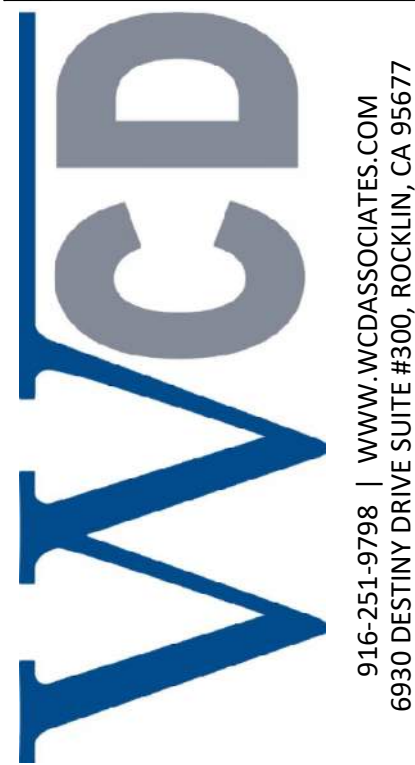


THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO WCD & ASSOCIATES, AND IS FURNISHED FOR THE PURPOSES OF REVIEW, BIDDING OR CONSTRUCTION OF THE PROJECT LISTED IN THE JOB TITLE BOX BELOW, AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF WCD. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF WCD. ALL RIGHTS RESERVED COPYRIGHT 2023.

ROOF FRAMING PLAN

PERMIT READY
ACCESSORY DWELLING UNIT PLANS - MODEL C

TITLE:



ADDRESS:

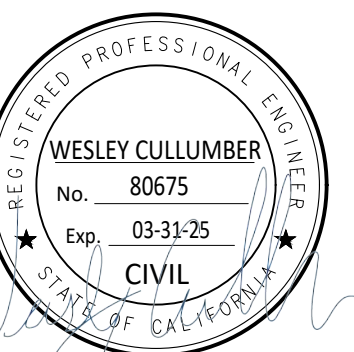

NO.	REVISIONS

SCALE: AS NOTED
DATE: 4/15/2024
DESIGNED BY: E.VILLALPANDO
DRAWN BY: E.COURPET
REVIEWED BY: W.CULLUMBER
JOB NO: RN101022
SHEET NO.

S3.0

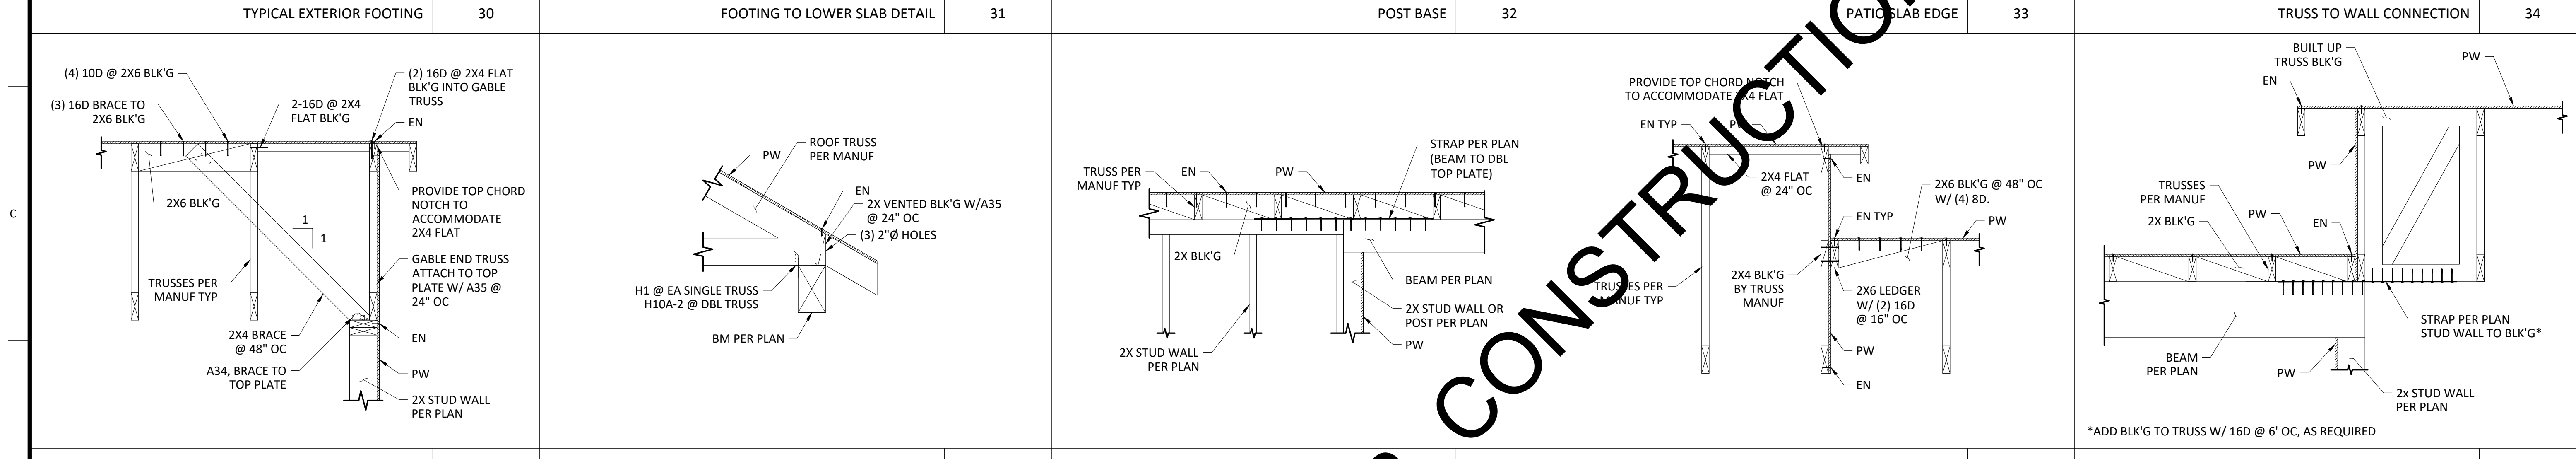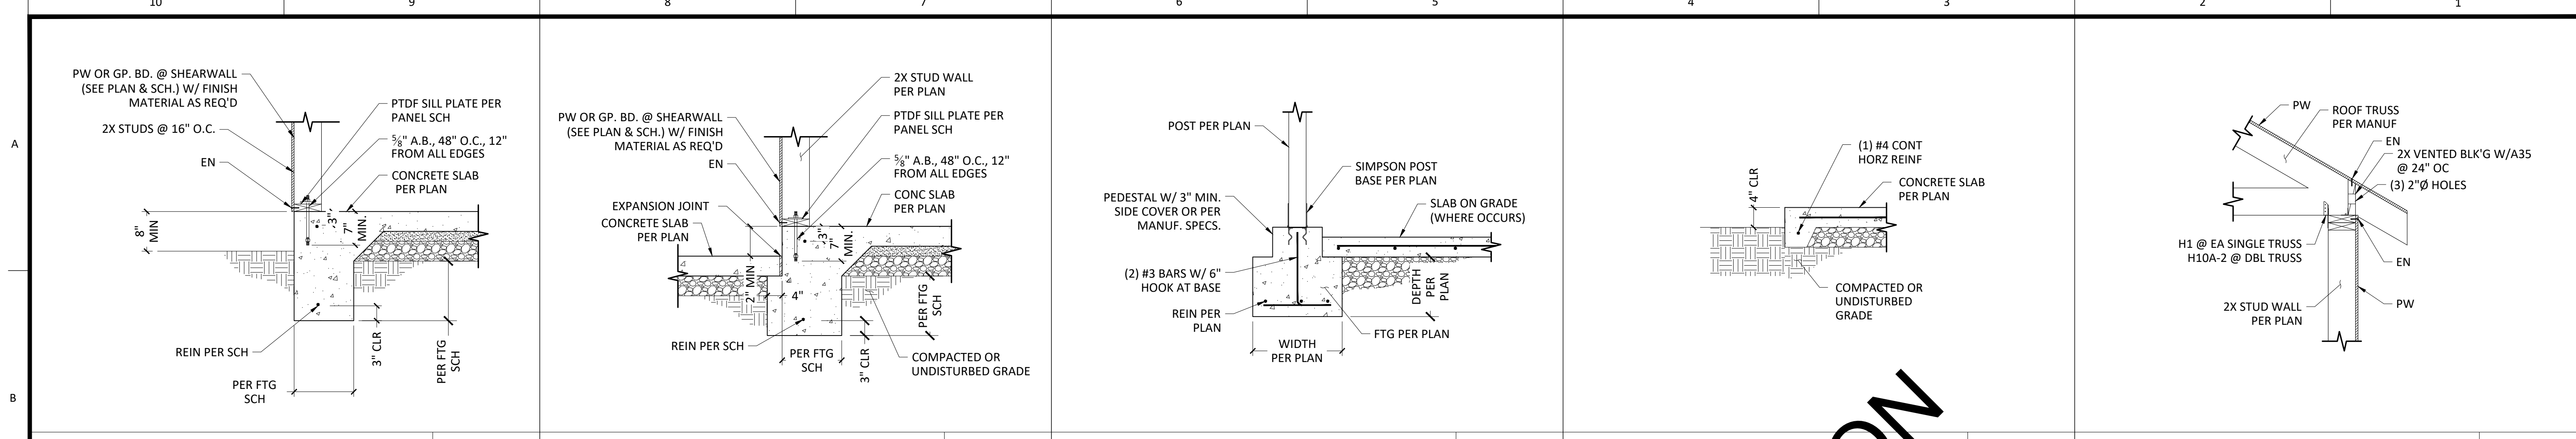


SAMPLE NOT FOR CONSTRUCTION

WCD
 916-251-9788 | WWW.WCDASSOCIATES.COM
 6930 DESTINY DRIVE SUITE #300, ROCKLIN, CA 95677

THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO WCD & ASSOCIATES, AND IS FURNISHED FOR THE PURPOSES OF REVIEW, BIDDING OR CONSTRUCTION OF THE PROJECT LISTED IN THE JOB TITLE BOX BELOW, AND SHALL NOT BE USED FOR ANY OTHER PURPOSE OR RELEASED TO ANY OTHER PARTY WITHOUT THE WRITTEN CONSENT OF WCD. INFORMATION CONTAINED HEREIN IS AN INSTRUMENT OF PROFESSIONAL SERVICES AND SHALL REMAIN THE PROPERTY OF WCD. ALL RIGHTS RESERVED COPYRIGHT 2023.

STRUCTURAL DETAILS
 PERMIT READY
 ACCESSORY DWELLING UNIT PLANS - MODEL C

TITLE:
 ADDRESS:

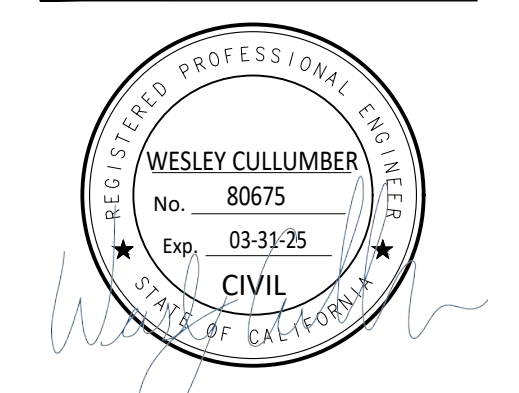

NO.	REVISIONS

SCALE: AS NOTED
 DATE: 4/15/2024
 DESIGNED BY: E.VILLALPANDO
 DRAWN BY: E.COURPET
 REVIEWED BY: W.CULLUMBER
 JOB NO: RN101022
 SHEET NO.

SD3

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU
 Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 1 of 12)

GENERAL INFORMATION			
01	Project Name	Model C ADU	
02	Run Title	Title 24 Analysis	
03	Project Location	Sacramento Project	
04	City	Sacramento County	05 Standards Version
06	Zip code	90000	07 Software Version
08	Climate Zone	12	09 Front Orientation (deg/ Cardinal)
10	Building Type	Single family	11 Number of Dwelling Units
12	Project Scope	Newly Constructed	13 Number of Bedrooms
14	Addition Cond. Floor Area (ft ²)	0	15 Number of Stories
16	Existing Cond. Floor Area (ft ²)	n/a	17 Fenestration Average U-factor
18	Total Cond. Floor Area (ft ²)	998	19 Glazing Percentage (%)
20	ADU Bedroom Count	n/a	21 ADU Conditioned Floor Area
22	Fuel Type	All electric	23 Occupancy U

COMPLIANCE RESULTS	
01	Building Complies with Computer Performance
02	This building incorporates features that require field testing and/or verification by a certified HERS rater under the supervision of a CEC-approved HERS provider.
03	This building incorporates one or more Special Features shown below

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU
 Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 2 of 12)

ENERGY DESIGN RATINGS	Energy Design Ratings			Compliance Margins		
	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)	Source Energy (EDR1)	Efficiency ¹ EDR (EDR2efficiency)	Total ² EDR (EDR2total)
Standard Design	34.5	35.1	32.6			
Proposed Design						
North Facing	28.4	28.7	28.5	6.1	6.4	4.1
East Facing	28.5	28.6	28.5	6	6.5	4.1
South Facing	28.2	28	28.1	6.3	7.1	4.5
West Facing	28.3	28.8	28.6	6.2	6.3	4
RESULT: PASS						

¹ Efficiency EDR includes improvements like a better building envelope and more efficient equipment.
² Total EDR includes efficiency and demand response measures such as photovoltaic (PV) system and batteries.
 * Building complies when source energy, efficiency and total compliance margins are greater than or equal to zero and unmet load hour limits are not exceeded.

- Standard Design PV Capacity: 2.15 kWdc
- Proposed PV Capacity Scaling: North (2.15 kWdc) East (2.15 kWdc) South (2.15 kWdc) West (2.15 kWdc)

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU
 Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 3 of 12)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDU/ft ² -yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDU/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	5.28	35.82	3.26	24.89	2.02	10.93
Space Cooling	0.9	26.6	0.81	26.95	0.09	-0.35
IAQ Ventilation	0.4	4.29	0.4	4.29	0	0
Water Heating	2.66	27.12	1.81	20.67	0.85	6.45
Self Utilization/Flexibility Credit				0		0
North Facing Efficiency Compliance Total	9.24	93.83	6.28	76.8	2.96	17.03
Space Heating	5.28	35.82	3.51	25.2	1.97	10.62
Space Cooling	0.9	26.6	0.8	26.47	0.1	0.13
IAQ Ventilation	0.4	4.29	0.4	4.29	0	0
Water Heating	2.66	27.12	1.81	20.66	0.85	6.46
Self Utilization/Flexibility Credit				0		0
East Facing Efficiency Compliance Total	9.24	93.83	6.32	76.62	2.92	17.21

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU
 Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 4 of 12)

ENERGY USE SUMMARY						
Energy Use	Standard Design Source Energy (EDR1) (kBtu/ft ² -yr)	Standard Design TDV Energy (EDR2) (kTDU/ft ² -yr)	Proposed Design Source Energy (EDR1) (kBtu/ft ² -yr)	Proposed Design TDV Energy (EDR2) (kTDU/ft ² -yr)	Compliance Margin (EDR1)	Compliance Margin (EDR2)
Space Heating	5.28	35.82	3.21	24.32	2.07	11.5
Space Cooling	0.9	26.6	0.77	25.57	0.13	1.03
IAQ Ventilation	0.4	4.29	0.4	4.29	0	0
Water Heating	2.66	27.12	1.81	20.65	0.85	6.47
Self Utilization/Flexibility Credit				0		0
South Facing Efficiency Compliance Total	9.24	93.83	6.19	74.83	3.05	19
Space Heating	5.28	35.82	3.18	24.17	2.1	11.65
Space Cooling	0.9	26.6	0.85	27.87	0.05	-1.27
IAQ Ventilation	0.4	4.29	0.4	4.29	0	0
Water Heating	2.66	27.12	1.81	20.64	0.85	6.48
Self Utilization/Flexibility Credit				0		0
West Facing Efficiency Compliance Total	9.24	93.83	6.24	76.97	3	16.86

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU
 Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 5 of 12)

ENERGY USE INTENSITY				
	Standard Design (kBtu/ft ² -yr)	Proposed Design (kBtu/ft ² -yr)	Compliance Margin (kBtu/ft ² -yr)	Margin Percentage
North Facing				
Gross EU1 ¹	23.27	20.02	3.25	13.97
Net EU2 ²	11.75	5	3.25	27.66
East Facing				
Gross EU1 ¹	23.27	20.08	3.19	13.71
Net EU2 ²	11.75	8.56	3.19	27.15
South Facing				
Gross EU1 ¹	23.27	19.93	3.34	14.35
Net EU2 ²	11.75	8.41	3.34	28.43
West Facing				
Gross EU1 ¹	23.27	20.03	3.24	13.92
Net EU2 ²	11.75	8.52	3.23	27.49

Notes:
 1. Gross EU1 is Energy Use Total (not including PV) / Total Building Area.
 2. Net EU2 is Energy Use Total (including PV) / Total Building Area.

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU
 Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis
 Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 6 of 12)

REQUIRED PV SYSTEMS											
01	02	03	04	05	06	07	08	09	10	11	12
DC System Size (kWdc)	Exception	Module Type	Array Type	Power Electronics	CFI	Azimuth (deg)	Tilt Input	Array Angle (deg)	Tilt: (x in 12)	Inverter Eff. (%)	Annual Solar Access (%)
2.15	NA	Standard (14-17%)	Fixed	none	true	150-270	n/a	n/a	<=7:12	96	98

REQUIRED SPECIAL FEATURES						
The following are features that must be installed as condition for meeting the modeled energy performance for this computer analysis.						
<ul style="list-style-type: none"> Variable capacity heat pump compliance option (verification details from VCHP Staff report, Appendix B, and RA3) Northwest Energy Efficiency Alliance (NEEA) rated heat pump water heater; specific brand/model, or equivalent, must be installed 						

HERS FEATURE SUMMARY						
The following is a summary of the features that must be field-verified by a certified HERS Rater as a condition for meeting the modeled energy performance for this computer analysis. Additional detail is provided in the building tables below. Registered CF2Rs and CF3Rs are required to be completed in the HERS Registry.						
<ul style="list-style-type: none"> Indoor air quality ventilation Kitchen range hood Verified Refrigerant Charge Airflow in habitable rooms (SC3.1.4.1.7) Verified heat pump rated heating capacity Wall-mounted thermostat in zones greater than 150 ft2 (SC3.4.5) Ductless indoor units located entirely in conditioned space (SC3.1.4.1.8) 						

BUILDING - FEATURES INFORMATION						
01	02	03	04	05	06	07
Project Name	Conditioned Floor Area (ft ²)	Number of Dwelling Units	Number of Bedrooms	Number of Zones	Number of Ventilation Cooling Systems	Number of Water Heating Systems
Model C ADU	998	1	2	1	0	1

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

compuCalc@title24energyreports.com
 title24energyreports.com
 (530) 268-8722

CompuCalc
 Title 24 Compliance
 Jeff Travis
 Certified Energy Analyst
 R19-22-30127

2022 Title 24 Part 6
 Energy Code

Sheet:
 T24-1

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 7 of 12)

01	02	03	04	05	06	07
Zone Name	Zone Type	HVAC System Name	Zone Floor Area (ft²)	Avg. Ceiling Height	Water Heating System 1	Status
ADU	Conditioned	Res HVAC1	998	8	DHW Sys 1	New

01	02	03	04	05	06	07	08
Name	Zone	Construction	Azimuth	Orientation	Gross Area (ft²)	Window and Door Area (ft²)	Tilt (deg)
Front Wall	ADU	R-21 Wall	0	Front	259	64	90
Back Wall	ADU	R-21 Wall	180	Back	259	44	90
Right Wall	ADU	R-21 Wall	270	Right	282	54	90
Left Wall	ADU	R-21 Wall	90	Left	230	32.25	90
Attic	ADU	R-38 Roof Attic	n/a	n/a	n/a	n/a	n/a

01	02	03	04	05	06	07	08
Name	Construction	Type	Roof Rise (k in 12)	Roof Reflectance	Roof Emittance	Radiant Barrier	Cool Roof
Attic ADU	Attic RoofADU	Ventilated	4	0.1	0.85	No	No

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
F1 WA	Window	Front Wall	Front	0			1	20	0.3	NFRC	0.23	NFRC	Bug Screen
F2 D1	Window	Front Wall	Front	0			1	20	0.3	NFRC	0.23	NFRC	Bug Screen
F3 WB	Window	Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 8 of 12)

01	02	03	04	05	06	07	08	09	10	11	12	13	14
Name	Type	Surface	Orientation	Azimuth	Width (ft)	Height (ft)	Mult.	Area (ft²)	U-factor	U-factor Source	SHGC	SHGC Source	Exterior Shading
F4 WB	Window	Front Wall	Front	0			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
B1 D10	Window	Back Wall	Back	180			1	20	0.3	NFRC	0.23	NFRC	Bug Screen
B2 WB	Window	Back Wall	Back	180			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
B3 WB	Window	Back Wall	Back	180			1	12	0.3	NFRC	0.23	NFRC	Bug Screen
R1 WC	Window	Right Wall	Right	270			1	7	0.3	NFRC	0.23	NFRC	Bug Screen
R2 WD	Window	Right Wall	Right	270			1	20	0.3	NFRC	0.23	NFRC	Bug Screen
R3 WC	Window	Right Wall	Right	270			1	7	0.3	NFRC	0.23	NFRC	Bug Screen
R4 WD	Window	Right Wall	Right	270			1	20	0.3	NFRC	0.23	NFRC	Bug Screen
L1 WA	Window	Left Wall	Left	90			1	20	0.3	NFRC	0.23	NFRC	Bug Screen
L2 WE	Window	Left Wall	Left	90			1	12.25	0.3	NFRC	0.23	NFRC	Bug Screen

01	02	03	04	05	06	07	08
Name	Zone	Area (ft²)	Perimeter (ft)	Edge Insul. R-value and Depth	Edge Insul. R-value and Depth	Carpeted Fraction	Heated
Slab-on-Grade	ADU	870	119	none	0	80%	No

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 9 of 12)

01	02	03	04	05	06	07	08
Construction Name	Surface Type	Construction Type	Framing	Total Cavity R-value	Interior / Exterior Continuous R-value	U-factor	Assembly Layers
R-21 Wall	Exterior Walls	Wood Framed Wall	2x6 @ 16 in. O. C.	R-21	None / None	0.068	Inside Finish: Gypsum Board Cavity / Frame: R-21 / 2x6 Exterior Finish: All Other Siding
Attic RoofADU	Attic Roofs	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-0	None / 0	0.644	Roofing: Light Roof (Asphalt Shingle) Roof Deck: Wood Siding/Sheathing/Decking Cavity / Frame: no insul. / 2x4
R-38 Roof Attic	Ceilings (below attic)	Wood Framed Ceiling	2x4 @ 24 in. O. C.	R-38	None / None	0.025	Over Ceiling Joists: R-28.9 Insul. Cavity / Frame: R-9.1 / 2x4 Inside Finish: Gypsum Board

01	02	03	04	05
Quality	Installation (QI)	High R-value Spray Foam Insulation	Building Envelope Air Leakage	CFM50
Not Required	Not Required	N/A	n/a	n/a

01	02	03	04	05	06	07	08	09
Name	System Type	Distribution Type	Water Heater Name	Number of Units	Solar Heating System	Compact Distribution	HERS Verification	Water Heater Name (#)
DHW Sys 1	Domestic Hot Water (DHW)	Standard	DHW Heater 1	1	n/a	None	n/a	DHW Heater 1 (1)

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 10 of 12)

01	02	03	04	05	06	07	08
Name	# of Units	Tank Vol. (gal)	NEEA Heat Pump Brand	NEEA Heat Pump Model	Tank Location	Duct Inlet Air Source	Duct Outlet Air Source
DHW Heater 1	1	40	Generic	Tier3Generic40	Outside	ADU	ADU

01	02	03	04	05	06	07
Name	Pipe Insulation	Parallel Piping	Compact Distribution	Compact Distribution Type	Recirculation Control	Shower Drain Water Heat Recovery
DHW Sys 1 - 1/1	Not Required	Not Required	Not Required	None	Not Required	Not Required

01	02	03	04	05	06	07	08	09
Name	System Type	Heating Unit Name	Heating Equipment Count	Cooling Unit Name	Cooling Equipment Count	Fan Name	Distribution Name	Required Thermostat Type
Res HVAC1	Heat pump heating cooling	Heat Pump System 1	1	Heat Pump System 1	1	n/a	n/a	Setback

01	02	03	04	05	06	07	08	09	10	11	12	13
Name	System Type	Number of Units	Heating			Cooling			Zonally Controlled	Compressor Type	HERS Verification	
			Efficiency Type	HSPF / HSPF2 / COP	Cap 47	Cap 17	Efficiency Type	SEER / SEER2				EER / EER / CEER
Heat Pump System 1	VCHP-ductless	1	HSPF2	7.5	10900	6700	EER2SEER2	14.3	9	Not Zonal	Single Speed	Heat Pump System 1-hers-htpump

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 11 of 12)

01	02	03	04	05	06	07	08	09
Name	Verified Airflow	Airflow Target	Verified EER/EER2	Verified SEER/SEER2	Verified Refrigerant Charge	Verified HSPF/HSPF2	Verified Heating Cap 47	Verified Heating Cap 17
Heat Pump System 1-hers-htpump	Not Required	0	Not Required	Not Required	Yes	No	Yes	Yes

01	02	03	04	05	06	07	08	09	10
Name	Certified Low-Static VCHP System	Flow Restricted Room	Ductless Units Conditioned Space	Wall Mount Thermostat	Air Filter Sizing & Pressure Drop Rating	Low Leakage Ducts in Conditioned Space	Minimum Airflow per RA3.3 and SC3.3.4.1.1	Certified non-continuous Fan	Indoor Fan not Running Continuously
Heat Pump System 1	Not required	Not required	Required	Required	Not required	Not required	Not required	Not required	Not required

01	02	03	04	05	06	07	08	09
Dwelling Unit	Airflow (CFM)	Fan Efficacy (W/CFM)	IAQ Fan Type	Includes Heat/Energy Recovery?	IAQ Recovery Effectiveness - SRE	Includes Fault Indicator Display?	HERS Verification	Status
Sfam IAQVent		0.35	Exhaust	No	n/a / n/a	No	Yes	

Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

CERTIFICATE OF COMPLIANCE - RESIDENTIAL PERFORMANCE COMPLIANCE METHOD

Project Name: Model C ADU Calculation Date/Time: 2023-09-01T15:57:05-07:00
 Calculation Description: Title 24 Analysis Input File Name: Model C ADU with Sacramento Project.rbd22x

CF1R-PRF-01E
 (Page 12 of 12)

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT	
I, I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: Jeff Travis	Documentation Author Signature: <i>Jeff Travis</i>
Company: CompuCalc	Signature Date: 2023-09-05 12:56:25
Address: 5201 Coventry Dr., Riverside, CA 92506	CEA/HERS Certification Identification (if applicable): R19-22-30127
City/State/Zip: Riverside, CA 92506	Phone: 951-902-2660
RESPONSIBLE PERSON'S DECLARATION STATEMENT	
I certify the following under penalty of perjury, under the laws of the State of California:	
1. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design identified on this Certificate of Compliance. 2. I certify that the energy features and performance specifications identified on this Certificate of Compliance conform to the requirements of Title 24, Part 3 and Part 6 of the California Code of Regulations. 3. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.	
Responsible Designer Name: Laura Miller	Responsible Designer Signature: <i>Laura Miller</i>
Company: Miller Design Studio	Date Signed: 2023-09-05 15:15:26
Address: 2656 Harkness Street	License: NA
City/State/Zip: Sacramento, CA 95818	Phone: 916-607-3321

Digitally signed by CalCERTS. This digital signature is provided in order to secure the content of this registered document, and in no way implies Registration Provider responsibility for the accuracy of the information.



Registration Number: 223-P016682809A-000-000-0000000-0000
 CA Building Energy Efficiency Standards - 2022 Residential Compliance
 Registration Date/Time: 2023-09-05 15:15:26
 Report Version: 2022.0.000
 Schema Version: rev 20220901
 HERS Provider: CalCERTS Inc.
 Report Generated: 2023-09-01 15:57:57

compuCalc@title24energyreports.com
 title24energyreports.com
 (530) 268-8722

CompuCalc
 Title 24 Compliance
 Jeff Travis
 Certified Energy Analyst

2022 Title 24 Part 6
 Energy Code

Sheet:
 T24-2

From Section 150.0(o) G. Local mechanical exhaust

Local mechanical exhaust. A local mechanical exhaust system shall be installed in each kitchen and bathroom. Systems shall be rated for airflow in accordance with ASHRAE 62.2 Section 7.1.

- Nonenclosed kitchens shall have a demand-controlled mechanical exhaust system meeting the requirements of Section 150.0(o)(1)(i).
- Enclosed kitchens and all bathrooms shall have either one of the following alternatives a or b:
 - A demand-controlled mechanical exhaust system meeting the requirements of Section 150.0(o)(1)(i).
 - A continuous mechanical exhaust system meeting the requirements of Section 150.0(o)(1)(iv).
- Demand-controlled mechanical exhaust. A local mechanical exhaust system shall be designed to be operated as needed.
 - Control and operation. Demand-controlled mechanical exhaust systems shall be provided with at least one of the following controls:
 - A readily accessible occupant-controlled ON-OFF control.
 - An automatic control that does not impede occupant ON control.
 - Ventilation rate and capture efficiency. The system shall meet or exceed either the minimum airflow in accordance with Table 150.0-E or the minimum capture efficiency in accordance with Table 150.0-E, and Table 150.0-G. Capture efficiency ratings shall be determined in accordance with ASTM E3087 and listed in a product directory approved by the Energy Commission.
- Continuous mechanical exhaust. A mechanical exhaust system shall be installed to operate continuously. The system may be part of a balanced mechanical ventilation system.
 - Control and operation. A manual ON-OFF control shall be provided for each continuous mechanical exhaust system. The system shall be designed to operate during all occupiable hours. The ON-OFF control shall be accessible to the dwelling unit occupant.
 - Ventilation rate. The minimum delivered ventilation shall be at least the amount indicated in Table 150.0-F during each hour of operation.
- Airflow measurement of local mechanical exhaust by the system installer. The airflow required by Section 150.0(o)(1) is the quantity of indoor air exhausted by the ventilation system as installed in the dwelling unit. When a vented range hood utilizes a capture efficiency rating to demonstrate compliance with Section 150.0(o)(1)(iii), the airflow listed in the approved directory corresponding to the compliant capture efficiency rating point shall be met by the installed system. The as-installed airflow shall be verified by the system installer to ensure compliance by use of either Subsection a or b below:
 - The system installer shall measure the airflow by using a flow hood, flow grid or other airflow measuring device at the mechanical ventilation fan/terminals, or air terminals/grilles or outlet terminals/grilles in accordance with the procedures in Reference Residential Appendix RA3.7.
 - As an alternative to performing an airflow measurement of the system as installed in the dwelling unit, compliance may be demonstrated by installing an exhaust fan and duct system that conforms to the specifications of Table 150.0-H. Visual inspection shall verify the installed system conforms to the requirements of Table 150.0-H.

When using Table 150.0-H for demonstrating compliance, the airflow rating shall be greater than or equal to the value required by Section 150.0(o)(1) at a static pressure greater than or equal to 0.25 in. of water (62.5 Pa). When a vented range hood utilizes a capture efficiency rating to demonstrate compliance with Section 150.0(o)(1)(iii), a static pressure greater than or equal to 0.25 in. of water at the rating point shall not be required, and the airflow listed in the approved directory corresponding to the compliant capture efficiency rating point shall be applied to Table 150.0-H for determining compliance.

- Use of Table 150.0-H is limited to ventilation systems that conform to all of the following three specifications:
- Total duct length is less than or equal to 25 ft (8 m).
 - Duct system has not more than three elbows, and
 - Duct system has exterior termination fitting with a hydraulic diameter greater than or equal to the minimum duct diameter and not less than the hydraulic diameter of the fan outlet.

Table 150.0-G Kitchen Range Hood Airflow Rates (fm) and ASTM E3087 Capture Efficiency (CE) Ratings According to Dwelling Unit Floor Area and Kitchen Range Fuel Type

Dwelling Unit Floor Area (ft ²)	Hood Over Electric Range	Hood Over Natural Gas Range
<1500	50% CE or 110 CFM	70% CE or 180 CFM
>1000 <1500	50% CE or 110 CFM	80% CE or 250 CFM
750 - 1000	55% CE or 110 CFM	85% CE or 280 CFM
<750	65% CE or 110 CFM	85% CE or 280 CFM

From Section 150.0 (n) (s)(1)(v)(v) – MANDATORY FEATURES AND DEVICES

- Water heating system.**
 - Systems using gas or propane water heaters to serve individual dwelling units shall designate a space at least 2.5 feet by 2.5 feet tall suitable for the future installation of a heat pump water heater (HPWH) by meeting either A or B below. All electrical components shall be installed in accordance with the California Electrical Code.
 - If the designated space is within 3 feet from the water heater, then this space shall include the following:
 - A dedicated 125 volt, 20 amp electrical receptacle that is connected to the electric panel with a 120/240-volt 3 conductor, 10 AWG copper branch circuit, within 3 feet from the water heater and accessible to the water heater with no obstructions; and
 - Both ends of the unused conductor shall be labeled with the words "space" and be electrically isolated; and
 - A reserved single pole circuit breaker space in the electrical panel adjacent to the circuit breaker for the branch circuit in A above and labeled with the words "Future 240V Use"; and
 - A condensate drain that is no more than 2 inches higher than the base of the installed water heater, and allows natural draining without pump assistance.
 - If the designated space is more than 3 feet from the water heater, then this space shall include the following:
 - A dedicated 240 volt branch circuit shall be installed within 3 feet from the designated space. The branch circuit shall be rated at 30 amps minimum. The blank cover shall be identified as "240V ready"; and
 - The main electrical service panel shall have a reserved space to allow for the installation of a double pole circuit breaker for a future HPWH installation. The reserved space shall be permanently marked as "For Future 240V use"; and
 - Either a dedicated cold water supply, or the cold water supply shall pass through the designated HPWH location just before reaching the gas or propane water heater; and
 - The hot water supply pipe coming out of the gas or propane water heater shall be routed first through the designated HPWH location before serving any fixtures; and
 - The hot and cold water piping at the designated HPWH location shall be exposed and readily accessible for future installation of an HPWH; and
 - A condensate drain that is no more than 2 inches higher than the base of the installed water heater, and allows natural draining without pump assistance.

(s) **Energy Storage Systems (ESS) ready.** All single-family residences that include one or two dwelling units shall meet the following. All electrical components shall be installed in accordance with the California Electrical Code:

- At least one of the following shall be provided:
 - ESS ready interconnection equipment with a minimum backed-up capacity of 60 amps and a minimum of four ESS-supplied branch circuits, or
 - A dedicated raceway from the main service to a panelboard (subpanel) that supplies the branch circuits in Section 150.0(y)(2). All branch circuits are permitted to be supplied by the main service panel prior to the installation of an ESS. The trade size of the raceway shall be not less than one inch. The panelboard that supplies the branch circuits (subpanel) must be labeled "Subpanel shall include all backed-up load circuits."
- A minimum of four branch circuits shall be identified and have their source of supply collocated at a single panelboard suitable to be supplied by the ESS. At least one circuit shall supply the refrigerator, one lighting circuit shall be located near the primary egress, and at least one circuit shall supply a sleeping room receptacle outlet.
- The main panelboard shall have a minimum busbar rating of 225 amps.
- Sufficient space shall be reserved to allow future installation of a system isolation equipment/transfer switch within 3 feet of the main panelboard. Raceways shall be installed between the panelboard and the system isolation equipment/transfer switch location to allow the connection of backup power source.

2022 Single-Family Residential Mandatory Requirements Summary

(NOTE: Single-family residential buildings subject to the Energy Codes must comply with all applicable mandatory measures, regardless of the compliance approach used. Review the respective section for more information. (04/2022)

Building Envelope:

§ 110.6(a)(1)	Air Leakage. Manufactured fenestration, exterior doors, and exterior pet doors must limit air leakage to 0.3 CFM per square foot or less when tested per NFRG-400, ASTM E283, or AAMAWDDMCA 10.11.2 (A4.40.2011.1).
§ 110.6(a)(6)	Labeling. Fenestration products and exterior doors must have a label meeting the requirements of § 110.11(a).
§ 110.6(b)	Field fabricated exterior doors and fenestration products must use U-factors and solar heat gain coefficient (SHGC) values from Table A.110.6.5-110.6.5-15 for exterior doors. They must be caulked and/or weather-stripped.
§ 110.7	Air Leakage. All joints, penetrations, and other openings in the building envelope that are potential sources of air leakage must be caulked, gasketed, or weather stripped.
§ 110.8(a)	Insulation Certification by Manufacturers. Insulation must be certified by the Department of Consumer Affairs, Bureau of Household Goods and Services (EHSG).
§ 110.8(a)	Insulation Requirements for Heated Slab Floors. Heated slab floors must be insulated per the requirements of § 110.8(b).
§ 110.8(b)	Roofing Products Solar Reflectance and Thermal Emittance. The thermal emittance and aged solar reflectance values of the roofing material must meet the requirements of § 110.8(b) and be labeled per § 10-113 when the installation of a cool roof is specified on the CFIR.
§ 110.8(b)	Radiant Barrier. When required, radiant barriers must have an emittance of 0.05 or less and be certified to the Department of Consumer Affairs.
§ 150.0(a)	Roof Deck, Ceiling and Rafter Roof Insulation. Roof decks in newly constructed attics in climate zones 4 and 6-16 area-weighted average U-factor not exceeding U0.194. Ceiling and rafter roofs minimum R-22 insulation in wood-frame ceiling, or area-weighted average U-factor must not exceed 0.045. Rafter roof alterations minimum R-19 or area-weighted average U-factor of 0.054 or less. Also access doors must have permanently attached insulation using adhesive or mechanical fasteners. The attic access must be gasketed to prevent air leakage. Insulation must be installed in direct contact with a roof or ceiling which is sealed to limit infiltration and exfiltration, as specified in § 110.7, including but not limited to placing insulation either above or below the roof deck or on top of a drywall ceiling.
§ 150.0(b)	Loose-Fill Insulation. Loose fill insulation must meet the manufacturer's required density for the labeled R-value.
§ 150.0(c)	Wall Insulation. Minimum R-13 insulation in 2x4 inch wood framing wall or have a U-factor of 0.102 or less; or R-20 in 2x6 inch wood framing or have a U-factor of 0.071 or less. Openage non-framed assemblies must have an overall assembly U-factor not exceeding 0.102. Masonry walls must meet Tables 150.1A or B.
§ 150.0(d)	Raised-floor Insulation. Minimum R-19 insulation in raised wood framed floor or 0.037 maximum U-factor.
§ 150.0(f)	Slab Edge Insulation. Slab edge insulation must meet all of the following: have a water absorption rate, for the insulation material alone without facings, no greater than 0.3 percent, have a water vapor permeance no greater than 2.0 perm inch, be protected from physical damage and UV light deterioration, and, when installed as part of a heated slab floor, meet the requirements of § 110.8(b).
§ 150.0(g)(1)	Vapor Retarder. In climate zones 1 through 16, the earth floor of unvented crawl space must be covered with a Class I or Class II vapor retarder. This requirement also applies to controlled ventilation crawl space for buildings complying with the exception to § 150.0(g)(2).
§ 150.0(g)(2)	Vapor Retarder. In climate zones 14 and 16, a Class I or Class II vapor retarder must be installed on the conditioned space side of all insulation in all exterior walls, vented attics, and unvented attics with air-permeable insulation.
§ 150.0(g)	Fenestration Products. Fenestration, including skylights, separating conditioned space from unconditioned space or outdoors must have a maximum U-factor of 0.45; or area-weighted average U-factor of all fenestration must not exceed 0.45.

Fireplaces, Decorative Gas Appliances, and Gas Log:

§ 110.5(e)	Pilot Light. Continuously burning pilot lights are not allowed for indoor and outdoor fireplaces.
§ 150.0(e)(1)	Closable Doors. Masonry or factory-built fireplaces must have a closable metal or glass door covering the entire opening of the firebox.
§ 150.0(e)(2)	Combustion Intake. Masonry or factory-built fireplaces must have a combustion outside air intake, which is at least six square inches in area and is equipped with a readily accessible, operable, and light-tight damper or combustion-air control device.
§ 150.0(e)(3)	Flue Damper. Masonry or factory-built fireplaces must have a flue damper with a readily accessible control.

Space Conditioning, Water Heating, and Plumbing System:

§ 110.5-110.3	Certification. Heating, ventilation, and air conditioning (HVAC) equipment, water heaters, showerheads, faucets, and all other regulated appliances must be certified by the manufacturer to the California Energy Commission.
§ 110.2(a)	HVAC Efficiency. Equipment must meet the applicable efficiency requirements in Table 110.2-A through Table 110.2-I.
§ 110.2(b)	Controls for Heat Pumps with Supplementary Electric Resistance Heating. Heat pumps with supplementary electric resistance heaters must have controls that prevent supplementary heater operation when the heating load can be met by the heat pump alone; and in which the cut-on temperature for compression heating is higher than the cut-on temperature for supplementary heating, and the cut-off temperature for compression heating is higher than the cut-off temperature for supplementary heating.
§ 110.2(c)	Thermostats. All heating or cooling systems not controlled by a central energy management control system (EMCS) must have a setback thermostat.
§ 110.3(a)(3)	Insulation. Unfired service water heater storage tanks and solar water-heating backup tanks must have adequate insulation, or tank surface heat loss rating.
§ 110.3(a)(6)	Isolation Valves. Instantaneous water heaters with an input rating greater than 6 Btu per hour (2 kW) must have isolation valves with hose bibbs or other fittings on both cold and hot water lines to allow for flushing the water heater when the valves are closed.

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

(t)	Heat pump space heater ready. Systems using gas or propane furnace to serve individual dwelling units shall include the following: <ol style="list-style-type: none"> A dedicated 240 volt branch circuit wiring shall be installed within 3 feet from the furnace and accessible to the furnace with no obstructions. The branch circuit conductors shall be rated at 30 amps minimum. The blank cover shall be identified as "240V ready." All electrical components shall be installed in accordance with the California Electrical Code. The main electrical service panel shall have a reserved space to allow for the installation of a double pole circuit breaker for a future heat pump space heater installation. The reserved space shall be permanently marked as "For Future 240V use."
(u)	Electric cooktop ready. Systems using gas or propane cooktop to serve individual dwelling units shall include the following: <ol style="list-style-type: none"> A dedicated 240 volt branch circuit wiring shall be installed within 3 feet from the cooktop and accessible to the cooktop with no obstructions. The branch circuit conductors shall be rated at 30 amps minimum. The blank cover shall be identified as "240V ready." All electrical components shall be installed in accordance with the California Electrical Code. The main electrical service panel shall have a reserved space to allow for the installation of a double pole circuit breaker for a future electric cooktop installation. The reserved space shall be permanently marked as "For Future 240V use."
(v)	Electric clothes dryer ready. Clothes dryer locations with gas or propane plumbing to serve individual dwelling units shall include the following: <ol style="list-style-type: none"> A dedicated 240 volt branch circuit wiring shall be installed within 3 feet from the clothes dryer location and accessible to the clothes dryer location with no obstructions. The branch circuit conductors shall be rated at 30 amps minimum. The blank cover shall be identified as "240V ready." All electrical components shall be installed in accordance with the California Electrical Code. The main electrical service panel shall have a reserved space to allow for the installation of a double pole circuit breaker for a future electric clothes dryer installation. The reserved space shall be permanently marked as "For Future 240V use."

NOTE: PV Solar is designed to have a minimum of 2.15 kW with no shading over the solar panels. Azimuth 150–270 degrees, tilt is less than 7:12. If there parameters cannot be met, please advise by calling CompuCalc at (530) 268-8722.

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

§ 110.5	Pilot Lights. Continuously burning pilot lights are prohibited for natural gas, fan-type central furnaces, household cooking appliances (except appliances without an electrical supply voltage connection with pilot lights that consume less than 150 Btu per hour), and pool and spa heaters.
§ 150.0(n)(1)	Building Cooling and Heating Loads. Heating and/or cooling loads are calculated in accordance with the ASHRAE Handbook, Equipment Volume, and Fundamentals Volume, the SMACNA Residential Comfort System Installation Standards Manual, or the ACCA Manual of Load Design conditions specified in § 150.0(h)(2).
§ 150.0(n)(3A)	Cleanances. Air conditioner and heat pump outdoor condensing units must have a clearance of at least five feet from the outlet of any dryer.
§ 150.0(n)(3B)	Liquid Line Drier. Air conditioners and heat pump systems must be equipped with liquid line filter driers if required, as specified by the manufacturer's instructions.
§ 150.0(n)	Water Piping, Solar Water-Heating System Piping, and Space Conditioning System Line Insulation. All domestic hot water piping must be insulated as specified in § 609.11 of the California Plumbing Code.
§ 150.0(n)(2)	Insulation Protection. Piping insulation must be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind as required by § 120.3(b). Insulation exposed to weather must be water retardant and protected from UV light (no adhesive tapes). Insulation covering chilled water piping and refrigerant suction piping located outside the conditioned space must include, or be protected by, a Class I or Class II vapor retarder. Pipe insulation buried below grade must be installed in a waterproof and non-combustible casing or sleeve.
§ 150.0(n)(1)	Gas or Propane Water Heating Systems. Systems using gas or propane water heaters to serve individual dwelling units must designate a space at least 2.5' x 2.5' x 7' suitable for the future installation of a heat pump water heater, and meet electrical and plumbing requirements, based on the distance between this designated space and the water heater location, and a condensate drain no more than 2' higher than the base of the water heater.
§ 150.0(n)(3)	Solar Water-Heating Systems. Solar water-heating systems and collectors must be certified and labeled by the Solar Rating and Certification Corporation (SRCC), the International Association of Plumbing and Mechanical Officials, Research and Testing (IAPMO) RRT, or by a listing agency that is approved by the executive director.

Ducts and Fans:

§ 110.9(a)(3)	Ducts. Insulation installed on an existing space-conditioning duct must comply with § 604.0 of the California Mechanical Code (CMC). The contractor installs the insulation, the contractor must certify to the customer, in writing, that the insulation meets the requirements of § 604.0 of the CMC. All air-distribution system ducts and plenums must meet CMC §§ 601.0-605.0 and ANSI/ACCA/CNA-006-2021 HVAC Duct Construction Standards Metal and Flexible 3rd Edition. Portions of supply-air and return-air ducts and plenums must be insulated to R-6.0 or higher; ducts located entirely in conditioned space as confirmed through field verification and documentation (see § 14.3.8) do not require insulation. Connections of metal ducts and inner core of flexible ducts must be sealed with mastic. Sealings must be sealed with mastic, tape, or other duct-closure system that meets the applicable UL requirements. Connections of flexible ducts must be sealed with mastic, tape, or other duct-closure system that meets the applicable UL requirements. The combination of mastic and seal tape must be used to seal openings greater than 1/8 inch in diameter. Sealings used. Building cavities, air handler support platforms, and plenums connected or constructed with materials other than galvanized sheet metal, duct board or flexible duct must not be used to convey conditioned air. Building cavities and support platforms may contain ducts; ducts installed in these spaces must not be compressed.
§ 150.0(n)(1)	Factory-Fabricated Duct Systems. Factory-fabricated duct systems must comply with applicable requirements for duct construction, connections, and closures, joints and seams of duct systems and their components. The ducts must be sealed with cloth back rubber adhesive duct tapes unless such tapes are used in combination with mastic and draw bands.
§ 150.0(n)(3)	Field-Fabricated Duct Systems. Field-fabricated duct systems must comply with applicable requirements for pressure-sensitive tapes, sealsants, and other requirements specified for duct construction.
§ 150.0(n)(7)	Backdraft Damper. Fan systems that exchange air between the conditioned space and outdoors must have backdraft or automatic damper.
§ 150.0(n)(8)	Gravity Ventilation Dampers. Gravity venting systems in the conditioned space must have either automatic or readily accessible, manually operated dampers in all openings to the outside, except combustion inlet and outlet air openings and elevator shaft vents.
§ 150.0(n)(9)	Protection of Insulation. Insulation must be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather must be suitable for outdoor service (e.g., protected by aluminum, steel metal, painted canvas, or plastic cover). Cellular foam insulation must be protected as above, and must have a water retardant and solar radiation-resistant coating.
§ 150.0(n)(10)	Porous Inner Core Flex Duct. Porous inner core flex ducts must have a non-porous layer or air barrier between the inner core and outer case fabric.
§ 150.0(n)(11)	Duct System Sealing and Leakage Test. When space conditioning systems use forced air duct systems to supply conditioned air to the occupied space, the ducts must be sealed and leakage tested, as confirmed through field verification and diagnostic testing, in accordance with Reference Residential Appendix RA3.1.
§ 150.0(n)(12)	Air Filtration. Space conditioning systems with ducts exceeding 10 feet and the supply side of ventilation systems must have MERV 13 or equivalent filter. Space conditioning systems must have a two inch depth or can be one inch if sized per Equation 150.0-A. Clean-filter pressure drop and static pressure must meet the requirements in § 150.0(n)(12). Filters must be accessible for regular service. Filter racks or gaskets must be gasketed, or other means to close gaps around the inserted filters to prevent air from bypassing the filter.

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

§ 150.0(n)(1)	Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JAB.
§ 150.0(n)(1F)	Light Sources in Enclosed or Recessed Luminaires. Lamps and other separable light sources that are not compliant with the JAB elevated temperature requirements, including marking requirements, must not be installed in enclosed or recessed luminaires.
§ 150.0(n)(1)	Light Sources in Drawers, Cabinets, and Linen Closets. Light sources internal to drawers, cabinetry or linen closets are not required to comply with Table 150.0-A, but are required to comply with the requirements of § 150.0(n)(12). Fillets must be accessible for regular service. Fillet racks or gaskets must be gasketed, or other means to close gaps around the inserted filters to prevent air from bypassing the filter.
§ 150.0(n)(2A)	Interior Switches and Controls. All forward phase out dimmers used with LED light sources must comply with NEMA SSL 7A.
§ 150.0(n)(2B)	Interior Switches and Controls. Exhaust fans must be controlled separately from lighting systems.
§ 150.0(n)(2A)	Accessible Controls. Lighting must have readily accessible wall-mounted controls that allow the lighting to be manually turned on and off.
§ 150.0(n)(2C)	Multiple Controls. Controls must not bypass a dimmer, occupant sensor, or vacancy sensor function if the dimmer or sensor is installed to comply with § 150.0(n).
§ 150.0(n)(2C)	Energy Management Control Systems. An energy management control system (EMCS) may be used to comply with dimming, occupancy, and control requirements if it provides the functionality of the specified control per § 110.9 and the physical controls specified in § 150.0(n)(2A).
§ 150.0(n)(2E)	Automatic Shutoff Controls. In bedrooms, garages, laundry rooms, utility rooms and walk-in closets, at least one installed luminaire must be controlled by an occupancy or vacancy sensor providing automatic-off functionality. Lighting inside drawers and cabinets with opaque fronts or doors must have controls that turn the light off when the drawer or door is closed.
§ 150.0(n)(2F)	Dimmers. Lighting in habitable spaces (e.g., living rooms, dining rooms, kitchens, and bedrooms) must have readily accessible wall-mounted dimming controls that allow the lighting to be manually adjusted up and down. Forward phase out dimmers controlling LED light sources in these spaces must comply with NEMA SSL 7A.
§ 150.0(n)(2K)	Independent controls. Integrated lighting of exhaust fans shall be controlled independently from the fans. Lighting under cabinets or shelves, lighting in display cabinets, and switched outlets must be controlled separately from ceiling-installed lighting.
§ 150.0(n)(3A)	Residential Outdoor Lighting. For single-family residential buildings, outdoor lighting permanently mounted to a residential building, or to other structures on the same lot, must have a manual on/off switch and either a photocell and motion sensor or automatic time switch control or an astronomical time clock. An energy management control system that provides the specified control functionality and meets all applicable requirements may be used to meet these requirements.
§ 150.0(n)(4)	Internally illuminated address signs. Internally illuminated address signs must comply with § 140.6 or consume no more than 5 watts of power.
§ 150.0(n)(5)	Residential Garages for Eight or More Vehicles. Lighting for residential parking garages for eight or more vehicles must comply with the applicable requirements for nonresidential garages in §§ 110.9, 130.0, 130.1, 130.4, 140.6, and 141.0.

Solar Readiness:

§ 110.10(a)(1)	Single-Family Residences. Single-family residences located in subdivisions with 10 or more single-family residences and where the application for a tentative subdivision map for the residences has been deemed complete and approved by the enforcement agency, which do not have a photovoltaic system installed, must comply with the requirements of § 110.10(b)(4).
§ 110.10(b)(1A)	Minimum Solar Zone Area. The solar zone must have a minimum total area as described below. The solar zone must comply with access, pathway, smoke ventilation, and spacing requirements as specified in Title 24, Part 9 or other parts of Title 24 or in any requirements adopted by a local jurisdiction. The solar zone total area must be comprised of areas that have no dimension less than 5 feet and are no less than 80 square feet each for buildings with roof areas less than or equal to 10,000 square feet or no less than 160 square feet each for buildings with roof areas greater than 10,000 square feet. For single-family residences, the solar zone must be located on the roof or overhang of the building and have a total area no less than 250 square feet.
§ 110.10(b)(2)	Azimuth. All sections of the solar zone located on steep-sloped roofs must have an azimuth between 90-300° of true north.
§ 110.10(b)(3A)	Shading. The solar zone must not contain any obstructions, including but not limited to vents, chimneys, architectural features, and roof-mounted equipment.
§ 110.10(b)(3B)	Shading. Any obstruction located on the roof or any other part of the building that projects above a solar zone must be located at least twice the horizontal distance of the height difference between the highest point of the obstruction and the horizontal projection of the nearest point of the solar zone, measured in the vertical plane.
§ 110.10(b)(4)	Structural Design Loads on Construction Documents. For areas of the roof designated as a solar zone, the structural design loads for roof dead load and roof live load must be clearly indicated on the construction documents.
§ 110.10(d)	Interconnection Pathways. The construction documents must include a location reserved for inverters and metering equipment and a pathway reserved for routing of conduit from the solar zone to the point of interconnection with the electrical service; and for single-family residences and central water-heating systems, a pathway reserved for routing plumbing from the solar zone to the water-heating system.
§ 110.10(d)	Documentation. A copy of the construction documents or a comparable document indicating the information from §§ 110.10(b)-(g) must be provided to the occupant.
§ 110.10(e)(1)	Main Electrical Service Panel. The main electrical service panel must have a minimum busbar rating of 200 amps.
§ 110.10(e)(2)	Main Electrical Service Panel. The main electrical service panel must have a reserved space to allow for the installation of a double pole circuit breaker for a future solar electric installation. The reserved space must be permanently marked as "For Future Solar Electric."

5/6/22

2022 Single-Family Residential Mandatory Requirements Summary

§ 150.0(n)(13)	Space Conditioning System Airflow Rate and Fan Efficacy. Space conditioning systems that use ducts to supply cooling must have a hole for the placement of a static pressure probe, or a permanently installed static pressure probe in the supply plenum. Airflow must be ≥ 350 CFM per ton of nominal cooling capacity, and an air-handling unit fan efficacy ≥ 0.45 watts per CFM for gas furnace air handlers and ≥ 0.28 watts per CFM for other fans. Small duct high velocity systems must provide an airflow ≥ 250 CFM per ton of nominal cooling capacity, and an air-handling unit fan efficacy ≥ 0.62 watts per CFM. Field verification testing is required in accordance with Reference Residential Appendix RA3.3.*
----------------	--

Ventilation and Indoor Air Quality:

§ 150.0(n)(1)	Requirements for Ventilation and Indoor Air Quality. All dwelling units must meet the requirements of ASHRAE Standard 62.2, Ventilation and Acceptable Indoor Air Quality in Residential Buildings subject to the amendments specified in § 150.0(j) 1.*
§ 150.0(n)(1B)	Central Fan Integrated (CFI) Ventilation Systems. Continuous operation of CFI air handlers is not allowed to provide the whole-dwelling unit ventilation airflow required per § 150.0(j) 1C. A motorized damper(s) must be installed on the ventilated duct(s) that prevents all airflow through the space conditioning duct system when the damper(s) is closed and uncontrolled per § 150.0(j) 1B(iii). CFI ventilation systems must have controls that track outdoor air ventilation run time, and either open or close the motorized damper(s) for compliance with § 150.0(j) 1C.
§ 150.0(n)(1C)	Whole-Dwelling Unit Mechanical Ventilation for Single-Family Detached and townhouses. Single-family detached dwelling units, and attached dwelling units not sharing ceilings or floors with other dwelling units, occupiable spaces, public garages, or commercial spaces must have mechanical ventilation airflow specified in § 150.0(j) 1C(i).
§ 150.0(n)(1G)	Local Mechanical Exhaust. Kitchens and bathrooms must have mechanical exhaust, nonenclosed kitchens must have demand-controlled exhaust system meeting requirements of § 150.0(j) 1G(i), enclosed kitchens and bathrooms can use demand-controlled or continuous exhaust meeting § 150.0(j) 1G(i)-iv. Airflow must be provided by the installer per § 150.0(j) 1G(v), and rated for sound per § 150.0(j) 1G(u).*
§ 150.0(n)(1)(8)	Airflow Measurement and Sound Ratings of Whole-Dwelling Unit Ventilation Systems. The airflow required per § 150.0(j) 1C must be measured by using a flow hood, flow grid, or other airflow measuring device at the fan's inlet or outlet terminals/signs per Reference Residential Appendix RA3.7. Whole-Dwelling unit ventilation systems must be rated for sound per ASHRAE 62.2 § 87.2 at no less than the minimum airflow rate required by § 150.0(j) 1C.
§ 150.0(n)(2)	Field Verification and Diagnostic Testing. Whole-Dwelling Unit ventilation airflow, vented range hood airflow and sound rating, and HRV and ERV fan efficacy must be verified in accordance with Reference Residential Appendix RA3.7. Vented range hoods must be verified per Reference Residential Appendix RA3.7.4.3 to confirm if it is rated by HV or AHAM to comply with the airflow rates and sound requirements per § 150.0(j) 1G.

Pool and Spa Systems and Equipment:

§ 110.4(a)	Certification by Manufacturers. Any pool or spa heating system or equipment must be certified to have all of the following compliance with the Appliance Efficiency Regulations and listing in MAEDES, an on-off switch mounted outside of the heater that allows shutting off the heater without adjusting the thermostat setting, a permanent weatherproof plate or card with operating instructions, and must not use electric resistance heating.*
§ 110.4(b)(1)	Piping. Any pool or spa heating system or equipment must be installed with all least 3/8 inches of pipe between the filter and the heater, or dedicated suction and return lines, or built-in or built-up connectors to allow for future solar heating.
§ 110.4(b)(2)	Covers. Outdoor pools or spas that have a heat pump or gas heater must have a cover.
§ 110.4(b)(3)	Directional Inlets and Time Switches for Pools. Pools must have directional inlets that adequately mix the pool water, and a time switch for the pump and heater that is programmed to run only during off-peak electric demand periods.
§ 110.5	Pilot Light. Natural gas pool and spa heaters must not have a continuously burning pilot light.
§ 150.0(p)	Pool Systems and Equipment Installation. Residential pool systems or equipment must meet the specified requirements for pump sizing, flow rate, piping, filters, and valves.*

Lighting:

§ 110.9	Lighting Controls and Components. All lighting control devices and systems, ballasts, and luminaires must meet the applicable requirements of § 110.9.*
§ 150.0(n)(1A)	Luminaire Efficacy. All installed luminaires must meet the requirements in Table 150.0-A, except lighting integral to exhaust fans, kitchen range hoods, bath vanity mirrors, and garage door openers; navigation lighting less than 5 watts; and lighting internal to drawers, cabinets, and linen closets with an efficacy of at least 45 lumens per watt.
§ 150.0(n)(1B)	Screw based luminaires. Screw based luminaires must contain lamps that comply with Reference Joint Appendix JAB.*
§ 150.0(n)(1C)	Recessed Downlight Luminaires in Ceilings. Luminaires recessed into ceilings must not contain screw based sockets, must be airtight, and must be labeled with a gasket or